

# BRYANT & STRATTON

110 BROADWAY

BUFFALO, NY

ARCHITECT:

DATE: 04-03-2020

## SILVESTRI ARCHITECTS, P.C.

1321 MILLERSPORT HIGHWAY, SUITE 101 AMHERST, NY 14221 (716) 691-0900

### STRUCTURAL ENGINEER:

S.A. PROJECT # 19099.02

## STUDIO T3 ENGINEERING, PLLC

2495 MAIN STREET, SUITE 301 **BUFFALO, NEW YORK 14214** (716) 803-6400

### MEP ENGINEER:

## EBS ENGINEERING, PC


2568 WALDEN AVE., SUITE 107 CHEEKTOWAGA, NY 14225 (716) 836-9600

### CONSTRUCTION MANAGER:

## P.A.T. CONSTRUCTION MANAGEMENT CORP.

2457 WEHRLE DRIVE WILLIAMSVILLE, NY 14221

### DRAWING AREA LOGIC

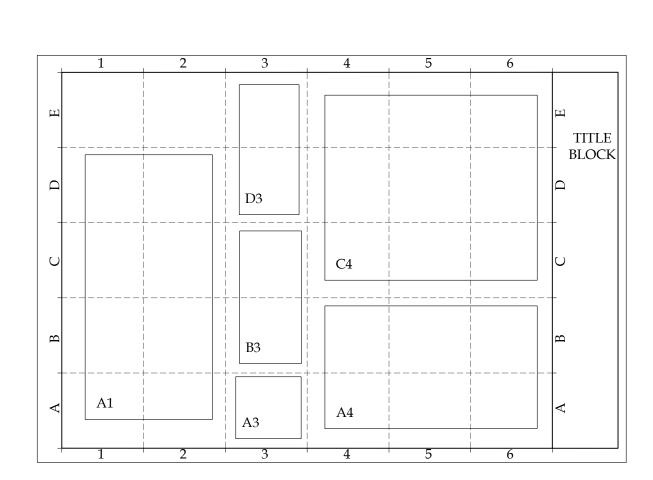

### SHEET INDEX

### STRUCTURAL:

FOLDING PARTITION FRAMING PLAN

### ARCHITECTURAL:

SECOND FLOOR DEMOLITION PLAN GENERAL NOTES ACCESSIBILITY REQUIREMENTS 1 OF 2 ACCESSIBILITY REQUIREMENTS 2 OF 2 SECOND FLOOR CODE COMPLIANCE

PARTITION TYPES

SECOND FLOOR PLAN SECOND FLOOR REFLECTED CEILING

SECOND FLOOR SPACE ALLOCATION PLAN

ENLARGED FLOOR PLANS & INTERIOR **ELEVATIONS** 

ENLARGED FLOOR PLANS & INTERIOR **ELEVATIONS** ENLARGED FLOOR PLANS & INTERIOR

**ELEVATIONS** A-404 ENLARGED FLOOR PLANS & INTERIOR

**ELEVATIONS** CEILING DETAILS

MILLWORK DETAILS MILLWORK DETAILS

DOOR SCHEDULE AND DETAILS

WINDOW TYPES

FINISH SCHEDULE & GENERAL NOTES FINISH LEGEND

FINISH FLOOR PLAN

### MECHANICAL:

## PLUMBING:

## **ELECTRIC:**

### FIRE PROTECTIONS:


TBD

### **ABBREVIATIONS**


MACHINE MANHOLE MANUFACTURE

MATERIAL MAXIMUM MECHANICAL


METAL
METAL
METAL TOILET PARTITION
MINIMUM
MISCELLANEOUS
MULLION

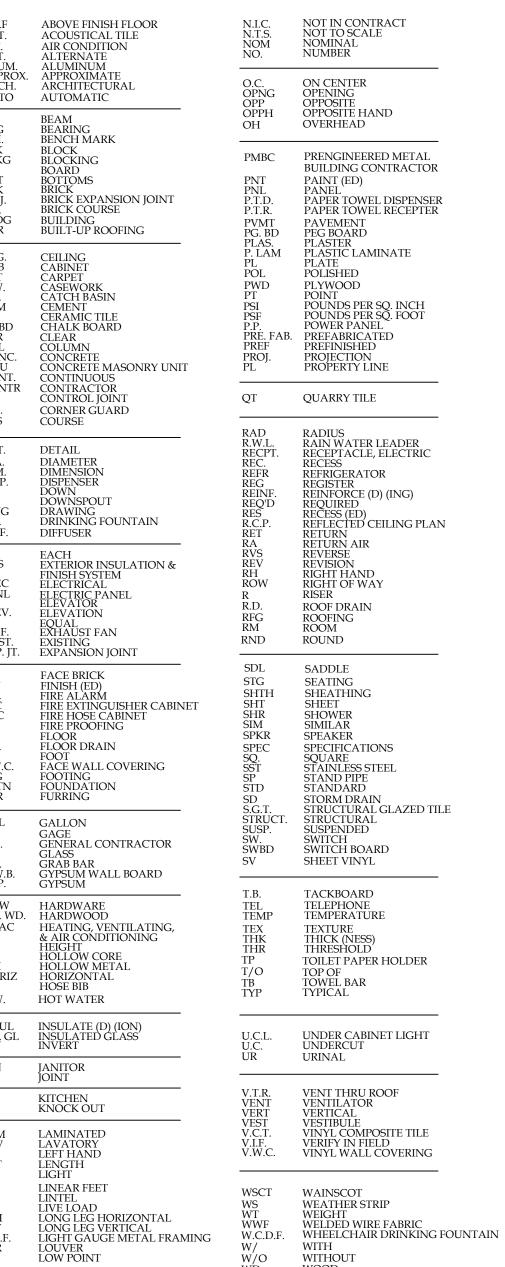

### DRAFTING SYMBOLS

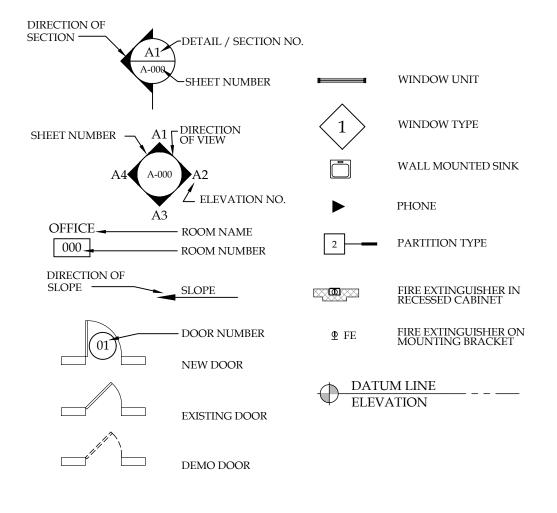

### MATERIAL SYMBOLS

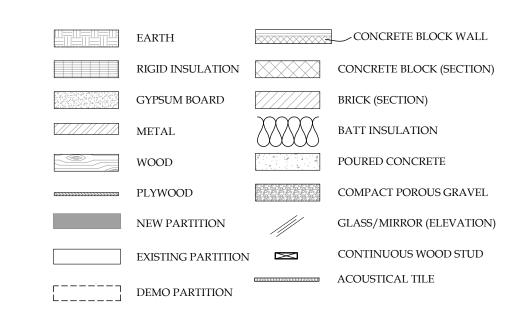


### **BUILDING DATA**

OCCUPANCY CLASSIFICATION: B CONSTRUCTION TYPE: 2B

2019-04-06: ISSUED FOR BID

## **ISSUE**

#### SHEET IDENTIFICATION LOGIC

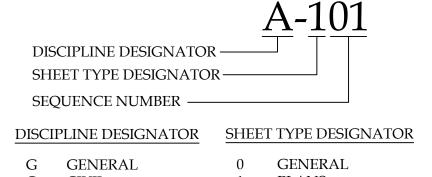


CIVIL LANDSCAPE STRUCTURAL

ELECTRICAL

ARCHITECTURAL PLUMBING MECHANICAL

PLANS **ELEVATIONS** SECTIONS LARGE SCALE VIEWS DETAILS SCHEDULES &

DIAGRAMS

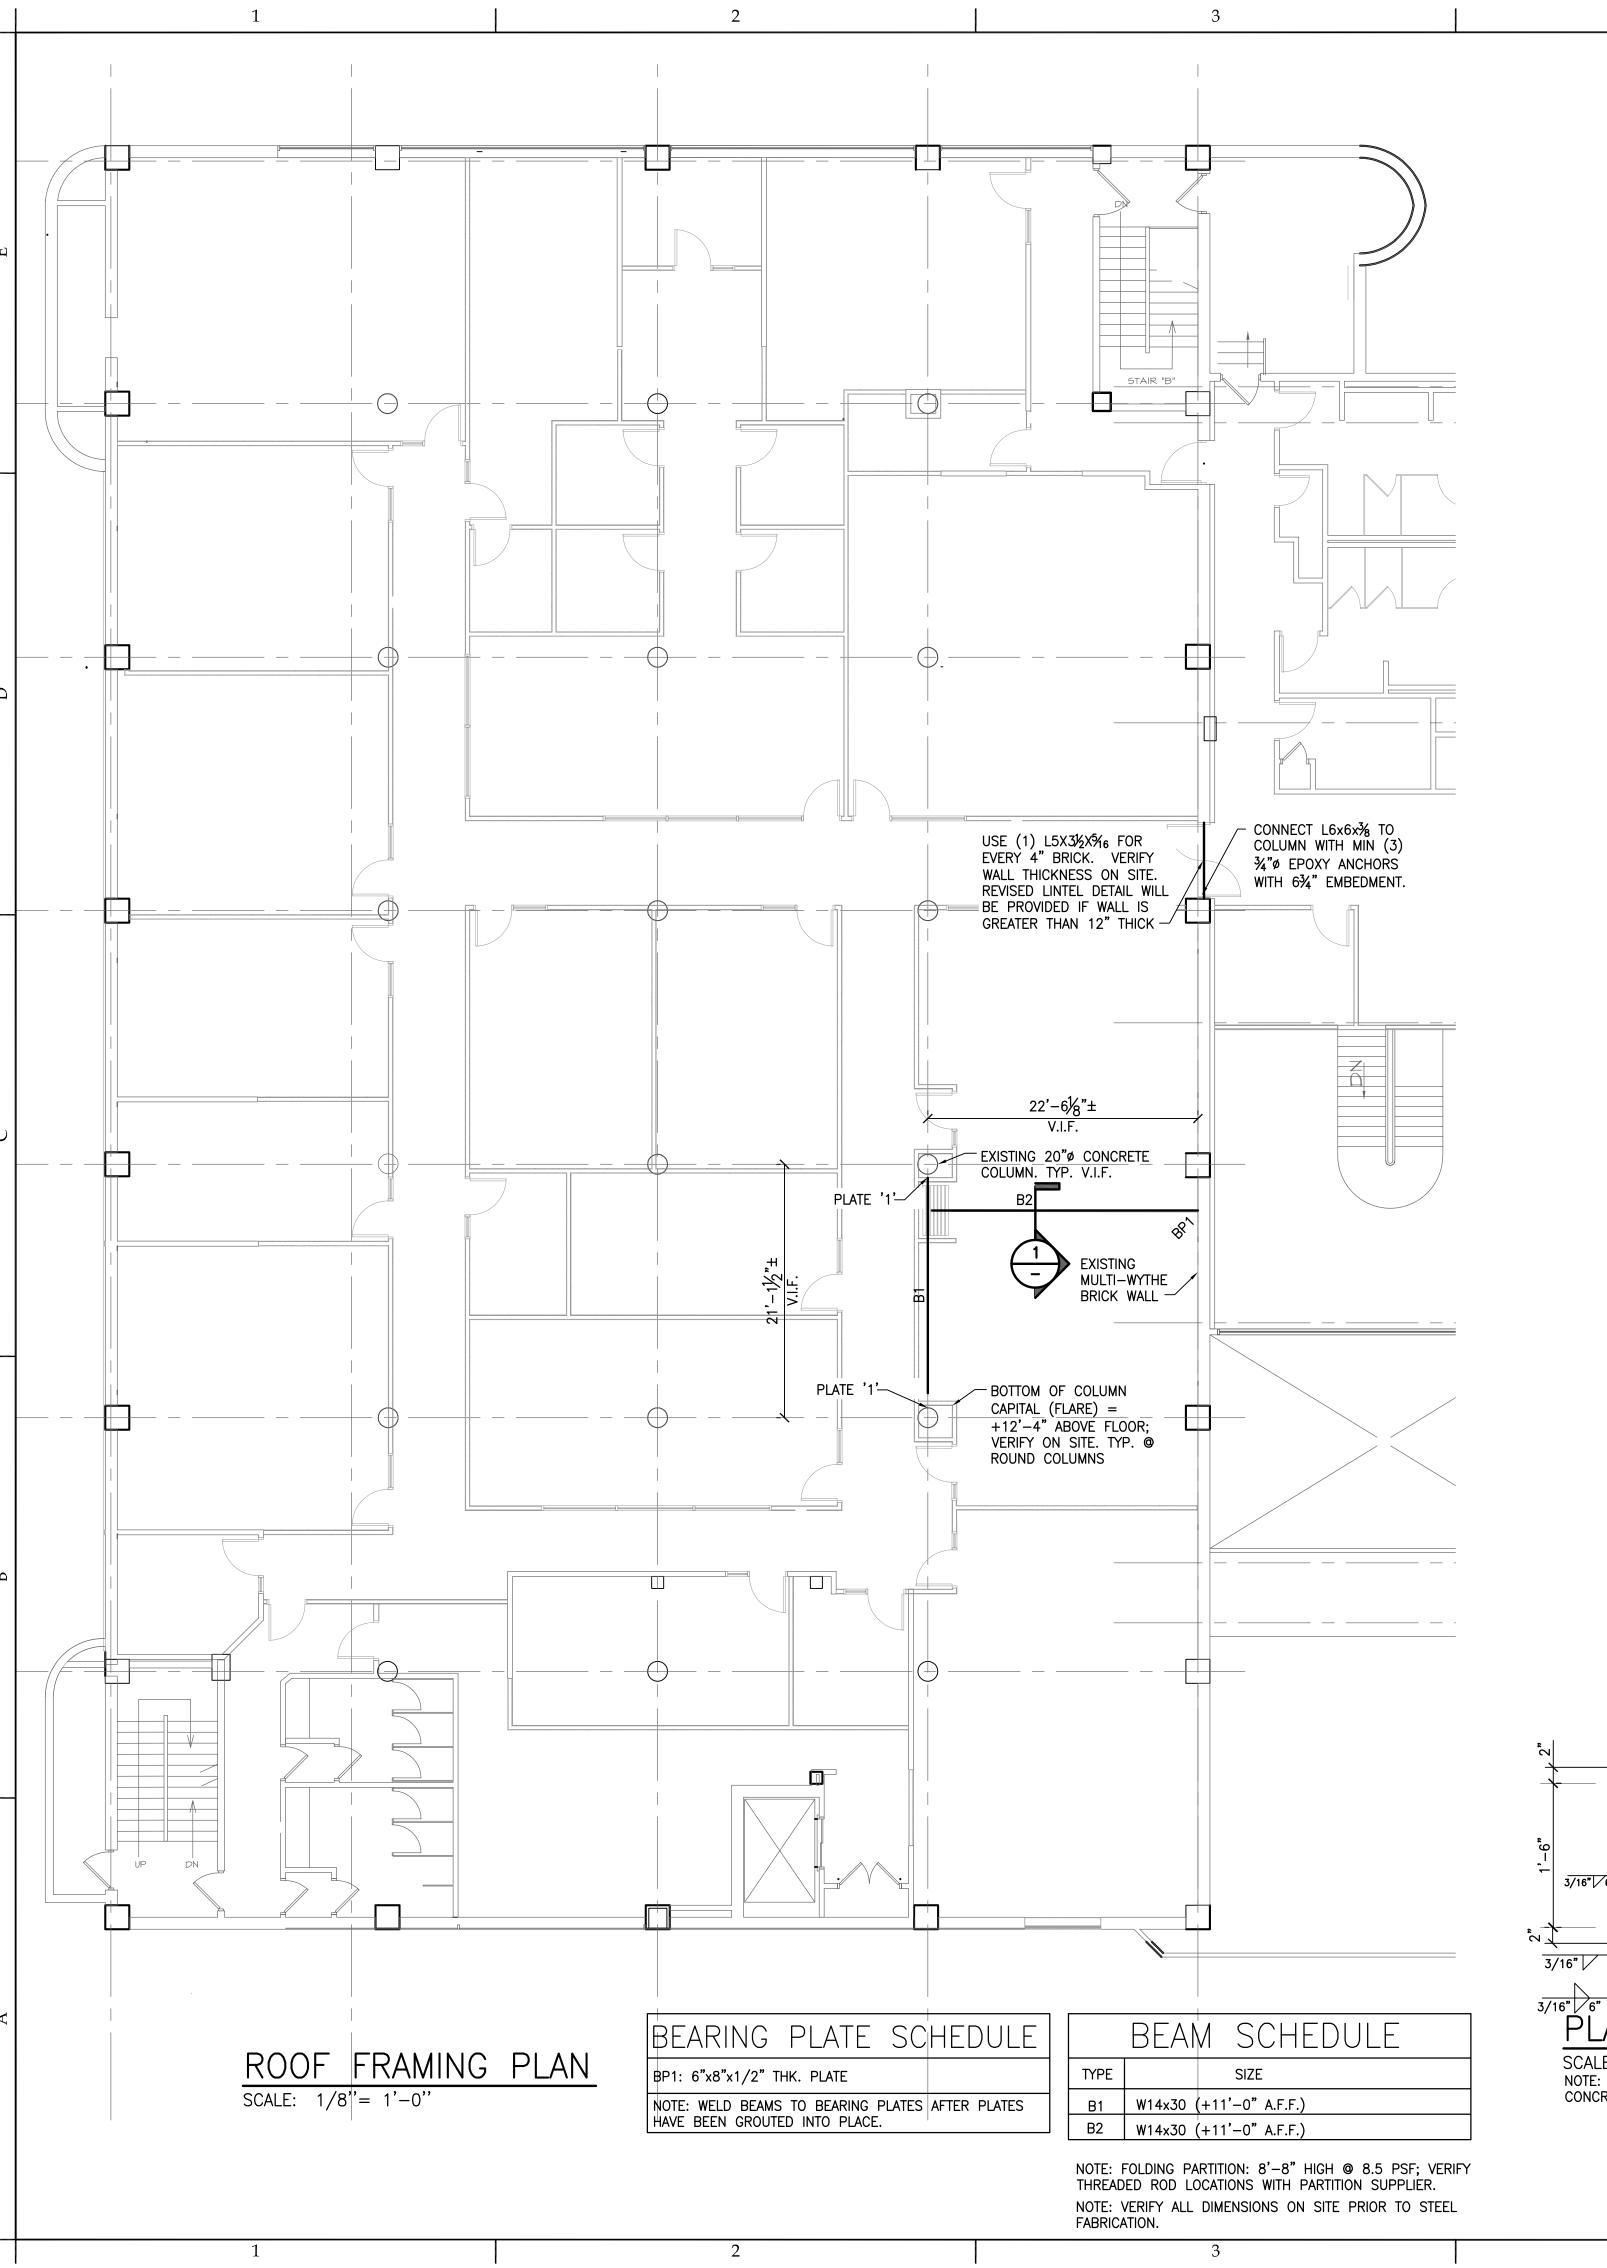

### **GENERAL NOTES:**

- 1. THE STRUCTURAL DESIGN IS IN ACCORDANCE WITH CHAPTER 16 2015 INTERNATIONAL BUILDING CODE.
- 2. THE GENERAL CONTRACTOR SHALL INSURE THAT ALL WORK IS COMPLETED IN ACCORDANCE WITH ALL APPLICABLE FEDERAL, STATE AND LOCAL BUILDING CODES AND ORDINANCES.
- 3. REPRODUCTION OF ANY PORTION OF THE STRUCTURAL DRAWINGS IS A VIOLATION OF COPYRIGHT LAWS. ALL PLANS, NOTES, DETAILS, AND SECTIONS MUST BE REDRAWN AND COORDINATED WITH THE ARCHITECTURAL DRAWINGS. REPRODUCED CONTRACT DOCUMENTS THAT ARE SUBMITTED WILL NOT BE REVIEWED.
- 4. THE GENERAL CONTRACTOR SHALL VERIFY ALL INFORMATION SHOWN ON THE PLANS PRIOR TO INITIATING CONSTRUCTION, AND SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DISCREPANCIES BETWEEN EXISTING CONDITIONS AND THOSE SHOWN ON THE PLANS FOR POSSIBLE MODIFICATION OF THE DESIGN OR DETAILS.
- 5. THE CONTRACTOR SHALL REFER TO ARCHITECTURAL DRAWINGS FOR INFORMATION NOT NOTED ON THE STRUCTURAL DRAWINGS. THE CONTRACTOR SHALL COMPARE THE STRUCTURAL DRAWINGS WITH THE ARCHITECTURAL DRAWINGS AND REPORT ANY DISCREPANCIES TO THE ENGINEER PRIOR TO COMPLETION OF SHOP DRAWINGS.
- 6. ANY DEVIATION FROM, ADDITION TO, SUBSTITUTION FOR, OR MODIFICATIONS TO THE STRUCTURE SHOWN ON THESE DRAWINGS SHALL BE SUBMITTED IN WRITING TO THE ENGINEER FOR REVIEW. SHOP DRAWINGS THAT ARE SUBMITTED FOR REVIEW DO NOT CONSTITUTE "IN WRITING" UNLESS IT IS CLEARLY NOTED THAT SPECIFIC CHANGES ARE BEING SUGGESTED.
- 7. THE STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHODS OF CONSTRUCTION UNLESS SO STATED OR NOTED. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT WORKERS AND OTHER PERSONS DURING CONSTRUCTION.
- 8. THE STRUCTURAL DRAWINGS ARE NOT TO BE SCALED FOR DETERMINATION OF QUANTITIES, LENGTHS OR FIT OF MATERIALS.
- 9. THE GENERAL CONTRACTOR SHALL BE SOLELY AND EXCLUSIVELY RESPONSIBLE FOR THE ADEQUACY OF ALL SHORING AND BRACING. THE CONTRACTOR SHALL PROVIDE TEMPORARY ERECTION SHORING AND BRACING OF ALL STRUCTURAL WORK AS REQUIRED FOR THE STABILITY OF THE STRUCTURE DURING ALL PHASES OF CONSTRUCTION. THE CONTRACTOR SHALL IMMEDIATELY INFORM THE ENGINEER OF ANY CONDITION WHICH, IN HIS OPINION, MIGHT ENDANGER THE STABILITY OF THE STRUCTURE OR CAUSE DISTRESS IN THE STRUCTURE.
- 10. THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS IN THE FIELD PRIOR TO INITIATING FABRICATION.
- 11. DESIGN LOADS: LIVE LOADS:

SNOW LOAD (GROUND) 50 P.S.F. SNOW DRIFT LOADS AS REQUIRED BY IBC SECTION 1603.1.3 & 1608.

DEAD LOADS: ROOF

100 P.S.F.

OTHER DEAD LOADS HAVE BEEN CALCULATED TO INCLUDE THE ACTUAL WEIGHT OF ALL WORK SHOWN ON THE STRUCTURAL DRAWINGS. NO EQUIPMENT SHALL BE PLACED ON OR HUNG FROM THE ROOF SYSTEM WITHOUT WRITTEN APPROVAL OF THE ENGINEER.

- 12. COMPLETE SHOP DRAWINGS FOR THE STRUCTURAL WORK SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO COMMENCEMENT OF CONSTRUCTION. REVIEW OF SHOP DRAWINGS BY THE ENGINEER DOES NOT RELIEVE THE CONTRACTOR OF FULL RESPONSIBILITY FOR CORRECT FABRICATION AND CONSTRUCTION OF THE WORK.
- 13. PRINCIPAL OPENINGS ARE SHOWN ON THE STRUCTURAL DRAWINGS. THE CONTRACTOR SHALL REFER TO ARCHITECTURAL DRAWINGS FOR SLEEVES, CURBS, INSERTS, AND SIMILAR DETAILS NOT SHOWN. SIZE AND LOCATION OF ALL OPENINGS SHALL BE VERIFIED BY THE CONTRACTOR. ANY DEVIATION FROM OPENINGS SHOWN ON THE ARCHITECTURAL DRAWINGS SHALL BE BROUGHT TO THE ENGINEER'S ATTENTION FOR APPROVAL PRIOR TO CONSTRUCTION.
- 14. CONSTRUCTION MATERIALS SHALL NOT BE STORED ON ROOFS IN EXCESS OF THE DESIGN LIVE LOADS UNLESS SPECIFICALLY APPROVED IN WRITING BY THE STRUCTURAL ENGINEER OF RECORD. IMPACT SHALL BE AVOIDED WHEN PLACING MATERIALS ON ROOFS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENFORCE THESE REQUIREMENTS.

#### CONCRETE OR BRICK MASONRY (C.M.U.) NOTES:

1. UNLESS OTHERWISE NOTED OR SHOWN ON PLANS AND SECTIONS, PROVIDE LINTEL ANGLES, ONE FOR EACH FOUR INCHES OF MASONRY WIDTH AS

FOR OPENINGS UP TO 5'-0" L4x3-1/2x5/16 FOR OPENINGS FROM 5'-0" TO 7'-0" L5x3-1/2x5/16 FOR OPENINGS FROM 7'-0" TO 9'-0" L6x3-1/2 $\frac{1}{2}$ 6

- 2. LINTEL ANGLES IN PAIRS SHALL BE PLUG WELDED AT 18" ON CENTER EXCEPT AS OTHERWISE NOTED.
- 3. STEEL LINTEL ANGLES, WHERE EXPOSED TO WEATHER, SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A 153.
- 4. ALL LINTELS SHALL BE A MINIMUM OF 6" LONGER THAN MASONRY OPENING DIMENSIONS AT EACH END IN ORDER TO PROVIDE PROPER BEARING.

#### STRUCTURAL STEEL NOTES:

- 1. ALL STEEL SHALL BE NEW STEEL, CONFORMING TO A.I.S.C. "SPECIFICATIONS FOR DESIGN, FABRICATION & ERECTION OF STRUCTURAL STEEL FOR BUILDINGS", LATEST EDITION, AND A.S.T.M. GRADE 50. ANGLES, PLATES, ETC. TO BE GRADE 36
- 2. STRUCTURAL STEEL TUBING SHALL CONFORM TO A.S.T.M. A 500, GRADE B, WITH A MINIMUM YIELD STRESS OF 46 K.S.I.
- 3. ALL CONNECTIONS SHOWN ARE "TYPE 2" CONNECTIONS AS DEFINED IN THE A.I.S.C. MANUAL OF STEEL CONSTRUCTION, UNLESS NOTED OTHERWISE. NO PERMANENT CONNECTIONS SHOULD BE MADE UP UNTIL THE STRUCTURE HAS BEEN PROPERLY ALIGNED. PROVIDE TEMPORARY BRACING AS REQUIRED.
- 4. ALL CONNECTIONS SHALL BE DESIGNED AS "TYPE 2" CONNECTIONS (UNLESS NOTED OTHERWISE) AND SHALL BE CAPABLE OF SUPPORTING ONE—HALF OF THE MAXIMUM ALLOWABLE UNIFORM LOAD AS INDICATED UNDER PART 2 OF THE MANUAL OF STEEL CONSTRUCTION, LATEST EDITION.
- 5. ALL SHOP AND FIELD WELDS SHOWN SHALL BE MADE BY APPROVED CERTIFIED WELDERS AND SHALL CONFORM TO THE A.W.S. CODE FOR BUILDINGS. ALL WELDS SHALL DEVELOP THE FULL STRENGTH OF THE MATERIAL BEING WELDED. USE E-70XX ELECTRODES.
- 6. ALL STEEL SHALL HAVE ONE COAT OF RUST INHIBITIVE PRIMER PAINT. TOUCH UP ALL WELDS, SCRATCHES, OR SCRAPES AFTER ERECTION.
- 7. WELD ALL STEEL CONTACT SURFACES (OTHER THAN BOLTED CONNECTIONS) WITH A CONTINUOUS 3/16" (MINIMUM) FILLET WELD.
- 8. THE FABRICATOR SHALL DESIGN ALL CONNECTIONS. CONNECTION DESIGNS SHALL COMPLY WITH ALL APPLICABLE PROVISIONS OF THE A.I.S.C. "MANUAL OF STEEL CONSTRUCTION, ALLOWABLE STRESS DESIGN," LATEST EDITION. WHERE DESIGN REACTIONS ARE SHOWN ON DRAWINGS, THESE VALUES SUPERSEDE THE MINIMUM CRITERIA IN THE A.I.S.C. MANUAL.
- 9. REPRODUCTION OF THE CONTRACT DRAWINGS FOR USE IN SHOP DRAWING SUBMITTAL IS PROHIBITED. ALL PLANS, SECTIONS, NOTES, AND DETAILS SHALL BE COORDINATED WITH THE ARCHITECTURAL PLANS AND REDRAWN. REPRODUCED CONTRACT DRAWINGS SUBMITTED WILL NOT BE REVIEWED.
- 10. ALL STRUCTURAL STEEL CONNECTIONS & DETAILS SHALL CONFORM TO THE A.I.S.C. "CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS & BRIDGES."
- 11. UNFINISHED THREADED FASTENERS SHALL CONFORM TO A.S.T.M. A 307 GRADE A BOLTS & NUTS WITH HEXAGONAL HEADS. UNFINISHED THREADED FASTENERS SHALL BE USED ONLY FOR ANCHORAGE TO CONCRETE CONSTRUCTION.
- 12. BOLTED CONNECTIONS OF PRIMARY MEMBERS SHALL CONFORM TO THE REQUIREMENTS OF THE A.I.S.C. "SPECIFICATIONS FOR STRUCTURAL JOINTS USING A.S.T.M. A 325 BOLTS." ALL PRIMARY CONNECTIONS SHALL USE A.S.T.M. A 325 BOLTS AND HEAVY HEX NUTS. ALL BOLTS AND NUTS SHALL BE NEW.
- 13. ALL STEEL BEAMS SHALL BE ERECTED WITH NATURAL CAMBER UP.
- 14. BOLTED CONNECTIONS SHALL BE BEARING TYPE WITH THREADS EXCLUDED FROM SHEAR PLANE UNLESS NOTED OTHERWISE.
- 15. THE USE OF OVERSIZED, SHORT-SLOTTED, OR LONG SLOTTED HOLES IN LIEU OF STANDARD HOLES REQUIRES THE APPROVAL OF THE ENGINEER-OF-RECORD.
- 16. THE USE OF THERMAL CUTTING IN THE PRODUCTION OR ALTERATION OF BOLT HOLES REQUIRES THE APPROVAL OF THE ENGINEER—OF—RECORD.

#### NOTICE

This document, the property of, prepared and issued by the architect, is submitted for the specific project namely \_\_\_\_\_\_ and the recipient by accepting this document assumes custody and agrees that this document will not be copied or reproduced in part or in whole, and any special features peculiar to this design shall not be incorporated in any other project, unless prior agreement has been obtained in writing. These documents will be returned immediately upon completion of the project or upon the request of the

This document is the exclusive property of the architect, no rights to ownership are transferable, or shall be lost by the filing of this document with any and all public authorities for the purpose of compliance with Codes and or Ordinances, i.e. Building Permit, etc.



Bryant & Stratton
110 Broadway
Buffalo, NY

SA PROJECT TEAM: PRINCIPAL P.Silvestri

PROJ. ARCH. <u>S.Hunt</u> DRAFTER

JOB CAPT. \_\_\_\_\_ INTERIORS <u>N.Catuzza</u>

SEAL:

TITLE:

FOLDING PARTITION FRAMING PLAN



ARCHITECTS PC

1321 MILLERSPORT HWY PH. 716.691.0900

AMHERST, NY 14221 FAX 716.691.4773

SA JOB #: 19099.02

DRAWING #:

4-6-2020

S-101

SECTION 1 SCALE: 1/2"= 1'-0" -

BEAM PER PLAN

THREADED

RODS PER
PARTITION
SUPPLIER

PROVIDE 4-1"Ø HILTI HIT-RE
500 EPOXY ANCHORS WITH 9"
EMBEDMENT INTO CONCRETE.

L3x3x1/4 x8" LONG. INSTALL
AFTER BEAM IS IN PLACE

EXIST. CONC. COLUMN

BEAM PER PLAN
2-3/4"Ø A325 BOLTS

3/16" 6"

LONG x 8" WIDE WITH
1-3/8" THICK STIFF PLATE IN
LINE WITH BEAM WEB.


14"x22"x¾" STEEL PLATE

7

PLATE DETAIL

1

SCALE: 1"= 1'-0"
NOTE: ROLL PLATES AS REQUIRED TO SUIT ROUND
CONCRETE COLUMNS. VERIFY RADIUS OF COLUMNS ON SITE.

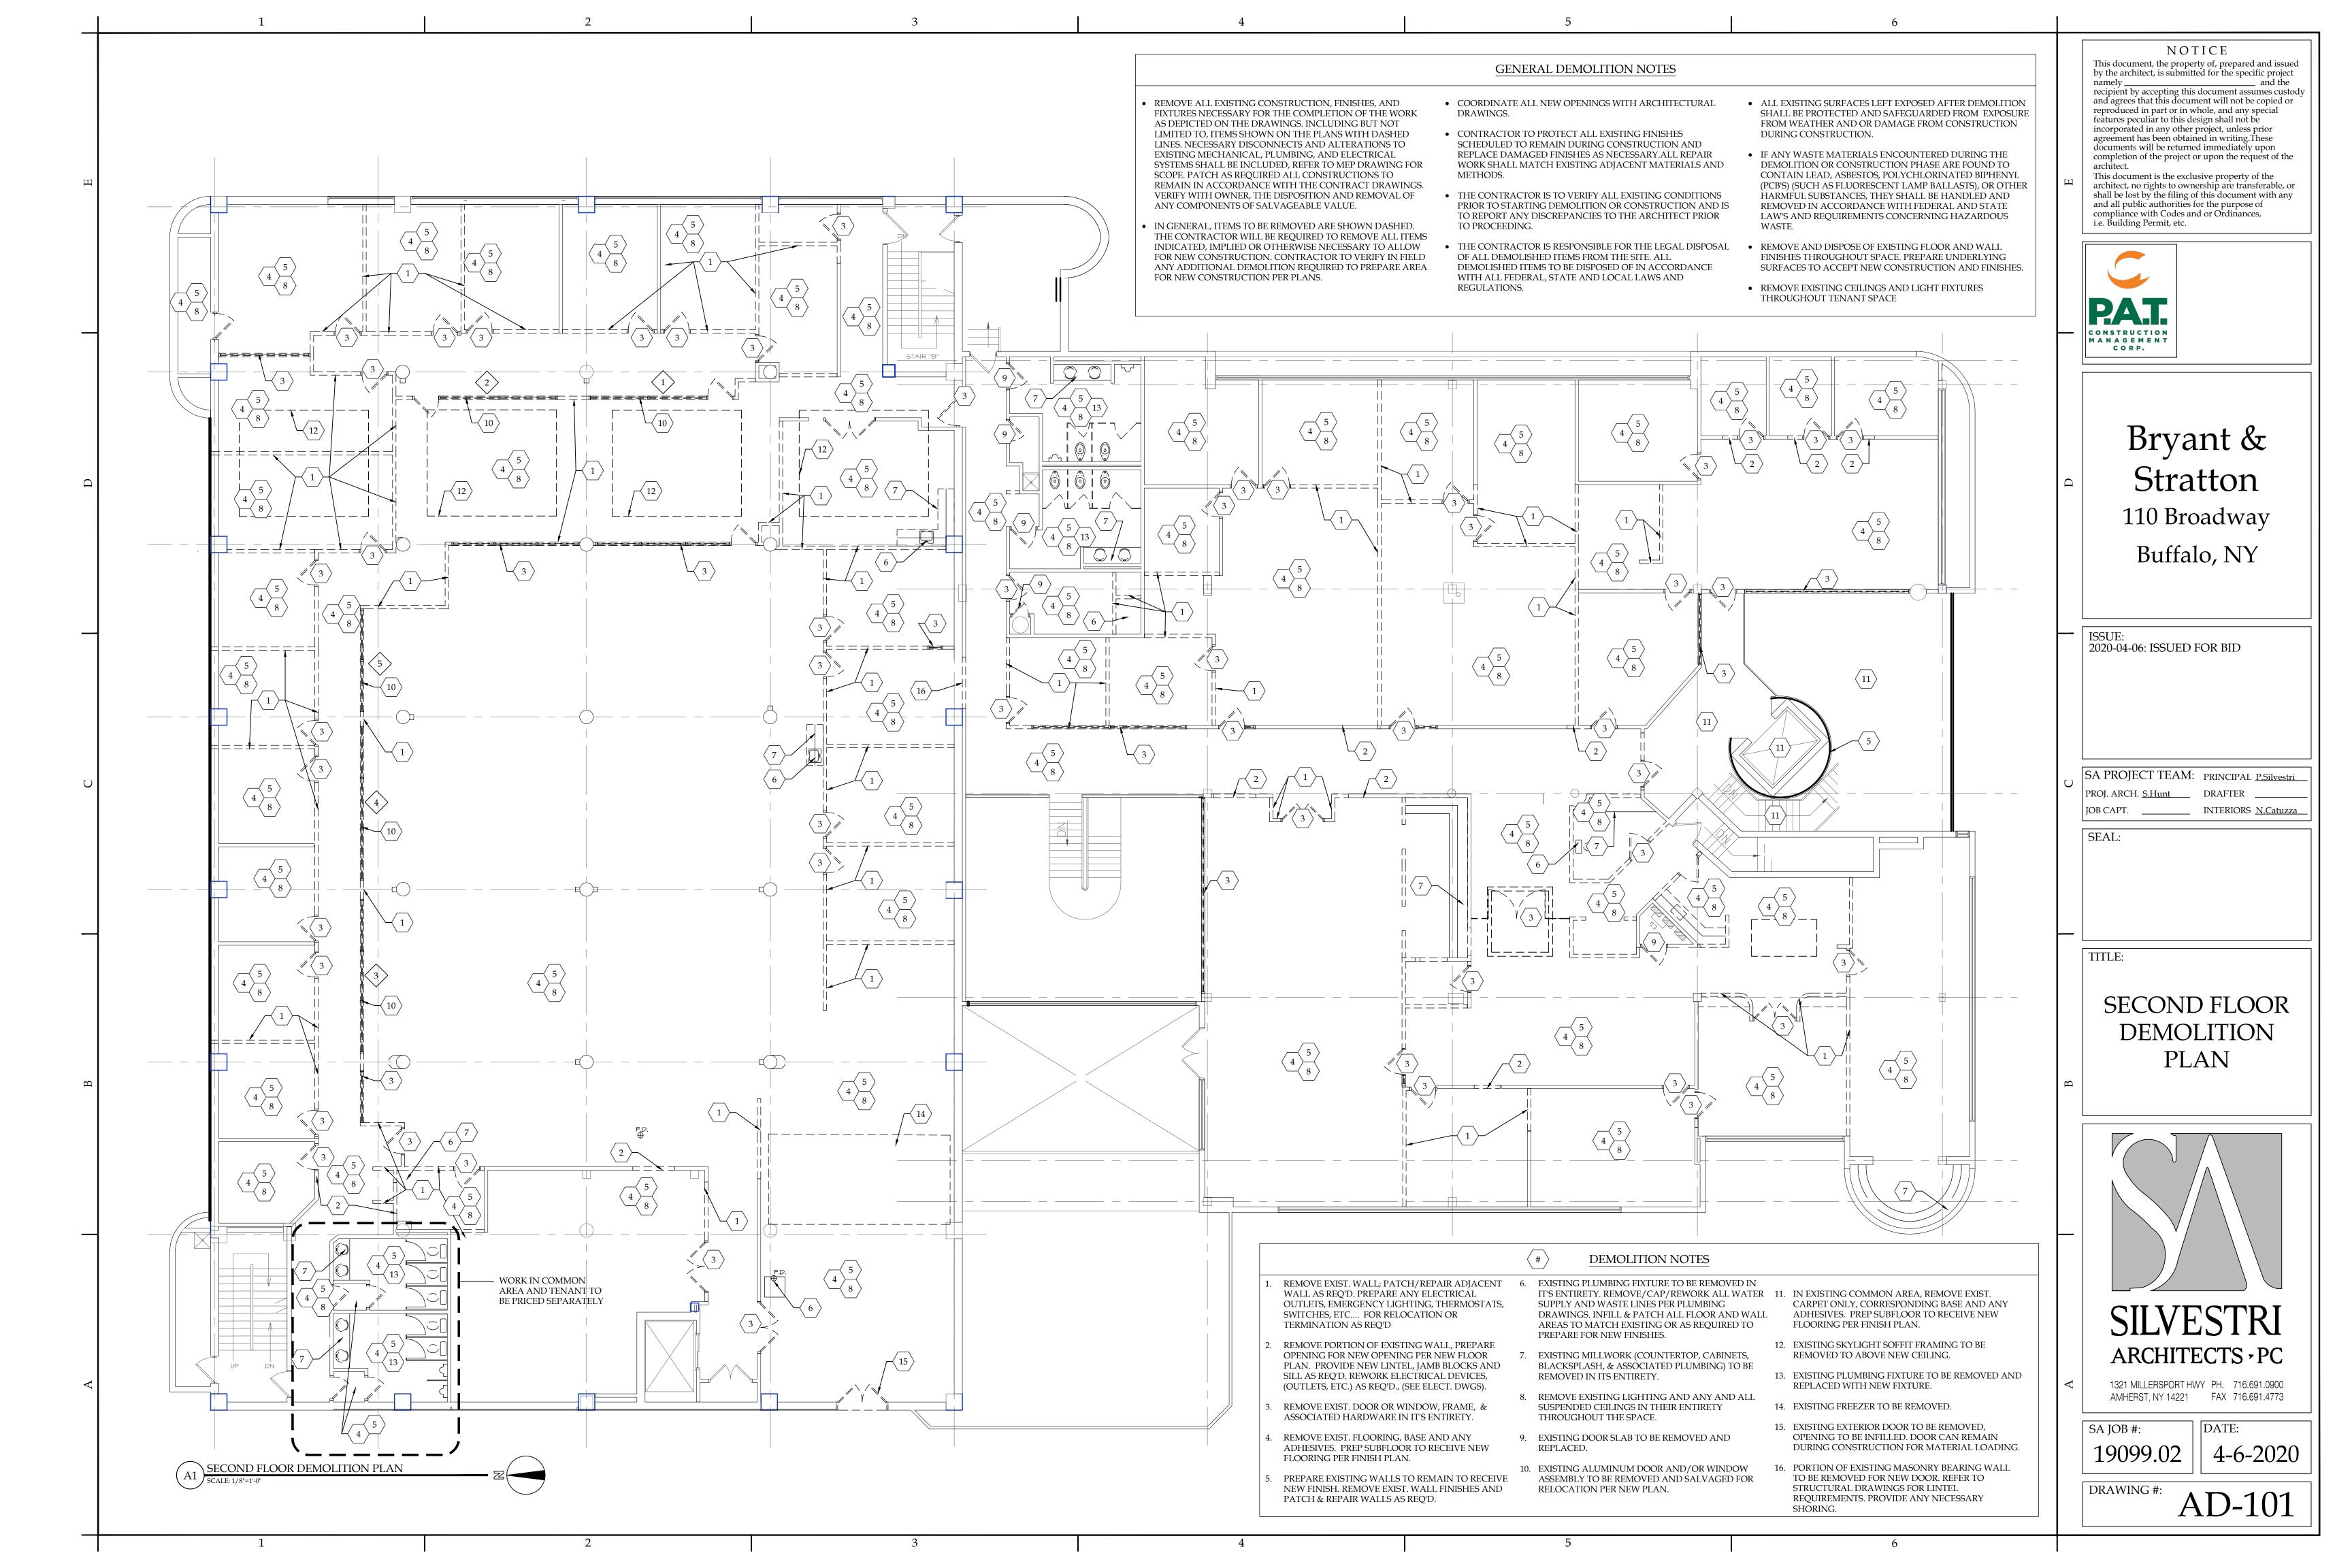

### GENERAL NOTES

- 1. DO NOT SCALE DRAWINGS. ALL DIMENSIONS SHALL HAVE PRECEDENCE OVER SCALE.
- 2. CONSTRUCTION SHALL CONFORM TO ALL APPLICABLE NEW YORK STATE BUILDING CODES, OSHA STANDARDS AND FIRE SAFETY CODE, RELEVANT SECTIONS OF THE N.F.P.A. & ANY LOCAL CODES BEING MORE RESTRICTIVE THAN THE MINIMUMS LISTED.
- 3. CONSTRUCTION MEANS, METHODS, TECHNIQUES AND CRAFTSMANSHIP ARE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR. G.C. SHALL VERIFY ALL DIMENSIONS AND CONDITIONS IN THE FIELD. CONTACT ARCHITECT IF MAJOR DISCREPANCIES OCCUR BETWEEN DRAWINGS AND EXISTING CONDITIONS.
- 4. THE CONTRACTOR IS REQUIRED TO INSPECT THE PROJECT SITE IN ORDER TO DETERMINE THE EXTENT OF THE REQUIRED WORK. THIS INSPECTION SHALL BE COMPLETED PRIOR TO THE SUBMISSION OF ANY PROPOSAL TO COMPLETE THIS PROJECT. INSPECTION TIMES SHALL BE COORDINATED WITH THE OWNER.
- 5. THE CONTRACTOR IS RESPONSIBLE FOR COMPLIANCE WITH ALL INFORMATION ON THE DRAWINGS.
- 6. ALL DIMENSIONS SHOWN FOR EXISTING STRUCTURES ARE BASED ON RECORD DRAWINGS. THE CONTRACTOR IS ADVISED THAT SAID DRAWINGS MAY NOT ACCURATELY REFLECT AS BUILT CONDITIONS. ACCURATE FIELD MEASUREMENTS SHOULD BE MADE PRIOR TO ORDERING ANY PREFABRICATED MATERIALS. DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT AND SHALL BE REFLECTED ON THE CONTRACTORS SHOP DRAWINGS.
- 7. THE DRAWINGS. SPECIFICATIONS AND OTHER DOCUMENTS FOR THIS PROJECT WILL BE COMPLETED TO THE SCOPE OF THE PROJECT IN COMPLIANCE WITH THE OWNER AND DESIGN TEAM. ANY CHANGES TO THESE DRAWINGS, SPECIFICATIONS AND OTHER DOCUMENTS WILL ONLY BE DONE BY A CHANGE ORDER THAT IS APPROVED BY THE OWNER'S REPRESENTATIVE.
- 8. CONSIDERATION WILL NOT BE GRANTED FOR ANY ALLEGED MISUNDERSTANDINGS AS TO THE AMOUNT AND / OR SCOPE OF WORK TO BE PERFORMED. TENDER OF PROPOSAL SHALL CONVEY FULL AGREEMENT TO THE ITEMS, AND CONDITIONS INDICATED IN THE CONSTRUCTION DOCUMENTS. SHOULD THE CONTRACTOR FIND DISCREPANCIES OR OMISSIONS IN THE CONSTRUCTION DOCUMENTS OR BE IN DOUBT AS TO THE INTENT THEREOF, THE CONTRACTOR SHALL IMMEDIATELY OBTAIN CLARIFICATION FROM THE ARCHITECT PRIOR TO SUBMITTING A PROPOSAL FOR THE WORK.
- 9. ALL OWNER SUPPLIED ITEMS WILL BE COORDINATED WITHIN THE GENERAL CONTRACTOR'S CONSTRUCTION SCHEDULES PRIOR TO COMMENCEMENT OF ANY WORK.
- 10. THE CONTRACTOR SHALL COORDINATE HIS WORK AND SCHEDULE WITH THE OWNER FOR ALL BUILDING AND CONSTRUCTION SIGNAGE.
- 11. THE CONTRACTOR IS RESPONSIBLE FOR THE COORDINATION OF HIS WORK AND SCHEDULE WITH WORK BEING PERFORMED BY OTHERS AND THE USER/OWNER OF THE BUILDING.
- 12. THE STRUCTURAL, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS ARE SUPPLEMENTARY TO THE ARCHITECTURAL DRAWINGS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO CHECK WITH THE ARCHITECTURAL DRAWINGS BEFORE THE INSTALLATION OF STRUCTURAL, MECHANICAL, ELECTRICAL AND PLUMBING WORK. ANY DISCREPANCIES BETWEEN THE ARCHITECT'S AND ENGINEER'S DRAWINGS AND SPECIFICATIONS SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION FOR CLARIFICATION PRIOR TO PROCEEDING WITH SAID WORK.

- 13. DETAILS MARKED "TYPICAL" SHALL APPLY IN ALL CASES UNLESS SPECIFICALLY INDICATED OTHERWISE.
- 14. ALL SYMBOLS AND ABBREVIATIONS USED ON THE DRAWINGS ARE CONSIDERED TO BE CONSTRUCTION STANDARDS. IF THE CONTRACTOR HAS QUESTIONS REGARDING SOME, OR THEIR EXACT MEANING, THE ARCHITECT SHALL BE NOTIFIED FOR CLARIFICATION.
- 15. CONTRACTOR SHALL VERIFY AND ESTABLISH THE LOCATIONS AND ELEVATIONS OF ALL UTILITIES WITHIN THE WORK AREA, AND SHALL COORDINATE WITH THE OWNER AND THE UTILITY COMPANIES PRIOR TO THE START OF THE PROJECT.
- 16. THE CONTRACTOR SHALL PROVIDE ALL SHORING AND BRACING REQUIRED TO ADEQUATELY PROTECT PERSONAL AND ADJACENT PROPERTY AND TO INSURE SAFETY OF THE STRUCTURE THROUGHOUT THE CONSTRUCTION PERIOD.
- 17. ALL CEILING HEIGHTS AS SHOWN ON DETAILS OR PLANS OR NOTES ARE FROM TOP OF CONCRETE DECK TO FINISH CEILING. USE OF THE TERM ABOVE FINISH FLOOR (A.F.F.) MEANS MEASURED FROM THE TOP OF CONCRETE DECK. CONTRACTOR SHALL ALLOW FOR AND COORDINATE WORK WITH FLOOR FINISH MATERIAL AND INSTALLATION METHOD.
- 18. PROVIDE INDEPENDENT SUSPENSION FOR ALL LIGHT FIXTURES. SUSPENSION FOR CEILING AND LIGHT FIXTURES SHALL BE INDEPENDENT OF SUSPENSION FOR DUCT WORK.
- 19. ALL EQUIPMENT AND MATERIALS INSTALLED IN THIS JOB SHALL BE NEW AND FREE OF ANY DEFECTS UNLESS OTHERWISE NOTED.
- 20. CONTRACTORS SHALL RECORD ALL DEVIATIONS FROM THE DESIGN DOCUMENTS IN THE DRAWINGS, AND PROVIDE A COPY TO THE ARCHITECT UPON THE COMPLETION OF WORK.
- 21. PROVIDE APPROVED SEPARATION BY MEANS OF COATINGS, GASKETS, OR OTHER EFFECTIVE MEANS TO PREVENT GALVANIC CORROSION BETWEEN ALL DISSIMILAR METALS.
- 22. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING ANY DAMAGE CAUSED BY THE CONSTRUCTION OPERATIONS OF THIS PROJECT TO ADJACENT PROPERTY, UTILITIES, PAVEMENT, LANDSCAPING, STRUCTURES OR IMPROVEMENTS OF ANY KIND. THE GENERAL CONTRACTOR SHALL REPAIR ALL SUCH DAMAGE D ITEMS TO THE CONDITION THEY WERE IN PRIOR TO COMMENCEMENT OF CONSTRUCTION ACTIVITIES OR BETTER.
- 23. WHERE IT IS NECESSARY TO INSURE STABILITY, CONTRACTOR IS TO PROVIDE ADDITIONAL ANCHORING AND/OR BLOCKING IN STUD PARTITIONS OR BRACE PARTITIONS ABOVE CEILINGS.
- 24. CONTRACTOR TO COORDINATE LOCATIONS OF FLOOR DRAINS WITH PLUMBING CONTRACTOR.
- 25. AUTOMATIC SPRINKLER PROTECTION IS REQUIRED. AUTOMATIC SPRINKLER TO BE CONFIGURED AS REQUIRED FOR NEW CONSTRUCTION. CONTRACTOR TO PROVIDE LAYOUT AND THE MINIMUM REQUIREMENTS FOR THE DESIGN AND INSTALLATION OF AUTOMATIC FIRE SPRINKLER SYSTEM AND EXPOSURE PROTECTION SPRINKLER SYSTEMS, INCLUDING THE CHARACTER AND ADEQUACY OF WATER SUPPLIES AND THE SELECTION OF SPRINKLERS, PIPING, VALVES AND ALL OTHER MATERIALS AND ACCESSORIES IN ACCORDANCE WITH NFPA 13 AND LOCAL BUILDING CODES.
- 26. ROOM IDENTIFICATION LABELING AND INTERIOR SIGNAGE TO BE COORDINATED WITH TENANT, SIGNAGE SHALL COMPLY WITH ADA REQUIREMENTS.

- 27. CONTRACTOR SHALL PROVIDE AND INSTALL FIRE EXTINGUISHERS PER CODE, INCLUDING NFPA 10, AND AS DIRECTED BY THE LOCAL FIRE DEPARTMENT THROUGHOUT BUILDING. FIRE EXTINGUISHER CABINETS SHALL NOT PROJECT MORE THAN 4" BEYOND THE FACE OF THE WALL RECESSED FIRE EXTINGUISHER CABINETS IN FIRE RATED WALLS SHALL HAVE THE SAME FIRE RATING AS THE WALL.
- 28. ALL INTERIOR DIMENSIONS ARE TAKEN FROM FACE OF FINISHED
- 29. BEFORE SUBMITTING BID, EXAMINE ALL DRAWINGS RELATED TO THE WORK, BECOME FULLY INFORMED AS TO THE EXTENT AND CHARACTER OF THE WORK OF ALL TRADES AND ITS RELATION TO THE WORK UNDER THE CONTRACT. NO CONSIDERATIONS WILL BE GIVEN FOR ALLEGED MISUNDERSTANDING OF THE MATERIALS TO BE FURNISHED OR THE WORK TO BE DONE.
- 30. CONTRACTOR SHALL REVIEW AND SUBMIT SHOP DRAWINGS SUFFICIENTLY IN ADVANCE OF THE WORK TO ALLOW PROPER TIME FOR REVIEW. MATERIALS SHALL NOT BE FABRICATED OR DELIVERED TO THE SITE BEFORE THE SHOP DRAWINGS HAVE BEEN REVIEWED AND APPROVED BY THE OWNER'S REPRESENTATIVE.
- 31. ALL SUBSTITUTE MANUFACTURERS, EQUIPMENT, MATERIALS AND PRODUCTS SHALL BE APPROVED BY THE OWNERS REPRESENTATIVE. THE CONTRACTORS IS RESPONSIBLE FOR ALL ASSOCIATED COSTS TO ANY AND ALL BUILDING COMPONENTS THAT ARE AFFECTED BY THE SUBSTITUTIONS. ADDITIONAL COSTS INCLUDE ANY REDESIGN THAT IS REQUIRED DUE TO THE SUBSTITUTION.
- 32. DO NOT SCALE DRAWINGS, THE DIMENSIONS SHOWN ON THE PLANS MAY VARY FROM THE ACTUAL DIMENSIONS IN THE FIELD. IT IS, THEREFORE, IMPERATIVE THAT THE CONTRACTOR, PRIOR TO COMMENCEMENT OF WORK, TAKE EXACT MEASUREMENTS TO VERIFY ALL DIMENSIONS SHOWN ON THE PLANS AND SHOP DRAWINGS. ALL WORKING DRAWINGS PREPARED BY THE CONTRACTOR SHALL INCLUDE A STATEMENT CERTIFYING THAT THOSE DRAWINGS HAVE BEEN PREPARED IN ACCORDANCE WITH THE FIELD MEASURED DIMENSIONS.
- 33. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF ANY AND ALL DISCREPANCIES BETWEEN FIELD CONDITIONS AND THE CONTRACT DOCUMENTS BEFORE PROCEEDING WITH THAT PORTION OF THE WORK. FAILURE TO NOTIFY THE ARCHITECT WILL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY TO COMPLY WITH THE DOCUMENTS. THE CONTRACTOR SHALL CORRECT ANY AND ALL WORK ARISING FROM SUCH FAILURE AND COORDINATE DISCREPANCIES TO THE SATISFACTION OF THE ARCHITECT WITHOUT ADDITIONAL COST TO THE OWNER. RECOMMENDED BY MANUFACTURER.
- 34. THE LOCATION FOR ALL ITEMS WHEN ON THE DRAWINGS OR CALLED FOR IN THE SPECIFICATIONS THAT ARE NOT DEFINITELY FIXED BY DIMENSIONS ARE DIAGRAMMATIC. THE EXACT LOCATIONS NECESSARY TO SECURE THE BEST CONDITIONS AND RESULTS MUST BE DETERMINED AT THE PROJECT AND SHALL HAVE THE APPROVAL OF THE OWNER'S REPRESENTATIVE BEFORE BEING INSTALLED. DO NOT SCALE DRAWINGS. THE CONTRACTOR SHALL FURNISH AND INSTALL, WITHOUT ADDITIONAL REMUNERATION, ANY COMPONENT NECESSARY TO COMPLETE THE SYSTEMS IN ACCORDANCE WITH THE BEST PRACTICE OF THE TRADE.
- 35. DATA, COMMUNICATION, CABLE, AND SECURITY SYSTEMS ARE PROVIDED BY THE OWNER'S VENDORS. HOWEVER THE ELECTRICAL CONTRACTOR SHALL PROVIDE APPROPRIATE WALL BOXES, CONDUIT WITH PULL STRINGS, ETC. AS REQUIRED FOR ROUGH-IN CONDITIONS. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR COORDINATING THE LOCATION OF THESE ITEMS WITH THE OWNER'S VENDORS. ADAAG COMPLIANCE SHALL APPLY.

- 36. MECHANICAL, ELECTRICAL, AND PLUMBING, ARE SCHEMATIC IN NATURE. THEREFORE, IT IS THE GENERAL CONTRACTOR'S RESPONSIBILITY TO COORDINATE THE ROUTING OF THESE TRADES, AS WELL AS, THE OWNER'S WORK TO ASSURE THAT THESE SYSTEMS DO NOT CONFLICT WITH THE ARCHITECTURAL AND STRUCTURAL ELEMENTS OF THE BUILDING. IF THE GENERAL CONTRACTOR ROUTE THESE ITEMS TO AVOID A CONFLICT, THEN THEY SHALL NOTIFY THE ARCHITECT PRIOR TO STARTING ANY RELATED WORK.
- 37. CONTRACTOR TO PROTECT ALL NEW WORK DURING CONSTRUCTION AND REPLACE DAMAGED MATERIAL IN KIND.
- 38. ALL GYPSUM WALL BOARD TO BE TAPED AND SANDED AT

INTERSECTION OF CONSTRUCTION (NO. "J" MOLD)

- 39. PROVIDE CORNER BEAD AT ALL EXPOSED GYPSUM WALL BOARD
- 40. CONTRACTOR SHALL PROVIDE ALL MATERIALS, FABRICATION, LABOR AND SUPERVISION, ERECTION EQUIPMENT AND APPLIANCES REQUIRED TO INSTALL ALL EQUIPMENT SHOWN ON DRAWINGS AS INDICATED IN THE SPECIFICATIONS.
- 41. THE TERM "PROVIDE" SHALL MEAN "FURNISH AND INSTALL, INCLUDING ALL LABOR, EQUIPMENT, MATERIALS AND PRODUCTS," UNLESS OTHERWISE NOTED.
- MAINTAINING AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE PERFORMANCE OF THE CONTRACT. 43. SAVE WORKING CONDITIONS ARE ALL SAFETY REQUIREMENTS

42. THE CONTRACTOR SHALL BE RESPONSIBLE FOR INITIATING,

- ESTABLISHED BY JURISDICTIONAL AGENCIES AND/OR THE OWNER SHALL BE OBSERVED. WHERE CONFLICTS EXIST, THE MORE STRINGENT REQUIREMENTS SHALL APPLY. CARE MUST BE EXERCISED TO AVOID ENDANGERING PERSONNEL OR THE STRUCTURE.
- 44. CONTRACTOR SHALL REMOVE ALL PROPERLY DISPOSE OF ALL DEBRIS FROM SITE AND LEAVE THE WORK AREA BROOM CLEAN ON A DAILY BASIS AND PROVIDE DUMPSTER SERVICE. PLACE DUMPSTERS AS DIRECTED BY THE "OWNER'S REPRESENTATIVE"
- 45. CONTRACTOR SHALL FURNISH ALL SCAFFOLDING, HOISTING EQUIPMENT AND ANY OTHER EQUIPMENT THAT MAY BE REQUIRED TO PERFORM THE WORK INDICATED IN A SAFE AND ORDERLY
- 46. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO INSURE AGAINST DAMAGE TO EXISTING WORK TO REMAIN IN PLACE. ANY DAMAGE TO SUCH WORK SHALL BE REPAIRED OR REPLACED TO THE SATISFACTION OF THE OWNER AT NO ADDITIONAL COST.

47. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SECURING AND

THE MANUFACTURERS LATEST WRITTEN INSTRUCTIONS AND

- PAYING FOR ALL PERMITS AND APPROVALS NECESSARY FOR THE COMPLETION OF THE PROJECT. 48. ALL NEW MATERIALS SHALL BE INSTALLED IN ACCORDANCE WITH
- 49. ALL FASTENERS INTO PRESSURE TREATED LUMBER ARE TO BE HOT DIPPED GALVANIZED OR STAINLESS STEEL AS RECOMMENDED BY

SPECIFICATIONS.

MANUFACTURER.

- - recipient by accepting this document assumes custody and agrees that this document will not be copied or reproduced in part or in whole, and any special features peculiar to this design shall not be incorporated in any other project, unless prior agreement has been obtained in writing. These documents will be returned immediately upon completion of the project or upon the request of the

NOTICE This document, the property of, prepared and issued

by the architect, is submitted for the specific project

This document is the exclusive property of the architect, no rights to ownership are transferable, or shall be lost by the filing of this document with any and all public authorities for the purpose of compliance with Codes and or Ordinances, i.e. Building Permit, etc.



namely

Bryant & Stratton 110 Broadway Buffalo, NY

2020-04-06: ISSUED FOR BID

SA PROJECT TEAM: PRINCIPAL P.Silvestri

INTERIORS <u>N.Catuzza</u>

PROJ. ARCH. <u>S.Hunt</u> DRAFTER

JOB CAPT.

TITLE:

GENERAL NOTES



SA JOB #: 19099.02

DATE: 4-6-2020

A-001

#### 302 FLOOR SURFACES

302.1 General. Floor surfaces shall be stable, firm, and slip resistant, and shall comply with Section 302. Changes in level in floor surfaces shall comply with

302.2 Carpet. Carpet or carpet tile shall be securely attached and shall have a firm cushion, pad, or backing or no cushion or pad. Carpet or carpet tile shall have a level loop, textured loop, level cut pile, or level cut/uncut pile texture. The pile shall be 1/2 inch maximum in height. Exposed edges of carpet shall be fastened to the floor and shall have trim along the entire length of the exposed edge. Carpet edge trim shall comply with Section 303.





FIG. 303.2 CARPET ON FLOOR SURFACES

302.3 Openings. Openings in floor surfaces shall be of a size that does not permit the assage of a ½ inch diameter sphere, except as allowed in Sections 407.4.3, 408.4.3, 409.4.3, 410.4, and 805.10. Elongated openings shall be placed so that the long dimension is perpendicular to the predominant direction of travel.

#### 303 CHANGES IN LEVEL

303.1 General. Changes in level in floor surfaces shall comply with Section 303. 303.2 Vertical. Changes in level of 1/4 inch maximum in height shall be permitted

303.3 Beveled. Changes in level greater than 1/4 inch in height and not more than 1/2 inch maximum in height shall be beveled with a slope not steeper than 1:2.



303.4 Ramps. Changes in level greater than 1/2 inch in height shall be ramped and shall comply with Section 405 or 406.

#### 304 TURNING SPACE

304.1 General. A turning space shall comply with Section 304. 304.2 Floor Surface. Floor surfaces of a turning space shall comply with Section 302. Changes in level are not permitted within the turning space. EXCEPTION: Slopes not steeper than 1:48 shall be permitted.

 $304.3 \ \mathrm{Size}.$  Turning spaces shall comply with Section  $304.3.1 \ \mathrm{or}\ 304.3.2.$ 304.3.1 Circular Space. The turning space shall be a circular space with a 60-inch minimum diameter. The turning space shall be permitted to include knee and toe clearance complying with Section 306.

304.3.2 T-Shaped Space. The turning space shall be a T-shaped space within a

60-inch minimum square, with arms and base 36 inches minimum in width. Each arm of the T shall be clear of obstructions 12 inches minimum in each direction, and the base shall be clear of obstructions 24 inches minimum. The turning space shall be permitted to include knee and toe clearance complying with Section 306 only at the end of either the base or one arm. 304.4 Door Swing. Unless otherwise specified, doors shall be permitted to swing

#### 305 CLEAR FLOOR SPACE

into turning spaces.

305.1 General. A clear floor space shall comply with Section 305. 305.2 Floor Surfaces. Floor surfaces of a clear floor space shall comply with Section

302. Changes in level are not permitted within the clear floor space EXCEPTION: Slopes not steeper than 1:48 shall be permitted. 305.3 Size. The clear floor space shall be 48 inches minimum in length and 30 inches

305.4 Knee and Toe Clearance. Unless otherwise specified, clear floor space shall be permitted to include knee and toe clearance complying with Section 306. 305.5 Position. Unless otherwise specified, the clear floor space shall be positioned for either forward or parallel approach to an element

305.6 Approach. One full, unobstructed side of the clear floor space shall adjoin or overlap an accessible route or adjoin another clear floor space. 305.7 Alcoves. If a clear floor space is in an alcove or otherwise confined on all or part of three sides, additional maneuvering clearances complying with Sections 305.7.1 and 305.7.2 shall be provided, as applicable.

305.7.1 Parallel Approach. Where the clear floor space is positioned for a parallel approach, the alcove shall be 60 inches minimum in width where the depth exceeds 305.7.2 Forward Approach. Where the clear floor space is positioned for a forward

### approach, the alcove shall be 36 inches minimum in width where the depth exceeds

#### 306 KNEE AND TOE CLEARANCE

306.1 General. Where space beneath an element is included as part of clear floor pace at an element, clearance at an element, or a turning space, the space shall comply with Section 306. Additional space shall not be prohibited beneath an element, but shall not be considered as part of the clear floor space or turning space. 306.2 Toe Clearance.

306.2.1 General. Space beneath an element between the floor and 9 inches above the floor shall be considered toe clearance and shall comply with Section 306.2. 306.2.2 Maximum Depth. Toe clearance shall be permitted to extend 25 inches maximum under an element

306.2.3 Minimum Depth. Where toe clearance is required at an element as part of a clear floor space complying with Section 305, the toe clearance shall extend 17 inches minimum beneath the element.

306.2.4 Additional Clearance. Space extending greater than 6 inches beyond the available knee clearance at 9 inches above the floor shall not be considered toe

#### 306.2.5 Width. Toe clearance shall be 30 inches minimum in width. 306.3 Knee Clearance

306.3.1 General. Space beneath an element between 9 inches and 27 inches above the floor shall be considered knee clearance and shall comply with Section 306.3. 306.3.2 Maximum Depth. Knee clearance shall be permitted to extend 25 inches maximum under an element at 9 inches above the floor.

306.3.3 Minimum Depth. Where knee clearance is required beneath an element as part of a clear floor space complying with Section 305, the knee clearance shall be 11 inches minimum in depth at 9 inches above the floor, and 8 inches minimum in depth at 27 inches above the floor. 306.3.4 Clearance Reduction. Between 9 inches and 27 inches above the floor, the

knee clearance shall be permitted to be reduced at a rate of 1 inch in depth for each 306.3.5 Width. Knee clearance shall be 30 inches minimum in width.

#### 307 PROTRUDING OBJECTS

307.1 General. Protruding objects on circulation paths shall comply with Section 307.2 Protrusion Limits. Objects with leading edges more than 27 inches and not more than 80 inches above the floor shall protrude 4 inches maximum hor

EXCEPTION: Handrails shall be permitted to protrude 4 ½ inches maximum.

FIG. 307.2 LIMITS OF PROTRUDING OBJECTS

required for accessible routes.

307.3 Post-Mounted Objects, Objects on posts or pylons shall be permitted to overhang 4 inches maximum where more than 27 inches and not more than 80 inches above the floor. Objects on multiple posts or pylons where the clear distance between the posts or pylons is greater than 12 inches shall have the lowest edge of such object either 27 inches maximum or 80 inches minimum above the floor. EXCEPTION: Sloping portions of handrails between the top and bottom riser of stairs and above the ramp run shall not be required to comply with Section 307.3. 307.4 Vertical Clearance. Vertical clearance shall be 80 inches minimum. Rails or other barriers shall be provided where the vertical clearance is less than 80 inches. The leading edge of such rails or barrier shall be located 27 inches maximum above

EXCEPTION: Door closers and door stops shall be permitted to be 78 inches minimum above the floor. 307.5 Required Clear Width. Protruding objects shall not reduce the clear width 308.1 General. Reach ranges shall comply with Section 308.

308.2 Forward Reach. 308.2.1 Unobstructed. Where a forward reach is unobstructed, the high forward

308.2.2 Obstructed High Reach. Where a high forward reach is over an obstruction, the clear floor space complying with Section 305 shall extend beneath the element for a distance not less than the required reach depth over the obstruction. The high 20 inches maximum. Where the reach depth exceeds 20 inches, the high forward reach shall be 44 inches maximum above the floor, and the reach depth shall be 25 308.3 Side Reach.

a parallel approach to an element and the edge of the clear floor space is 10 inches maximum from the element, the high side reach shall be 48 inches maximum and the low side reach shall be 15 inches minimum above the floor.

inches maximum above the floor. 308.3.2 Obstructed High Reach. Where a clear floor space complying with Section 305 allows a parallel approach to an element and the high side reach is over an obstruction, the height of the obstruction shall be 34 inches maximum above the floor and the depth of the obstruction shall be 24 inches maximum. The high side reach shall be 48 inches maximum above the floor for a reach depth of 10 inches maximum. Where the reach depth exceeds 10 inches, the high side reach shall be 46 nches maximum above the floor for a reach depth of 24 inches maximum EXCEPTION: At washing machines and clothes dryers, the height of the obstruction

#### 309 OPERABLE PARTS

309.1 General. Operable parts required to be accessible shall comply with Section 309.2 Clear Floor Space. A clear floor space complying with Section 305 shall be

401.1 Scope. Accessible routes required by the scoping provisions adopted by the

402.2 Components. Accessible routes shall consist of one or more of the following components: Walking surfaces with a slope not steeper than 1:20, doors and doorways, ramps, curb ramps excluding the flared sides, elevators, and platform lifts. All components of an accessible route shall comply with the applicable portions of this standard.

402.3 Revolving Doors, Revolving Gates, and Turnstiles. Revolving doors, revolving gates, and turnstiles shall not be part of an accessible route.

with Section 403. 403.2 Floor Surface. Floor surfaces shall comply with Section 302.

The cross slope of a walking surface shall not be steeper than 1:48. 403.4 Changes in Level. Changes in level shall comply with Section 303. 403.5 Clear Width. The clear width of an accessible route shall be 36 inches

EXCEPTION: The clear width shall be permitted to be reduced to 32 inches minimum for a length of 24 inches maximum provided the reduced width segments are separated by segments that are 48 inches minimum in length and 36 inches minimum in width. 403.5.1 Clear Width at 180 Degree Turn. Where an accessible route makes a 180 degree turn around an object that is less than 48 inches in width, clear widths shall

be 42 inches minimum approaching the turn, 48 inches minimum during the turn, and 42 inches minimum leaving the turn. EXCEPTION: Section 403.5.1 shall not apply where the clear width during the turn is 60 inches minimum. 403.5.2 Passing Space. An accessible route with a clear width less than 60 inches shall provide passing spaces at intervals of 200 feet maximum. Passing spaces shall be either a 60-inch minimum by 60-inch minimum space, or an intersection of two

walking surfaces that provide a T-shaped turning space complying with Section


nimum beyond the intersection. 403.6 Handrails. Where handrails are required at the side of a corridor they shall comply with Sections 505.4 through 505.9.

#### 404 DOORS AND DOORWAYS

EXCEPTION: Doors, doorways, and gates designed to be operated only by security personnel shall not be required to comply with Sections 404.2.6, 404.2.7, 404.2.1 Double-Leaf Doors and Gates. At least one of the active leaves of doorways

with two leaves shall comply with Sections 404.2.2 and 404.2.3. 404.2.2 Clear Width. Doorways shall have a clear opening width of 32 inches minimum. Clear opening width of doorways with swinging doors shall be measured between the face of door and stop, with the door open 90 degrees. Openings more than 24 inches in depth at doors and doorways without doors shall provide a clear opening width of 36 inches minimum. There shall be no projections into the clear opening width lower than 34 inches above the floor. Projections into the clear opening width between 34 inches and 80 inches above the floor shall not exceed 4 inches.

1. Door closers and door stops shall be permitted to be 78 inches minimum above 2. In alterations, a projection of  $\frac{5}{8}$  inch maximum into the required clear opening

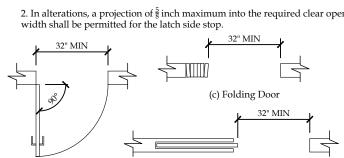


(a) Hinged Door 404.2.3 Maneuvering Clearances. Min

404.2.3.1 Floor Surface. Floor surface within the maneuvering clearances shall have a slope not steeper than 1:48 and shall comply with Section 302. 404.2.3.2 Swinging Doors. Swinging doors shall have maneuvering clearances complying with Table 404.2.3.2.

TABLE 404.2.3.2-MANEUVERING CLEARANCES AT MANUAL SWINGING

Type of	Use	Maneuvering Clearances	Maneuvering Clearances at Manual Swing Doors					
Approach Direction	Door Side	Perpendicular to Doorway	Parallel to Doorway (beyond latch unless noted)					
From front	Pull	60 inches	18 inches					
From front	Push	48 inches	0 inches <sup>3</sup>					
From hinge side	Pull	60 inches	36 inches					
From hinge side	Pull	54 inches	42 inches					
From hinge side	Push	42 inches <sup>1</sup>	22 inches <sup>3&amp;4</sup>					
From latch side	Pull	48 inches <sup>1</sup>	24 inches					
From latch side	Push	42 inches <sup>2</sup>	24 inches					

1 Add 6 inches (150 mm) if closer and latch provided. 2 Add 6 inches (150 mm) if closer provided. 3 Add 12 inches (305 mm) beyond latch if closer and latch provided.

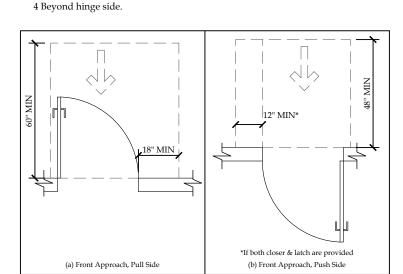

### 308 REACH RANGES

reach shall be 48 inches maximum and the low forward reach shall be 15 inches

minimum above the floor forward reach shall be 48 inches maximum above the floor where the reach depth is

308.3.1 Unobstructed. Where a clear floor space complying with Section 305 allows.

EXCEPTION: Existing elements that are not altered shall be permitted at 54 shall be permitted to be 36 inches maximum above the floor.

309.3 Height. Operable parts shall be placed within one or more of the reach ranges specified in Section 308. 309.4 Operation. Operable parts shall be operable with one hand and shall not require tight grasping, pinching, or twisting of the wrist. The force required to activate operable parts shall be 5.0 pounds (22.2 N) maximum. 401 General

dministrative authority shall comply with the applicable provisions of Chapter 4

#### 402 ACCESSIBLE ROUTES

402.1 General. Accessible routes shall comply with Section 402

#### 403 WALKING SURFACES


403.1 General. Walking surfaces that are a part of an accessible route shall comply

403.3 Slope. The running slope of walking surfaces shall not be steeper than 1:20.

304.3.2, provided the base and arms of the T-shaped space extend 48 inches

404.1 General. Doors and doorways that are part of an accessible route shall comply ticket gates, shall comply with Section 404.2

### **EXCEPTIONS**

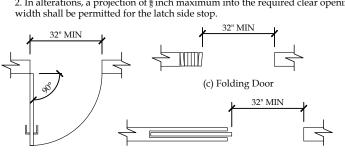

ering clearances at doors shall comply with Section 404.2.3 and shall include the full clear opening width of the

404.2.8 Door-Opening Force. Fire doors shall have the minimum opening force allowable by the appropriate administrative authority. The force for pushing or pulling open doors other than fire doors shall be as follows: 1. Interior hinged door ounds maximum 2. Sliding or folding door: 5.0 pounds maximum These forces do not apply to the force required to retract latch bolts or disengage other devices that hold the door in a closed position.

> 404.2.9 Door Surface. Door surfaces within 10 inches of the floor, measured vertically, shall be a smooth surface on the push side extending the full width of the door. Parts creating horizontal or vertical joints in such surface shall be within 1/16 inch of the same plane as the other. Cavities created by added kick plates shall be

EXCEPTIONS: 1. Sliding doors shall not be required to comply with Section 404.2.9. 2. Tempered glass doors without stiles and having a bottom rail or shoe with the top leading edge tapered at no less than 60 degrees from the horizontal shall not be required to comply with the 10-inch bottom rail height requirement. 3. Doors that do not extend to within 10 inches of the floor shall not be required to comply with Section 404.2.9.

404.2.10 Vision Lites. Doors and sidelites adjacent to doors containing one or more glazing panels that permit viewing through the panels shall have the bottom of at least one panel on either the door or an adjacent sidelite 43 inches maximum above EXCEPTION: Vision lites with the lowest part more than 66 inches (1675 mm) above the floor shall not be required to comply with Section 404.2.10. 404.3 Automatic Doors. Automatic doors and automatic gates shall comply with Section 404.3. Full powered automatic doors shall comply with ANSI/BHMA A

156.10 listed in Section 105.2.4. Power-assist and low-energy doors shall comply

with ANSI/BHMA A 156.19 listed in Section 105.2.3. EXCEPTION: Doors, doorways, and gates designed to be operated only by security personnel shall not be required to comply with Sections 404.3.2, 404.3.4, 404.3.1 Clear Width. Doorways shall have a clear opening width of 32 inches in power-on and power-off mode. The minimum clear opening width for automatic

door systems shall be based on the clear opening width provided with all leafs in the open position. 404.3.2 Maneuvering Clearances. Maneuvering clearances at power-assisted doors shall comply with Section 404.2.3. 404.3.3 Thresholds. Thresholds and changes in level at doorways shall comply with Section 404.2.4. 404.3.4 Two Doors in Series. Doors in series shall comply with Section 404.2.5. 404.3.5 Control Switches. Manually operated control switches shall comply with Section 309. The clear floor space adjacent to the control switch shall be located beyond the arc of the door

36" MIN

\* 54" min. if closer is provided

(f) Latch Approach, Pull Side

(c) Hinge Approach, Pull Side

(d) Hinge Approach, Pull Side

\* 48" min. if closer is provided

(g) Latch Approach, Push Side

404.2.3.3 Sliding and Folding Doors. Sliding doors and folding doors shall have

TABLE 404.2.3.3-MANEUVERING CLEARANCES AT SLIDING AND FOLDING

404.2.3.4 Doorways without Doors. Doorways without doors that are less than 36

inches in width shall have maneuvering clearances complying with Table 404.2.3.4

TABLE 404.2.3.4-MANEUVERING CLEARANCES FOR DOORWAYS WITHOUT

404.2.3.5 Recessed Doors. Where any obstruction within 18 inches of the latch side

404.2.4 Thresholds. If provided, thresholds at doorways shall be 1/2 inch maximum

EXCEPTION: An existing or altered threshold shall be permitted to be 3/4 inch

404.2.5 Two Doors in Series. Distance between two hinged or pivoted doors in series

shall be 48 inches (1220 mm) minimum plus the width of any door swinging into

404.2.6 Door Hardware. Handles, pulls, latches, locks, and other operable parts on

accessible doors shall have a shape that is easy to grasp with one hand and does not

require tight grasping, pinching, or twisting of the wrist to operate. Operable parts

of such hardware shall be 34 inches (865 mm) minimum and 48 inches (1220 mm)

EXCEPTION: Locks used only for security purposes and not used for normal

404.2.7.1 Door Closers. Door closers shall be adjusted so that from an open position

of 90 degrees, the time required to move the door to an open position of 12 degrees

404.2.7.2 Spring Hinges. Door spring hinges shall be adjusted so that from an open

position of 70 degrees, the door shall move to the closed position in 1.5 seconds

maximum above the floor. Where sliding doors are in the fully open position,

operating hardware shall be exposed and usable from both sides.

404.2.7 Closing Speed.

operation shall not be required to comply with Section 404.2.6.

the space. The space between the doors shall provide a turning space complying

maximum in height provided that the threshold has a beveled edge on each side

in height. Raised thresholds and changes in level at doorways shall comply with

of a doorway projects more than 8 inches beyond the face of the door, measured

perpendicular to the face of the door, maneuvering clearances for a forward

with a maximum slope of 1:2 for the height exceeding 1/4 inch.

Perpendicular to Doorway Paranet to Doorway (beyond latch unless noted)

Minimum Maneuvering Clearance

maneuvering clearances complying with Table 404.2.3.3.

1 Beyond pocket or hinge side.

Approach Direction

proach shall be provided

12" MIN\*

48" min. if <u>both</u> closer & latch are provided

(e) Hinge Approach, Push Side

405.1 General. Ramps along accessible routes shall comply with Section 405. EXCEPTION: In assembly areas, aisle ramps adjacent to seating and not serving elements required to be on an accessible route shall not be required to comply with Section 405.

405.2 Slope. Ramp runs shall have a running slope greater than 1:20 and not steeper EXCEPTION: In existing buildings or facilities, ramps shall be permitted to have slopes steeper than 1:12 complying with Table 405.2 where such slopes are

necessary due to space limitations TABLE 405.2-ALLOWABLE RAMP DIMENSIONS FOR CONSTRUCTION IN EXISTING SITES, BUILDINGS AND FACILITIES Maximum Rise Steeper than 1:10 but not steeper than 1:8 3 inches

Steeper than 1:12 but not steeper than 1:10 6 inches 405.3 Cross Slope. Cross slope of ramp runs shall not be steeper than 1:48. 405.4 Floor Surfaces. Floor surfaces of ramp runs shall comply with Section 302. 405.5 Clear Width. The clear width of a ramp run shall be 36 inches minimum. Handrails and handrail supports that are provided on the ramp run shall not project into the required clear width of the ramp run. 405.6 Rise. The rise for any ramp run shall be 30 inches maximum.

405.7 Landings. Ramps shall have landings at the bottom and top of each ramp run. Landings shall comply with Section 405.7. 405.7.1 Slope. Landings shall have a slope not steeper than 1:48 and shall comply with Section 302. 405.7.2 Width. Clear width of landings shall be at least as wide as the widest ramp run leading to the landing.

405.7.3 Length. Landings shall have a clear length of 60 inches minimum. 405.7.4 Change in Direction. Ramps that change direction at ramp landings shall be sized to provide a turning space complying with Section 304.3. 405.7.5 Doorways. Where doorways are adjacent to a ramp landing, maneuvering clearances required by Sections 404.2.3 and 404.3.2 shall be permitted to overlap the anding area. Where a door that is subject to locking is located adjacent to a ramp anding, the landing shall be sized to provide a turning space complying with Section 304.3.

 $405.8\ Handrails.\ Ramp$  runs with a rise greater than 6 inches (150 mm) shall have handrails complying with Section 505. 405.9 Edge Protection. Edge protection complying with Section 405.9.1 or 405.9.2 shall be provided on each side of ramp runs and at each side of ramp landings. EXCEPTIONS: 1. Edge protection shall not be required on ramps not required to have

handrails and that have flared sides complying with Section 406.3.

2. Edge protection shall not be required on the sides of ramp landings serving an adjoining ramp run or stairway 3. Edge protection shall not be required on the sides of ramp landings having a vertical dropoff of 1/2 inch maximum within 10 inches (255 mm) horizontally of the minimum landing area specified in Section 405.7. 4. Edge protection shall not be required on the sides of ramped aisles where the ramps provide access to the adjacent seats and aisle access ways. 405.9.1 Extended Floor Surface. The floor surface of the ramp run or ramp landing shall extend 12 inches minimum beyond the inside face of a railing complying with Section 505.

405.9.2 Curb or Barrier. A curb complying with Section 405.9.2.1 or a barrier complying with Section 405.9.2.2 shall be provided. 405.9.2.1 Curb. A curb shall be a minimum of 4 inches in height 405.9.2.2 Barrier. Barriers shall be constructed so that the barrier prevents the passage of a 4-inch diameter sphere where any portion of the sphere is within 4  $405.10\,\mathrm{Wet}$  Conditions. Landings subject to wet conditions shall be designed to

prevent the accumulation of water.

504.2 Treads and Risers. All steps on a flight of stairs shall have uniform riser height and uniform tread depth. Risers shall be 4 inches minimum and 7 inches maximur in height. Treads shall be 11 inches minimum in depth. 504.3 Open Risers. Open risers shall not be permitted on accessible stairs. 504.4 Tread Surface. Stair treads shall comply with Section 302 and shall have a slope not steeper than 1:48.

504.5 Nosings. The radius of curvature at the leading edge of the tread shall be  $\frac{1}{2}$ ch maximum. Nosings that project beyond risers shall have the underside of the leading edge curved or beveled. Risers shall be permitted to slope under the tread at an angle of 30 degrees maximum from vertical. The permitted projection of the nosing shall be  $1\frac{1}{2}$  inches maximum over the tread or floor below. 504.5.1 Visual contrast. The leading 2 inches of the tread shall have visual contrast of dark-on-light or light-on-dark from the remainder of the tread. 504.6 Handrails. Stairs shall have handrails complying with Section 505.

504.7 Wet Conditions. Stair treads and landings subject to wet conditions shall be designed to prevent the accumulation of water. 504.8 Lighting. Lighting for interior stairways shall comply with Section 504.8. 504.8.1 Illumination Level. Lighting facilities shall be capable of providing 10 foot-candles (108 lux) of illuminance measured at the center of tread surfaces and on landing surfaces within 24 inches (610 mm) of step nosings. 504.8.2 Lighting Controls. If provided, occupancy sensing automatic controls shall activate the stairway lighting so the illuminance level required by Section 504.8.1 is provided on the entrance landing, each stair flight adjacent to the entrance landing

nd on the landings above and below the entrance landing prior to any step being 504.9 Stair Level Identification. Stair level identification signs in raised characters and braille complying with Sections 703.3 and 703.4 shall be located at each floor level landing in all enclosed stairways adjacent to the door leading from the stairwell into the corridor to identify the floor level. The exit door discharging to the outside or to the level of exit discharge shall have a sign with raised characters and braille stating "EXIT."

### 505 HANDRAILS

505.1 General. Handrails required by Section 405.8 for ramps, or Section 504.6 for stairs, shall comply with Section 505. 505.2 Location. Handrails shall be provided on both sides of stairs and ramps.

1. In assembly seating areas, handrails shall not be required on both sides along aisle stairs, provided with a handrail either at the side or within the aisle. 2. In assembly seating areas, handrails shall not be required on the sides of ramped aisles serving seats. 505.3 Continuity. Handrails shall be continuous within the full length of each stair light or ramp run. Inside handrails on switchback or dogleg stairs or ramps shall be ontinuous between flights or runs. Other handrails shall comply with Sections

505.10 and 307. EXCEPTION: Handrails shall not be required to be continuous in aisles serving seating where handrails are discontinuous to provide access to seating and to permit crossovers within the aisles. 505.4 Height. Top of gripping surfaces of handrails shall be 34 inches minimum and

38 inches maximum vertically above stair nosings, ramp surfaces and walking surfaces. Handrails shall be at a consistent height above stair nosings, ramp surfaces and walking surfaces. 505.5 Clearance. Clearance between handrail gripping surface and adjacent surfaces shall be  $1\frac{1}{2}$  inches minimum.  $1\frac{1}{3}$  MIN.

FIG. 505.5 Handrail Clearance 505.6 Gripping Surface. Gripping surfaces shall be continuous, without interruption by newel posts, other construction elements, or obstructions.

**EXCEPTIONS:** 1. Handrail brackets or balusters attached to the bottom surface of the handrail shall not be considered obstructions, provided the brackets or balusters comply with the following criteria: a. Not more than 20 percent of the handrail length is obstructed,

b. Horizontal projections beyond the sides of the handrail occur  $1\frac{1}{2}$  inches ninimum below the bottom of the handrail, and provided that for each ½ inch of additional handrail perimeter dimension above 4 inches, the vertical clearance dimension of 1½ inch can be reduced by 1/8 inch, and c. Edges shall be rounded. 2. Where handrails are provided along walking surfaces with slopes not steeper than 1:20, the bottoms of handrail gripping surfaces shall be permitted to be

obstructed along their entire length where they are integral to crash rails or

505.7 Cross Section. Handrails shall have a cross section complying with Section 505.7.1 or 505.7.2. 505.7.1 Circular Cross Section. Handrails with a circular cross section shall have an outside diameter of 1 1/4 inches minimum and 2 inches maximum 505.7.2 Noncircular Cross Sections. Handrails with a noncircular cross section shall have a perimeter dimension of 4 inches minimum and 6 1/4 inches maximum, and a cross-section dimension of 2 1/4 inches maximum 505.8 Surfaces. Handrails, and any wall or other surfaces adjacent to them, shall be free of any sharp or abrasive elements. Edges shall be rounded.

505.10 Handrail Extensions. Handrails shall extend beyond and in the same direction of stair flights and ramp runs in accordance with Section 505.10. EXCEPTIONS: 1. Continuous handrails at the inside turn of stairs and ramps. 2. Handrail extensions are not required in aisles serving seating where the

505.9 Fittings. Handrails shall not rotate within their fittings.

within the aisle. 3. In alterations, full extensions of handrails shall not be required where such extensions would be hazardous due to plan configuration. 505.10.1 Top and Bottom Extension at Ramps. Ramp handrails shall extend horizontally above the landing 12 inches minimum beyond the top and bottom of ramp runs. Extensions shall return to a wall, guard, or floor, or shall be continuous to the handrail of an adjacent ramp run.

handrails are discontinuous to provide access to seating and to permit crossovers

505.10.2 Top Extension at Stairs. At the top of a stair flight, handrails shall extend horizontally above the landing for 12 inches minimum beginning directly above the landing nosing. Extensions shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an adjacent stair flight 505.10.3 Bottom Extension at Stairs. At the bottom of a stair flight, handrails shall

extend at the slope of the stair flight for a horizontal distance equal to one tread depth beyond the bottom tread nosing. Extensions shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an adjacent stair flight. 602 DRINKING FOUNTAINS 602.1 General. Accessible drinking fountains shall comply with Sections 602 and

602.2 Clear Floor Space. A clear floor space complying with Section 305, positioned for a forward approach to the drinking fountain, shall be provided. Knee and toe centered on the drinking fountain.

space complying with Section 306 shall be provided. The clear floor space shall be 1. Drinking fountains for standing persons.


2. Drinking fountains primarily for children's use shall be permitted where the

complying with Section 305 is provided and the clear floor space is centered on

spout outlet is 30 inches maximum above the floor, a parallel approach

the drinking fountain. 602.3 Operable Parts. Operable parts shall comply with Section 309. 602.4 Spout Outlet Height, Spout outlets of wheelchair accessible drinking fountains shall be 36 inches maximum above the floor. Spout outlets of drinking fountains for standing persons shall be 38 inches minimum and 43 inches maximum above the

602.5 Spout Location. The spout shall be located 15 inches minimum from the vertical support and 5 inches maximum from the front edge of the drinking fountain, including bumpers. Where only a parallel approach is provided, the spout shall be located  $3\frac{1}{2}$  inches maximum from the front edge of the drinking fountain, including bumpers



602.6 Water Flow. The spout shall provide a flow of water 4 inches minimum in height. The angle of the water stream from spouts within 3 inches of the front of the drinking fountain shall be 30 degrees maximum, and from spouts between 3 inches and 5 inches from the front of the drinking fountain shall be 15 degrees maximum, measured horizontally relative to the front face of the drinking fountain.

**603 TOILET AND BATHING ROOMS** 603.1 General. Accessible toilet and bathing rooms shall comply with Section 603. 603.2 Clearances

603.2.1 Turning Space. A turning space complying with Section 304 shall be

provided within the room . The required turning space shall not be provided within a toilet compartment. 603.2.2 Door Swing. Doors shall not swing into the clear floor space or clearance for any fixture. EXCEPTIONS

1. Doors to a toilet or bathing room for a single occupant, accessed only through

a private office and not for common use or public use shall be permitted to swing into the clear floor space, provided the swing of the door can be reversed to comply with Section 603.2.2 2. Where the room is for individual use and a clear floor space complying with Section 305.3 is provided within the room beyond the arc of the door swing, the door shall not be required to comply with Section 603.2.2. 603.3 Mirrors. Where mirrors are located above lavatories, a mirror shall be located

over the accessible lavatory and shall be mounted with the bottom edge of the


reflecting surface 40 inches maximum above the floor. Where mirrors are located above counters that do not contain lavatories, the mirror shall be mounted with the bottom edge of the reflecting surface 40 inches maximum above the floor. EXCEPTION: Other than within Accessible dwelling or sleeping units, mirrors are not required over the lavatories or counters if a mirror is located within the same toilet or bathing room and mounted with the bottom edge of the reflecting

surface 35 inches maximum above the floor. 603.4 Coat Hooks and Shelves. Coat hooks shall be located within one of the reach ranges specified in Section 308. Shelves shall be 40 inches minimum and 48 inches maximum above the floor. 603.5 Diaper Changing Tables. Diaper changing tables shall comply with Sections 603.6 Operable Parts. Operable parts on towel dispensers and hand dryers serving

accessible lavatories shall comply with Table 603.6.										
TABLE 603.6 MAXIMUM REACH DEPTH AND HEIGHT										
Max. Reach Depth	0.5"	2"	5"	6"	9"	11"				
Max. Reach Height	48"	46"	42"	40"	36"	34"				

604 WATER CLOSETS AND TOILET COMPARTMENTS 604.1 General. Accessible water closets and toilet compartments shall comply with Section 604. Compartments containing more than one plumbing fixture shall Section 604.9. Ambulatory accessible compartments shall comply with Section

EXCEPTION: Water closets and toilet compartments primarily for children's use shall be permitted to comply with Section 604.11 as applicable. 604.2 Location. The water closet shall be located with a wall or partition to the rear and to one side. The centerline of the water closet shall be 16 inches minimum and 18 inches maximum from the side wall or partition. Water closets located in ambulatory accessible compartments specified in Section 604.10 shall have the centerline of the water closet 17 inches minimum and 19 inches maximum from the

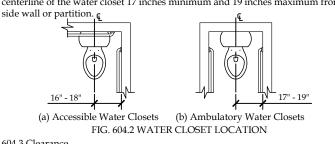




FIG. 604.3 SIZE OF CLEARANCE FOR WATER CLOSET 604.3.1 Clearance width. Clearance around a water closet shall be 60 inches minimum in width, measured perpendicular from the sidewall. 604.3.2 Clearance Depth. Clearance around the water closet shall be 56 inches minimum in depth, measured perpendicular from the rear wall. 604.3.3 Clearance Overlap. The required clearance around the water closet shall be permitted to overlap the water closet, associated grab bars, paper dispensers. sanitary napkin receptacles, coat hooks, shelves, accessible routes, clear floor space at other fixtures and the turning space. No other fixtures or obstructions shall be within the required water closet clearance.

604.4 Height. The height of water closet seats shall be 17 inches minimum and 19 inches maximum above the floor, measured to the top of the seat. Seats shall not be sprung to return to a lifted position. EXCEPTION: A water closet in a toilet room for a single occupant, accessed only

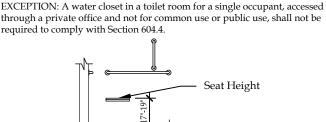


FIG. 604.4 WATER CLOSET SEAT HEIGHT 604.5 Grab Bars. Grab bars for water closets shall comply with Section 609 and shall be provided in accordance with Sections 604.5.1 and 604.5.2. Grab bars shall be provided on the rear wall and on the side wall closest to the water closet. EXCEPTIONS: 1. Grab bars are not required to be installed in a toilet room for a single

occupant, accessed only through a private office and not for common use or

to permit the installation of grab bars complying with Section 604.5.

shall comply with Section 609.4.2.

public use, provided reinforcement has been installed in walls and located so as

2. In detention or correction facilities, grab bars are not required to be installed

in housing or holding cells or rooms that are specially designed without protrusions for purposes of suicide prevention. 604.5.1 Fixed Side Wall Grab Bars. Fixed side-wall grab bars shall be 42 inches minimum in length, located 12 inches maximum from the rear wall and extending 54 inches minimum from the rear wall. In addition, a vertical grab bar 18 inches minimum in length shall be mounted with the bottom of the bar located 39 inches minimum and 41 inches maximum above the floor, and with the center line of the bar located 39 inches minimum and 41 inches maximum from the rear wall. EXCEPTION: The vertical grab bar at water closets primarily for children's use




FIG. 604.5.1 SIDE WALL GRAB BAR FOR WATER CLOSET 604.5.2 Rear Wall Grab Bars. The rear wall grab bar shall be 36 inches minimum in length, and extend from the centerline of the water closet 12 inches minimum on the side closest to the wall, and 24 inches minimum on the transfer side.


EXCEPTIONS 1. The rear grab bar shall be permitted to be 24 inches minimum in length, centered on the water closet, where wall space does not permit a grab bar 36 inches minimum in length due to the location of a recessed fixture adjacent to the

2. Where an administrative authority requires flush controls for flush valves to be located in a position that conflicts with the location of the rear grab bar, that grab bar shall be permitted to be split or shifted to the open side of the toilet area.



FIG. 604.5.2 REAR WALL GRAB BAR FOR WATER CLOSET 604.6 Flush Controls. Flush controls shall be hand operated or automatic. Hand operated flush controls shall comply with Section 309. Flush controls shall be located on the open side of the water closet. EXCEPTION: In ambulatory accessible compartments complying with Section

604.7 Dispensers. Toilet paper dispensers shall comply with Section 309.4. Where the dispenser is located above the grab bar, the outlet of the dispenser shall be located within an area 24 inches minimum and 36 inches maximum from the rear wall. Where the dispenser is located below the grab bar, the outlet of the dispenser shall be located within an area 24 inches minimum and 42 inches maximum from the rear wall. The outlet of the dispenser shall be located 18 inches minimum and 40 inches maximum above the floor. Dispensers shall comply with Section 609.3.

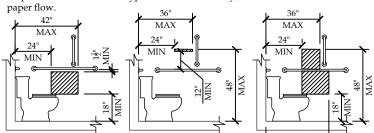

604.9.1 General. Wheelchair accessible compartments shall comply with Section 604.9.2 Size. Toilet compartments shall comply with Section 604.9.2.1 or 604.9.2.2 as

side wall, and 56 inches minimum in depth for wall hung water closets, and 59 inches minimum in depth for floor mounted water closets measured perpendicular 604.9.2.2 Compartment for children's use. The minimum area of a wheelchair accessible compartment primarily for children's use shall be 60 inches minimum in

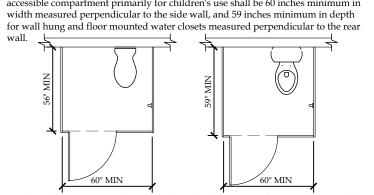


FIG. 604.9.2 WHEELCHAIR ACCESSIBLE TOILET COMPARTMENTS 604.9.3 Doors. Toilet compartment doors, including door hardware, shall comply with Section 404, except if the approach is to the latch side of the compartment door clearance between the door side of the stall and any obstruction shall be 42 inches minimum. The door shall be self-closing. A door pull complying with Section 404.2.6 shall be placed on both sides of the door near the latch. Toilet compartment doors shall not swing into the required minimum area of the compartment. 604.9.3.1 Door Opening Location. The farthest edge of toilet compartment door opening shall be located in the front wall or partition or in the side wall or partition as required by Table 604.9.3.1.

Table 604	.9.3.1 - DOOR OPENING LO	CATION			
Door Opening Location	Measured From	Dimensions			
	From the side wall or partition closest to the water closet	56 inches minimum			
Front Wall or Partition	or				
	From the side wall or partition farthest from the water closet	4 inches maximum			
Side Wall or Partition	From the rear wall	52 inches minimum			
Wall-Hung Water Closet	or				
Wall-Hung Water Closet	From the front wall or partition	4 inches maximum			
COLUMN DO COL	From the rear wall	55 inches minimum			
Side Wall or Partition Floor-Mounted Water Closet	or	•			
Floor-Mounted Water Closet	From the front wall or partition	4 inches maximum			
4" max or 56" min	52" min - wall hung 55" min floor mounted				

(b) Side wall or partition

extending 6 inches beyond the compartment side face of the partition, exclusive of partition support members.

2. Toe clearance at the side partition is not required in a compartment greater 604.9.5.2 Toe Clearance at Compartments for Children's Use. The front partition and at least one side partition of compartments primarily for children's use shall provide a toe clearance of 12 inches minimum above the floor and extending 6 inches beyond the compartment side face of the partition, exclusive of partition support

604.9.6 Grab Bars. Grab bars shall comply with Section 609. Side wall grab bars complying with Section 604.5.1 located on the wall closest to the water closet, and a rear wall grab bar complying with Section 604.5.2, shall be provided. 604.10 Ambulatory Accessible Compartments.

604.10.1 General. Ambulatory accessible compartments shall comply with Section

604.10.2 Size. The minimum area of an ambulatory accessible compartment shall be 60 inches minimum in depth and 36 inches in width. 604.10.3 Doors. Toilet compartment doors, including door hardware, shall comply with Section 404, except if the approach is to the latch side of the compartment door the clearance between the door side of the compartment and any obstruction shall be 42 inches minimum. The door shall be self-closing. A door pull complying with Section 404.2.6 shall be placed on both sides of the door near the latch. Compartment doors shall not swing into the required minimum area of the

complying with Section 604.5.1 shall be provided on both sides of the compartment. 604.11 Water Closets and Toilet Compartments for Children's Use. 604.11.1 General. Accessible water closets and toilet compartments primarily for hildren's use shall comply with Section 604.11. 604.11.2 Location. The water closet primarily for children's use shall be located with a wall or partition to the rear and to one side. The centerline of the water closet shall be 12 inches (305 mm) minimum and 18 inches (455 mm) maximum from the side wall or partition. Water closets located in ambulatory accessible toilet compartments specified in Section 604.10 shall be located as specified in Section

604 10 4 Grab Bars. Grab bars shall comply with Section 609. Side wall grab bars.

604.11.3 Clearance. A clearance around the water closet primarily for children's use complying with Section 604.3 shall be provided. 604.11.4 Height. The height of water closet seats primarily for children's use shall be 11 inches minimum and 17 inches maximum above the floor, measured to the top of the seat. Seats shall not be sprung to return to a lifted position.  $604.11.5\,Grab$  Bars. Grab bars for water closets primarily for children's use shall comply with Section 604.5.

309.2 and 309.4 and shall be installed 36 inches maximum above the floor. Flush controls shall be located on the open side of the water closet. EXCEPTION: In ambulatory accessible compartments complying with Section 604.10, flush controls shall be permitted to be located on either side of the water

604.11.6 Flush Controls. Flush controls primarily for children's use shall be hand

operated or automatic. Hand operated flush controls shall comply with Sections

604.11.7 Dispensers. Toilet paper dispensers primarily for children's use shall comply with Section The outlet of dispensers shall be located within an area 24 inches minimum and 42 inches maximum from the rear wall. The outlet of the dispenser shall be 14 inches minimum and 19 inches maximum above the floor. There shall be a clearance of  $1\frac{1}{2}$  inches minimum below the grab bar. Dispensers shall not be of a type that control delivery or do not allow continuous paper flow. 604.11.8 Toilet Compartments. Toilet compartments primarily for children's use shall comply with Sections 604.9 and 604.10, as applicable.

605.1 General. Accessible urinals shall comply with Section 605. 605.2 Height and Depth. Urinals shall be of the stall type or shall be of the wall hung type with the rim at 17 inches maximum above the floor. Wall hung urinals

operated flush controls shall comply with Section 309.

office and not for common use or public use

**EXCEPTIONS** 

shall be  $13 \, \frac{1}{2}$  inches minimum in depth measured from the outer face of the urinal 605.3 Clear Floor Space. A clear floor space complying with Section 305, positioned for forward approach, shall be provided. 605.4 Flush Controls. Flush controls shall be hand operated or automatic. Hand

606 Lavatories and Sinks 606.1 General. Accessible lavatories and sinks shall comply with Section 606. 606.2 Clear Floor Space. A clear floor space complying with Section 305.3, positioned for forward approach, shall be provided. Knee and toe clearance complying with Section 306 shall be provided. The dip of the overflow shall not be nsidered in determining knee and toe clearances.

1. A parallel approach complying with Section 305 and centered on the sink, shall be permitted to a kitchen sink in a space where a cook top or conventional range is not provided. 2. The requirement for knee and toe clearance shall not apply to a lavatory in a oilet or bathing facility for a single occupant, accessed only through a private

3. A knee clearance of 24 inches minimum above the floor shall be permitted at lavatories and sinks used primarily by children ages 6 through 12 where the rim or counter surface is 31 inches maximum above the floor. 4. A parallel approach complying with Section 305 and centered on the sink, shall be permitted at lavatories and sinks used primarily by children ages 5 and 5. The requirement for knee and toe clearance shall not apply to more than one

bowl of a multibowl sink. 6. A parallel approach complying with Section 305 and centered on the sink, shall be permitted at wet bars. 606.3 Height. The front of lavatories and sinks shall be 34 inches maximum above the floor, measured to the higher of the rim or counter surface. CEPTION: A lavatory in a toilet or bathing facility for a single occ



FIG. 606.3 HEIGHT OF LAVATORIES AND SINKS 606.4 Faucets. Faucets shall comply with Section 309. Hand-operated metering faucets shall remain open for 10 seconds minimum 606.5 Lavatories with Enhanced Reach Range. Where enhanced reach range is required at lavatories, faucets and soap dispenser controls shall have a reach depth of 11 inches maximum or, if automatic, shall be activated within a reach depth of 11 inches maximum. Water and soap flow shall be provided with a reach depth of 11 inches maximum. 606.6 Exposed Pipes and Surfaces. Water supply and drainpipes under lavatories

#### and sinks shall be insulated or otherwise configured to protect against contact. There shall be no sharp or abrasive surfaces under lavatories and sinks.

607.1 General. Accessible bathtubs shall comply with Section 607. 607.2 Clearance. A clearance in front of bathtubs extending the length of the bathtub and 30 inches minimum in depth shall be provided. Where a permanent seat is provided at the head end of the bathtub, the clearance shall extend 12 inches nimum beyond the wall at the head end of the bathtub. 607.3 Seat. A permanent seat at the head end of the bathtub or a removable in-tub seat shall be provided. Seats shall comply with Section 610. 607.4 Grab Bars. Grab bars shall comply with Section 609 and shall be provided in

accordance with Section 607.4.1 or 607.4.2. EXCEPTION: Grab bars shall not be required to be installed in a bathing facility for a single occupant accessed only through a private office and not for common use or public use, provided reinforcement has been installed in walls and located so as to permit the installation of grab bars complying with Section 607.4. 607.4.1 Bathtubs with Permanent Seats. For bathtubs with permanent seats, grab bars complying with Section 607.4.1 shall be provided. 607.4.1.1 Back Wall. Two horizontal grab bars shall be provided on the back wall, one complying with Section 609.4 and the other located 8 inches minimum and 10 inches maximum above the rim of the bathtub. Each grab bar shall be located 15 inches maximum from the head end wall and extend to 12 inches maximum from the control end wall. 607.4.1.2 Control End Wall. Control end wall grab bars shall comply with Section

horizontal grab bars. 607.4.1.2.1 Horizontal Grab Bar. A horizontal grab bar 24 inches minimum in length shall be provided on the control end wall beginning near the front edge of the bathtub and extending toward the inside corner of the bathtub. 607.4.1.2.2 Vertical Grab Bar. A vertical grab bar 18 inches minimum in length shall be provided on the control end wall 3 inches minimum and 6 inches maximum above the horizontal grab bar, and 4 inches maximum inward from the front edge of the bathtub.

607.4.2 Bathtubs without Permanent Seats. For bathtubs without permanent seats,

607.4.2.1 Back Wall. Two horizontal grab bars shall be provided on the back wall.

wall, located between the bathtub rim and grab bar, and between the open side of

the bathtub and the centerline of the width of the bathtub. Controls shall comply

grab bars complying with Section 607.4.2 shall be provided.

with Section 309.4.

rim of the bathtub.

EXCEPTION: An L-shaped continuous grab bar of equivalent dimensions and

positioning shall be permitted to serve the function of separate vertical and

one complying with Section 609.4 and the other located 8 inches minimum and 10 inches maximum above the rim of the bathtub. Each grab bar shall be 24 inches minimum in length, located 24 inches maximum from the head end wall and extend to 12 inches maximum from the control end wall. 607.4.2.2 Control End Wall. Control end wall grab bars shall comply with Section 607.4.2.3 Head End Wall. A horizontal grab bar 12 inches minimum in length shall be provided on the head end wall at the front edge of the bathtub. 607.5 Controls. Controls, other than drain stoppers, shall be provided on an end  $\,$ 

607.6 Hand Shower, A hand shower with a hose 59 inches minimum in length, that can be used as both a fixed shower head and as a hand shower, shall be provided. The hand shower shall have a control with a nonpositive shut-off feature. Where provided, an adjustable-height hand shower mounted on a vertical bar shall be nstalled so as to not obstruct the use of grab bars. 607.7 Bathtub Enclosures. Enclosures for bathtubs shall not obstruct controls, faucets, shower and spray units or obstruct transfer from wheelchairs onto bathtub

seats or into bathtubs. Enclosures on bathtubs shall not have tracks installed on the

607.8 Water Temperature. Bathtubs shall deliver water that is 120°F maximum.

documents will be returned immediately upon completion of the project or upon the request of the This document is the exclusive property of the architect, no rights to ownership are transferable, or shall be lost by the filing of this document with any and all public authorities for the purpose of compliance with Codes and or Ordinances, i.e. Building Permit, etc.

namelv

NOTICE This document, the property of, prepared and issued

by the architect, is submitted for the specific project

and agrees that this document will not be copied or

reproduced in part or in whole, and any special

features peculiar to this design shall not be

incorporated in any other project, unless prior

agreement has been obtained in writing. These

recipient by accepting this document assumes custody



## Bryant & Stratton 110 Broadway Buffalo, NY

2020-04-06: ISSUED FOR BID

SA PROJECT TEAM: PRINCIPAL P.Silvestri

INTERIORS N.Catuzza

PROJ. ARCH. <u>S.Hunt</u> DRAFTER

JOB CAPT.

**ACCESSIBILITY REQUIREMENTS** 1 OF 2



1321 MILLERSPORT HWY PH. 716.691.0900 AMHERST, NY 14221 FAX 716.691.4773

DRAWING #:

SA JOB #:

DATE:


604.9.4 Approach. Wheelchair accessible compartments shall be arranged for left-hand or right-hand approach to the water closet. 604.9.5 Toe Clearance. Toe clearance for compartments primarily for children's use shall comply with Section 604.9.5.2. Toe clearance for other wheelchair accessible

EXCEPTIONS: 1. Toe clearance at the front partition is not required in a compartment greater than 62 inches in depth with a wall-hung water closet, or greater than 65 inches in depth with a floor-mounted water closet than 66 inches in width.

EXCEPTIONS: 1. Toe clearance at the front partition is not required in a compartment greater than 65 inches in depth. 2. Toe clearance at the side partition is not required in a compartment greater than 66 inches in width.


(b) Elevation Children FIG. 604.9.5 - Wheelchair Accessible Compartment Toe Clearance

604.10, flush controls shall be permitted to be located on either side of the water

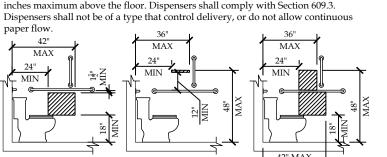

42" MAX (a) Protruding Dispenser (b) Protruding Dispenser Below Grab Bar Above Grab Bar 604.8 Coat Hooks and Shelves. Coat hooks provided within toilet compartments shall be 48 inches maximum above the floor. Shelves shall be 40 inches minimum and 48 inches (1220 mm) maximum above the floor. 604.9 Wheelchair Accessible Compartment

604.9.2.1 Minimum area. The minimum area of a wheelchair accessible mpartment shall be 60 inches minimum in width measured perpendicular to the

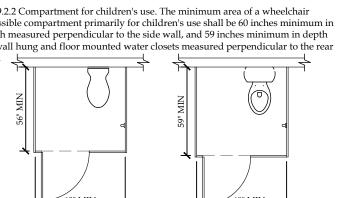

(a) Wall-Hung Water Closet - Adult (b) Floor-Mounted Water Closet - Adult Wall-Hung & Floor Mounted - Children

FIG. 604.9.3.1 - WHEELCHAIR ACCESSIBLE COMPARTMENT DOOR OPENINGS compartments shall comply with Section 604.9.5.1. 604.9.5.1 Toe Clearance at Compartments. The front partition and at least one side partition shall provide a toe clearance of 9 inches minimum above the floor and

and seats complying with Section 608.2. 608.2.1 Transfer-type Shower Compartments. Transfer-type shower compartments shall comply with Section 608.2.1. 608.2.1.1 Size. Transfer-type shower compartments shall have a clear inside dimension of 36 inches in width and 36 inches in depth, measured at the center

point of opposing sides. An entry 36 inches minimum in width shall be provided. 608.2.1.2 Clearance. A clearance of 48 inches minimum in length measured perpendicular from the control wall, and 36 inches minimum in depth shall be provided adjacent to the open face of the compartment. 608.2.1.3 Seat. A folding or non-folding seat complying with Section 610 shall be

provided on the wall opposite the control wall. Exception: A seat is not required to be installed in a shower for a single occupant, accessed only through a private office and not for common use or public use. provided reinforcement has been installed in walls and located so as to permit the

installation of a shower seat. 608.2.2 Standard Roll-in-type Shower Compartments. Standard roll-in-type shower compartments shall comply with Section 608.2.2. 608.2.2.1 Size. Standard roll-in-type shower compartments shall have a clear inside dimension of 60 inches minimum in width and 30 inches minimum in depth, measured at the center point of opposing sides. An entry 60 inches minimum in

width shall be provided. 608.2.2.2 Clearance. A clearance of 60 inches minimum in length adjacent to the 60-inch width of the open face of the shower compartment, and 30 inches minimum in depth, shall be provided.

EXCEPTION: A lavatory complying with Section 606 shall be permitted at the end of the clearance opposite the seat. 608.2.2.3 Seat. A folding seat complying with Section 610 shall be provided on an

EXCEPTIONS: 1. A seat is not required to be installed in a shower for a single occupant accessed only through a private office and not for common use or public use, provided reinforcement has been installed in walls and located so as to permit the

nstallation of a shower seat. 2. A fixed seat shall be permitted where the seat does not overlap the minimum clear inside dimension required by Section 608.2.2.1. 608.2.3 Alternate Roll-in-type Shower Compartments. Alternate roll-in-type shower

compartments shall comply with Section 608.2.3. 608.2.3.1 Size. Alternate roll-in shower compartments shall have a clear inside dimension of 60 inches minimum in width, and 36 inches in depth, measured at the center point of opposing sides. An entry 36 inches minimum in width shall be provided at one end of the 60-inch width of the compartment. A seat wall, 24 inches minimum and 36 inches maximum in length, shall be provided on the entry side of the compartment.

608.2.3.2 Seat. A folding seat complying with Section 610 shall be provided on the seat wall opposite the back wall. EXCEPTION: A seat is not required to be installed in a shower for a single occupant, accessed only through a private office and not for common use or

public use, provided reinforcement has been installed in walls and located so as to permit the installation of a shower seat. 608.3 Grab Bars. Grab bars shall comply with Section 609 and shall be provided in accordance with Section 608.3. Where multiple grab bars are used, required

horizontal grab bars shall be installed at the same height above the floor. EXCEPTION: Grab bars are not required to be installed in a shower for a single occupant, accessed only through a private office and not for common use or public use, provided reinforcement has been installed in walls and located so as to permit the installation of grab bars complying with Section 608.3. 608.3.1 Transfer-Type Showers. Grab bars for transfer type showers shall comply

with Section 608.3.1. 608.3.1.1 Horizontal Grab Bars. Horizontal grab bars shall be provided across the control wall and on the back wall to a point 18 inches from the control wall. 608.3.1.2 Vertical Grab Bar. A vertical grab bar 18 inches minimum in length shall be provided on the control end wall 3 inches minimum and 6 inches maximum above

the horizontal grab bar, and 4 inches maximum inward from the front edge of the 608.3.2 Standard Roll-in-Type Showers. In standard roll-in type showers, a grab bar shall be provided on the back wall beginning at the edge of the seat. The grab bars shall not be provided above the seat. The back wall grab bar shall extend the length of the wall but shall not be required to exceed 48 inches in length. Where a side wall is provided opposite the seat within 72 inches of the seat wall, a grab bar shall be provided on the side wall opposite the seat. The side wall grab bar shall extend the

length of the wall but shall not be required to exceed 30 inches in length. Grab bars shall be 6 inches maximum from the adjacent wall. 60S.3.3 Alternate Roll-in-Type Showers. In alternate roll-in type showers, grab bars shall be provided on the back wall and the end wall adjacent to the seat. Grab bars shall not be provided above the seat. Grab bars shall be 6 inches maximum from the

adjacent wall. 60S.4 Controls and Hand Showers. Controls and hand showers shall comply with Sections 608.4 and 309.4. 608.4.1 Transfer-Type Showers. In transfer-type showers, the controls and hand shower shall be located:

 On the control wall opposite the seat. 2. At a height of 38 inches minimum and 48 inches maximum above the shower

shower opening

608.4.2 Standard Roll-in Showers. In standard roll-in showers, the controls and hand shower shall be located on the back wall above the grab bar, 48 inches (1220 mm) maximum above the shower floor and 16 inches minimum and 27 inches maximum from the end wall behind the seat.

608 4.3 Alternate Roll-in Showers. In alternate roll-in showers, the controls and hand shower shall be located 38 inches minimum and 48 inches maximum above the shower floor. In alternate roll-in showers with controls and hand shower located on the end wall adjacent to the seat, the controls and hand shower shall be 27 inches maximum from the seat wall. In alternate roll-in showers with the controls and hand shower located on the back wall opposite the seat, the controls and hand shower shall be located within 15 inches, left or right, of the centerline of the seat. 608.5 Hand Showers. A hand shower with a hose 59 inches minimum in length, that can be used both as a fixed shower head and as a hand shower shall be provided The hand shower shall have a control with a nonpositive shut-off feature. Where

installed so as to not obstruct the use of grab bars. EXCEPTION: In other than Accessible units and Type A units, a fixed shower head located 48 inches maximum above the shower floor shall be permitted in lieu of a hand shower.

provided, an adjustable-height hand shower mounted on a vertical bar shall be


608.6 Thresholds. Thresholds in roll-in-type shower compartments shall be 1/2 inch maximum in height in accordance with Section 303. In transfer-type shower compartments, thresholds ½ inch maximum in height shall be beveled, rounded, or

EXCEPTION: In existing facilities, in transfer-type shower compartments where provision of a threshold 1/2 inch in height would disturb the structural reinforcement of the floor slab, a threshold 2 inches maximum in height shall be

608.7 Shower Enclosures. Shower compartment enclosures for shower compartments shall not obstruct controls or obstruct transfer from wheelchairs onto shower seats. 608.8 Water Temperature. Showers shall deliver water that is 120°F (49°C) maximum.

609 Grab Bars 609.1 General. Grab bars in accessible toilet or bathing facilities shall comply with Section 609. 609.2 Cross Section. Grab bars shall have a cross section complying with Section

609.2.1 or 609.2.2. 609.2.1 Circular Cross Section. Grab bars with a circular cross section shall have an outside diameter of 11/4 inch minimum and 2 inches maximum. 609.2.2 Noncircular Cross Section. Grab bars with a noncircular cross section shall have a cross section dimension of 2 inches maximum, and a perimeter dimension of

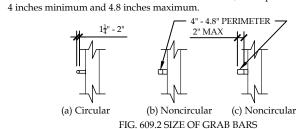

609.3 Spacing. The space between the wall and the grab bar shall be 1½ inches. The space between the grab bar and projecting objects below and at the ends of the grab bar shall be 1½ inches minimum. The space between the grab bar and projecting objects above the grab bar shall be 12 inches minimum. EXCEPTIONS:

1. The space between the grab bars and shower controls, shower fittings, and other grab bars above the grab bar shall be permitted to be 1½ inches minimum. 2. Recessed dispensers projecting from the wall ¼ inch maximum measured from the face of the dispenser and complying with Section 604.7 shall be permitted within the 12-inch space above and the 1½ inch spaces below and at the ends of the grab bar.




FIG. 609.3 SPACING OF GRAB BARS 609.4 Position of Grab Bars.

609.4.1 General. Grab bars shall be installed in a horizontal position, 33 inches minimum and 36 inches maximum above the floor measured to the top of the gripping surface or shall be installed as required by Items 1 through 3. 1. The lower grab bar on the back wall of a bathtub shall comply with Section 1. Vertical grab bars shall comply with Sections 604.5.1, 607.4.1.2.2, 607.4.2.2,

2. Grab bars at water closets primarily for children's use shall comply with Section 609.4.2.

609.4.2 Position of Children's Grab Bars. At water closets primarily for children's use complying with Section 604.11, grab bars shall be installed in a horizontal position 18 inches minimum and 27 inches maximum above the floor measured to he top of the gripping surface. A vertical grab bar shall be mounted with the bottom of the bar located between 21 inches minimum and 30 inches maximum above the floor and with the centerline of the bar located between 34 inches minimum and 36 inches maximum from the rear wall.

609.5 Surface Hazards. Grab bars, and any wall or other surfaces adjacent to grab bars, shall be free of sharp or abrasive elements. Edges shall be rounded. 609.6 Fittings. Grab bars shall not rotate within their fittings. 609.7 Installation and Configuration. Grab bars shall be installed in any manner that provides a gripping surface at the locations specified in this standard and does not

be separate bars, a single piece bar, or combination thereof. 609.8 Structural Strength. Allowable stresses shall not be exceeded for materials used where a vertical or horizontal force of 250 pounds is applied at any point on the grab bar, fastener mounting device, or supporting structure.

obstruct the clear floor space. Horizontal and vertical grab bars shall be permitted to

510.1 General. Seats in accessible bathtubs and shower compartments shall comply

610.2 Bathtub Seats. The height of bathtub seats shall be 17 inches minimum and 19 inches maximum above the bathroom floor, measured to the top of the seat. Removable in-tub seats shall be 15 inches minimum and 16 inches maximum in depth. Removable in-tub seats shall be capable of secure placement. Permanent seats shall be 15 inches minimum in depth and shall extend from the back wall to or beyond the outer edge of the bathtub. Permanent seats shall be positioned at the head end of the bathtub. 610.3 Shower Compartment Seats. The height of shower compartment seats shall be

17 inches minimum and 19 maximum above the bathroom floor, measured to the top of the seat. In transfer-type and alternate roll-in-type showers, the seat shall extend along the seat wall to a point within 3 inches of the compartment entry. In standard roll-in-type showers, the seat shall extend from the control wall to a point within 3 inches of the compartment entry. Seats shall comply with Section 610.3.1 or

610.3.1 Rectangular Seats. The rear edge of a rectangular seat shall be 2 ½ inches maximum and the front edge 15 inches minimum and 16 inches maximum from the seat wall. The side edge of the seat shall be 1 ½ inches maximum from the back wall of a transfer-type shower and 1 ½ inches maximum from the control wall of a roll-in-type shower. 

maximum and the front edge 15 inches minimum and 16 inches maximum from the seat wall. The rear edge of the "L" portion of the seat shall be 1 ½ inches maximum from the wall and the front edge shall be 14 inches minimum and 15 inches maximum from the wall. The end of the "L" shall be 22 inches minimum and 23 inches maximum from the main seat wall. 610.4 Structural Strength. Allowable stresses shall not be exceeded for materials

used where a vertical or horizontal force of 250 pounds is applied at any point on

701.1 Scope. Communications elements and features required to be accessible by the

scoping provisions adopted by the administrative authority shall comply with the

the seat, fastener mounting device, or supporting structure.

applicable provisions of Chapter 7

702.1 General. Accessible audible and visible alarms and notification appliances shall be installed in accordance with NFPA 72 listed in Section 105.2.2, be powered by a commercial

light and power source, be permanently connected to the wiring of the premises electric system, and be permanently installed.

703.1 General. Accessible signs shall comply with Section 703. Tactile signs shall contain both raised characters and braille. Where signs with both visual and raised characters are uired, either one sign with both visual and raised characters, or two separate signs, one with visual, and one with raised characters, shall be provided. 703.1.1 Designations. Interior and exterior signs identifying permanent rooms and spaces shall comply with Sections 703.1, 703.2, and 703.3.

EXCEPTION: Exterior signs that are not located at the door to the space they serve shall not be required to comply with Section 703.3. 703.1.2 Directional and Informational Signs. Signs that provide direction to or information about interior spaces and facilities of the site shall comply with Section 703.2. 703.1.3 Pictograms. Where pictograms are provided as designations of permanent interior rooms and spaces, the pictograms shall comply with Section 703.5 and shall have text descriptors located directly below the pictogram field and complying with Sections 703.2

EXCEPTION: Pictograms that provide information about a room or space, such as "No Smoking", occupant logos, and the International Symbol of Accessibility, are not required to have text descriptors. 703.2 Visual Characters.

703.2.1 General. Visual characters shall comply with the following: 1. Visual characters that also serve as raised characters shall comply with Section 703.3,

2. Visual characters on VMS signage shall comply with Section 703.7, or EXCEPTION: The visual and raised requirements of item 1 shall be permitted to be provided by two separate signs that provide corresponding information provided one sign complies with Section 703.2 and the second sign complies with Section 703.3. 703.2.2 Case. Characters shall be uppercase, lowercase, or a combination of both. 703.2.3 Style, Characters shall be conventional in form, Characters shall not be italic. oblique, script, highly decorative, or of other unusual forms.

703.2.4 Character Height. The uppercase letter "I" shall be used to determine the allowable height of all characters of a font. The uppercase letter "I" of the font shall have a minimum height complying with Table 703.2.4. Viewing distance shall be measured as the horizontal distance between the character and an obstruction preventing further approach towards the EXCEPTION: In assembly seating where the maximum viewing distance is 100 feet or

greater, the height of the uppercase "I" of fonts shall be permitted to be 1 inch for every 30 feet of viewing distance, provided the character height is 8 inches minimum. Viewing distance shall be measured as the horizontal distance between the character and where someone is expected to view the sign.

TABLE 703.2.4 - VISUAL CHARACTER HEIGHT

Height above Floor to Baseline of Character	Horizontal Viewing Distance	Minimum Character Height				
40 inches to less than or equal to	Less than 6 feet	5/8 inch				
70 inches	6 feet and greater	$\frac{5}{8}$ inch, plus $\frac{1}{8}$ inch per foot of viewing distance above 6 feet				
Greater than 70 inches to less than	Less than 15 feet	2 inches				
or equal to 120 inches	15 feet and greater	2 inches, plus $\frac{1}{8}$ inch per foot of viewing distance above 15 feet				
	Less than 21 feet	3 inches				
Greater than 120 inches	12 feet and greater	3 inches, plus $\frac{1}{8}$ inch per foot of viewing distance above 21 feet				
500.0.5.Cl	1	1. 1				

703.2.5 Character Width. The uppercase letter "0" shall be used to determine the allowable width of all characters of a font. The width of the uppercase letter "0" of the font shall be 55 ercent minimum and 110 percent maximum of the height of the uppercase "I" of the font. 703.2.6 Stroke Width. The uppercase letter "I" shall be used to determine the allowable stroke width of all characters of a font. The stroke width shall be 10 percent minimum and 30 percent maximum of the height of the uppercase "I" of the font. 703.2.7 Character Spacing. Spacing shall be measured between the two closest points of adjacent characters within a message, excluding word spaces. Spacing between individual characters shall be 10 percent minimum and 35 percent maximum of the character height. 703.2.8 Line Spacing. Spacing between the baselines of separate lines of characters within a nessage shall be 135 percent minimum and 170 percent maximum of the character height.

EXCEPTION: In assembly seating where the maximum viewing distance is 100 feet or greater, the spacing between the baselines of separate lines of characters within a nessage shall be permitted to be 120 percent minimum and 170 percent maximum of the character height. 703.2.9 Height Above Floor. Visual characters shall be 40 inches minimum above the floor of the viewing position, measured to the baseline of the character. Heights shall comply with Table 703.2.4, based on the size of the characters on the sign.

EXCEPTION: Visual characters indicating elevator car controls shall not be required to comply with Section 703.2.9. 703.2.10 Finish and Contrast. Characters and their background shall have a non-glare finish. Characters shall contrast with their background, with either light characters on a dark background, or dark characters on a light background.

703.3.1 General. Raised characters shall comply with Section 703.3, and shall be duplicated in braille complying with Section 703.4. 703.3.2 Depth. Raised characters shall be raised 1/32 inch minimum above their

703.3.3 Case. Characters shall be uppercase. 703.3.4 Style. Characters shall be sans serif. Characters shall not be italic, oblique, script, highly decorative, or of other unusual forms. 703.3.5 Character Height. The uppercase letter "I" shall be used to determine the allowable height of all characters of a font. The height of the uppercase letter "I" of the font, measured vertically from the baseline of the character, shall be 5/8 inch minimum, and 2 inches


EXCEPTION: Where separate raised and visual characters with the same information are provided, the height of the raised uppercase letter "I" shall be permitted to be 1/2 inch

703.3.6 Character Width. The uppercase letter "0" shall be used to determine the allowable width of all characters of a font. The width of the uppercase letter "0" of the font shall be 55 percent minimum and 110 percent maximum of the height of the uppercase "I" of the font. 703.3.7 Stroke Width. Raised character stroke width shall comply with Section 703.3.7. The appercase letter "I" of the font shall be used to determine the allowable stroke width of all characters of a font. 703.3.7.1 Maximum. The stroke width shall be 15 percent maximum of the height of the

appercase letter "I" measured at the top surface of the character, and 30 percent maximum of the height of the uppercase letter "I" measured at the base of the character. 703.3.7.2 Minimum. When characters are both visual and raised, the stroke width shall be 10 percent minimum of the height of the uppercase letter "I". 703.3.8 Character Spacing. Character spacing shall be measured between the two closest points of adjacent raised characters within a message, excluding word spaces. Spacing between individual raised characters shall be 1/8 inch minimum measured at the top surface of the characters, 1/16 inch minimum measured at the base of the characters, and four times the raised character stroke width maximum. Characters shall be separated from raised borders and decorative elements 3/8 inch minimum.

703.3.9 Line Spacing. Spacing between the baselines of separate lines of raised characters within a message shall be 135 percent minimum and 170 percent maximum of the raised character height.

703.3.10 Height above Floor. Raised characters shall be 48 inches minimum above the floor, measured to the baseline of the lowest raised character and 60 inches maximum above the floor, measured to the baseline of the highest raised character. EXCEPTION: Raised characters for elevator car controls shall not be required to comply

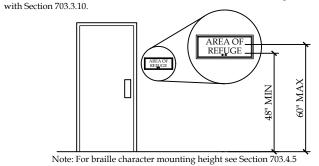

Note: For braille character mounting height see Section 703.4.5 FIG. 703.3.10

HEIGHT OF RAISED CHARACTERS ABOVE FLOOR 703.3.11 location. Where a sign containing raised characters and braille is provided at a door, the sign shall be alongside the door at the latch side. Where a sign containing raised characters and braille is provided at double doors with one active leaf, the sign shall be located on the inactive leaf. Where a sign containing raised characters and braille is ided at double doors with two active leaves, the sign shall be to the right of the right-hand door. Where there is no wall space on the latch side of a single door, or to the right side of double doors, signs shall be on the nearest adjacent wall. Signs containing d characters and braille shall be located so that a clear floor area 18 inches minim by 18 inches minimum, centered on the raised characters is provided beyond the arc of any door swing between the closed position and 45 degree open position.

EXCEPTION: Signs containing raised characters and braille shall be permitted on the push side of doors with closers and without hold-open devices.

LOCATION OF SIGNS AT DOORS 703.3.12 Finish and Contrast. Characters and their background shall have a non-glare finish. Characters shall contrast with their background with either light characters on a dark

background, or dark characters on a light background. EXCEPTION: Where separate raised characters and visual characters with the same information are provided, raised characters are not required to have non-glare finish or to contrast with their background.

703.4.1 General. Braille shall be contracted (Grade 2) braille and shall comply with Section 703.4.2 Uppercase Letters. The indication of an uppercase letter or letters shall only be used before the first word of sentences, proper nouns and names, individual letters of the alphabet, initials, or acronyms.

TARLE 703 4 3 RRAILLE MEASUREMENT

703.4.3 Dimensions. Braille dots shall have a domed or rounded shape and shall comply

TABLE 703.4.3 BRAILLE MEASUREMENT								
Measurement Range	Minimum in inches Maximum in inches							
Dot base diameter	0.059 to 0.063							
Distance between two dots in the same cell	0.090 to 0.100							
Distance between corresponding dots in adjacent cells <sup>1</sup>	0.241 to 0.300							
Dot height	0.025 to 0.037							
Distance between corresponding dots from one cell	0.395 to 0.400							

Measured center to center 703.4.4 Position. Braille shall be below the corresponding text. If text is multilined, braille shall be placed below entire text. Braille shall be separated 3/8 inch minimum from any other raised characters and 3/8 inch minimum from raised borders and decorative elements. Braille provided on elevator car controls shall be separated 3/16 inch minimum either directly below or adjacent to the corresponding raised characters or symbols. 703.4.5 Mounting Height. Braille shall be 48 inches minimum and 60 inches maximum

above the floor, measured to the baseline of the braille cells. EXCEPTION: Elevator car controls shall not be required to comply with Section 703.4.5. 703.5 Pictograms.

703.5.1 General. Pictograms shall comply with Section 703.5. 703.5.2 Pictogram Field. Pictograms shall have a field 6 inches minimum in height. Characters or braille shall not be located in the pictogram field.



with Table 703.4.3.

MEN

703.5.3 Finish and Contrast. Pictograms and their fields shall have a nonglare finish. Pictograms shall contrast with their fields, with either a light pictogram on a dark field or a dark pictogram on a light field 703.6 Symbols of Accessibility.

703.6.1 General. Symbols of accessibility shall comply with Section 703.6. 703.6.2 Finish and Contrast. Symbols of accessibility and their backgrounds shall have a non-glare finish. Symbols of accessibility shall contrast with their backgrounds, with either a light symbol on a dark background or a dark symbol on a light background.

703.6 Symbols of Accessibility.  $703.6.3.1\ International\ Symbol\ of\ Accessibility.\ The\ International\ Symbol\ of\ Accessibility$ shall comply with Figure 703.6.3.1. 703.6.3.2 International Symbol of TTY. The International Symbol of TTY shall comply with

Figure 703.6.3.2. 703.6.3.3 Assistive Listening Systems. Assistive listening systems shall be identified by the International Symbol of Access for Hearing Loss complying with Figure 703.6.3.3. 703.6.3.4 Volume-Controlled Telephones. Telephones with volume controls shall be identified by a pictogram of a telephone handset with radiating sound waves on a square







INTERNATIONAL SYMBOL OF ACCESSIBILITY

INTERNATIONAL SYMBOL OF ACCESS FOR HEARING LOSS

INTERNATIONAL TTY SYMBOL VOLUME-CONTROLLED TELEPHONE

NOTICE

This document, the property of, prepared and issued by the architect, is submitted for the specific project namelv recipient by accepting this document assumes custody and agrees that this document will not be copied or reproduced in part or in whole, and any special features peculiar to this design shall not be incorporated in any other project, unless prior agreement has been obtained in writing. These documents will be returned immediately upon completion of the project or upon the request of the

This document is the exclusive property of the architect, no rights to ownership are transferable, or shall be lost by the filing of this document with any and all public authorities for the purpose of compliance with Codes and or Ordinances, i.e. Building Permit, etc.



Bryant & Stratton 110 Broadway Buffalo, NY

2020-04-06: ISSUED FOR BID

SA PROJECT TEAM: PRINCIPAL P.Silvestri PROJ. ARCH. <u>S.Hunt</u> DRAFTER

INTERIORS N.Catuzza

JOB CAPT.

TITLE:


**ACCESSIBILITY** REQUIREMENTS 2 OF 2





SA JOB #: 19099.02


DATE:


DRAWING #:

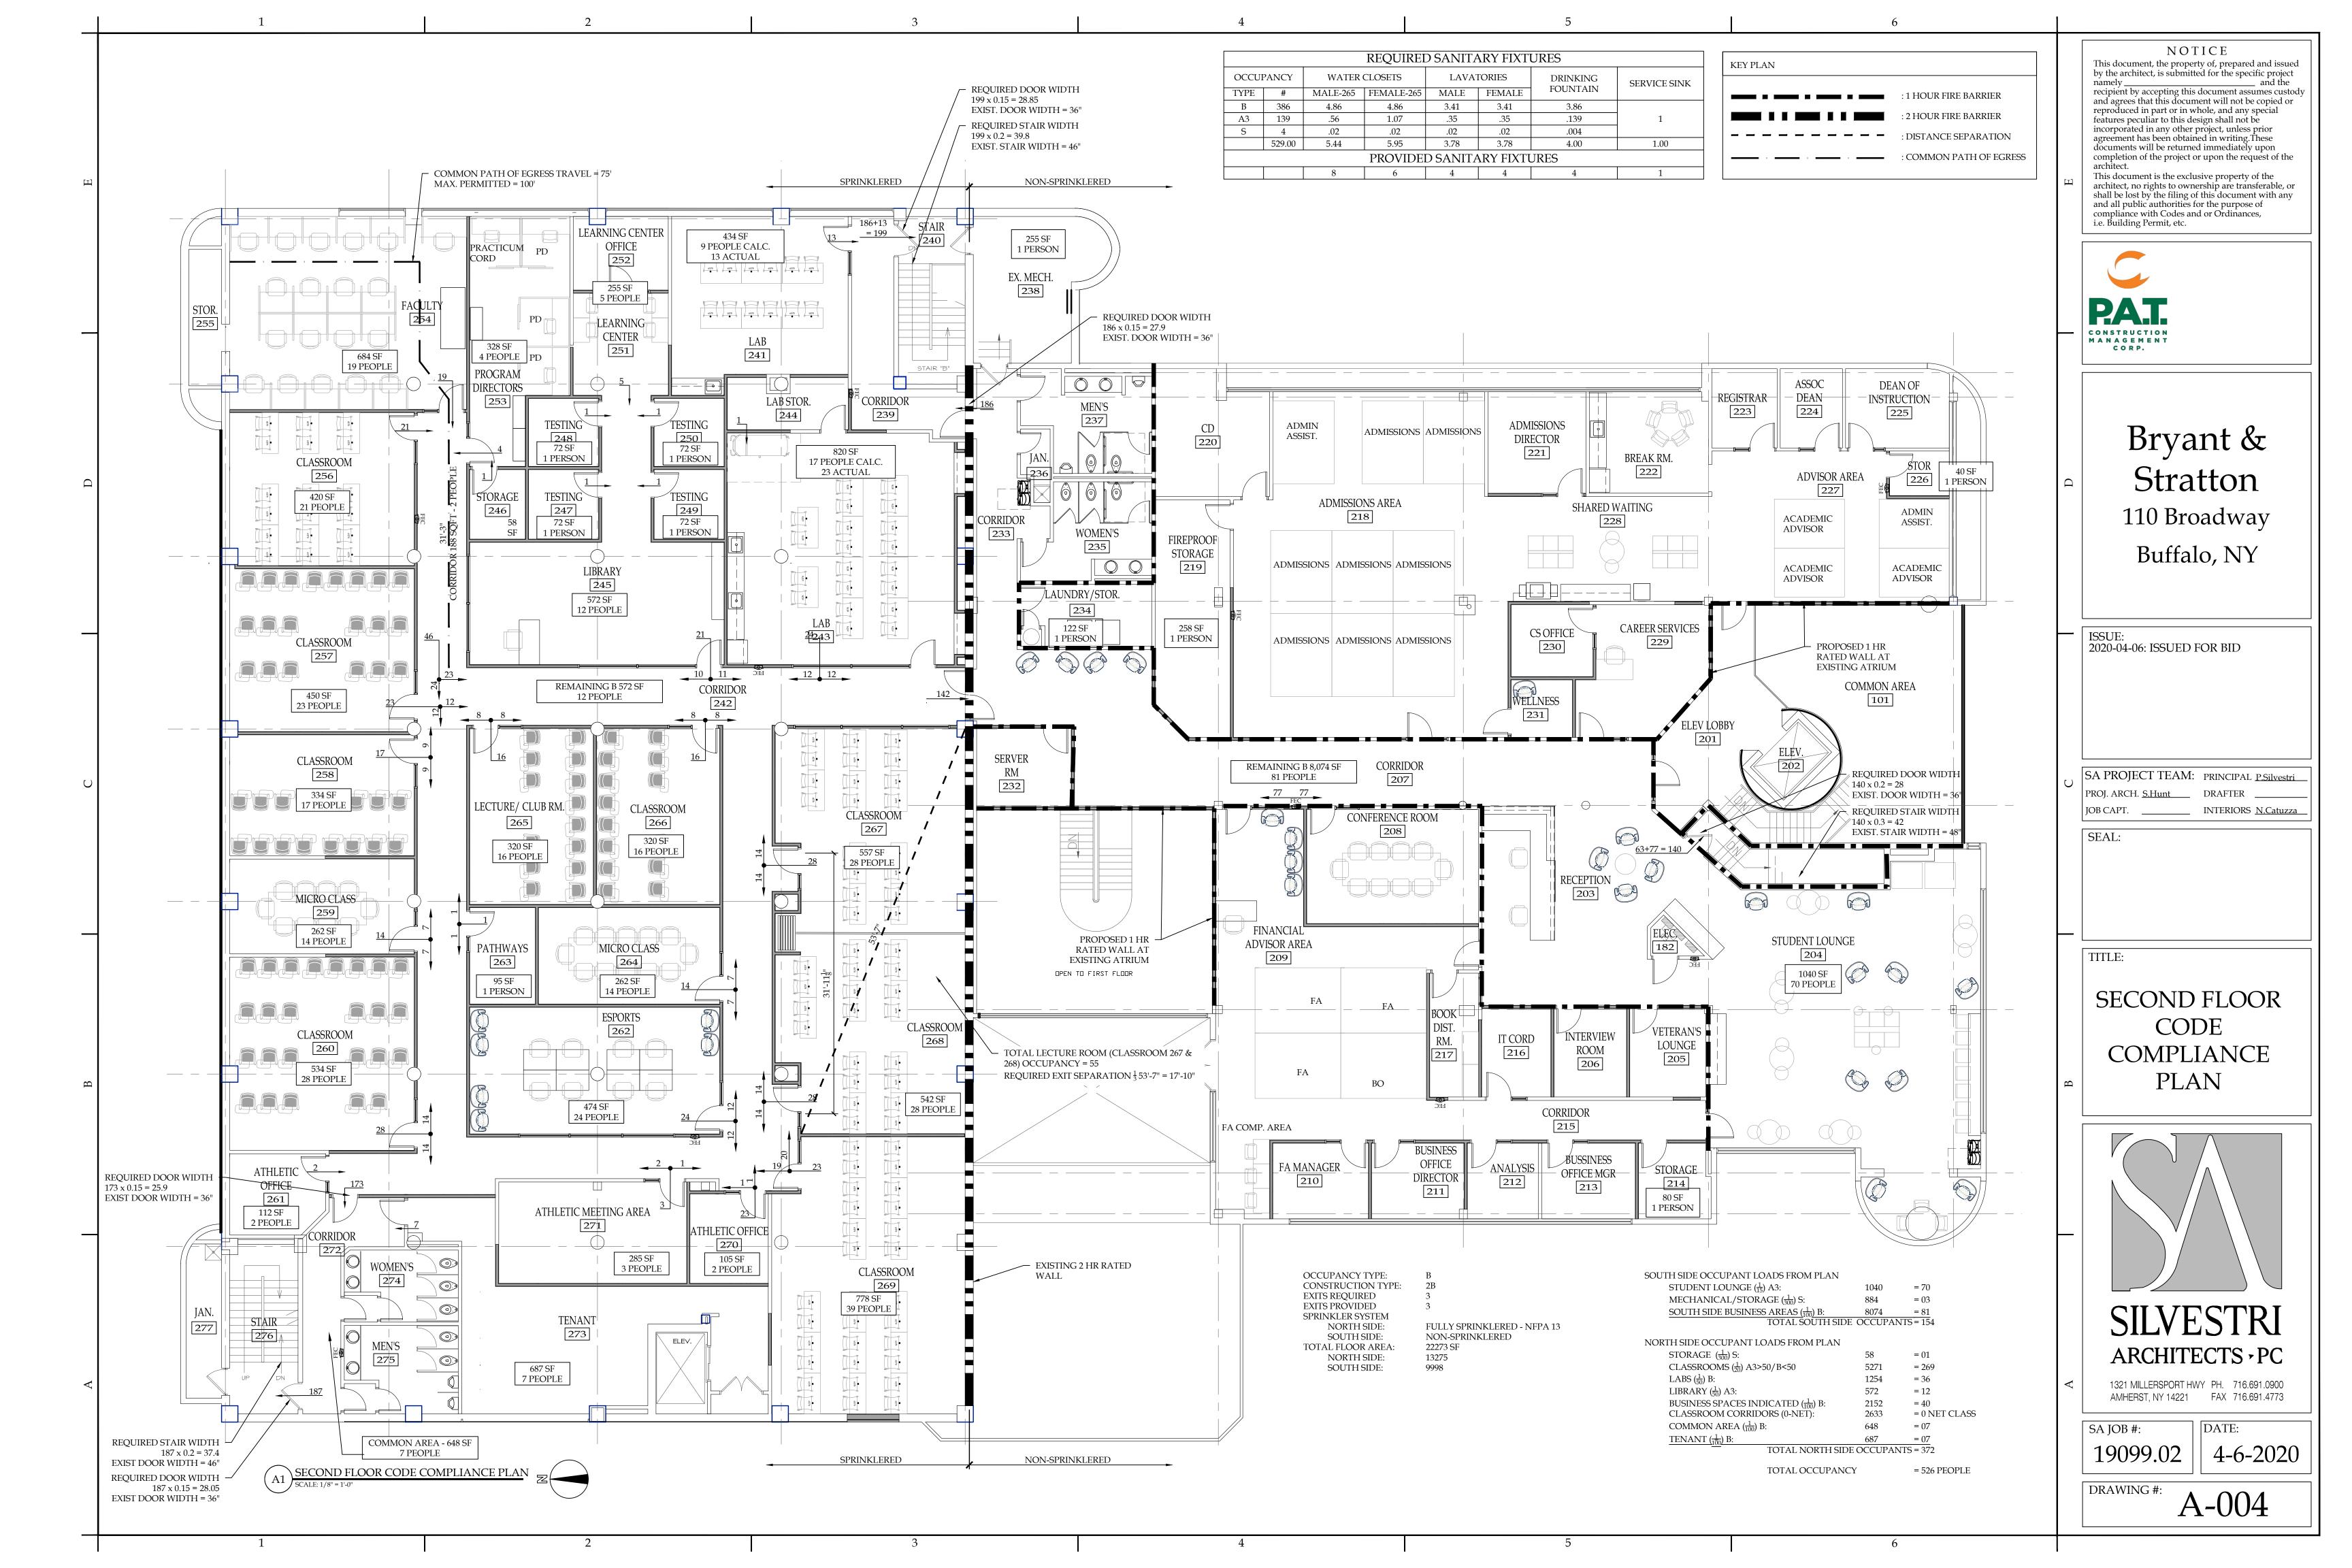


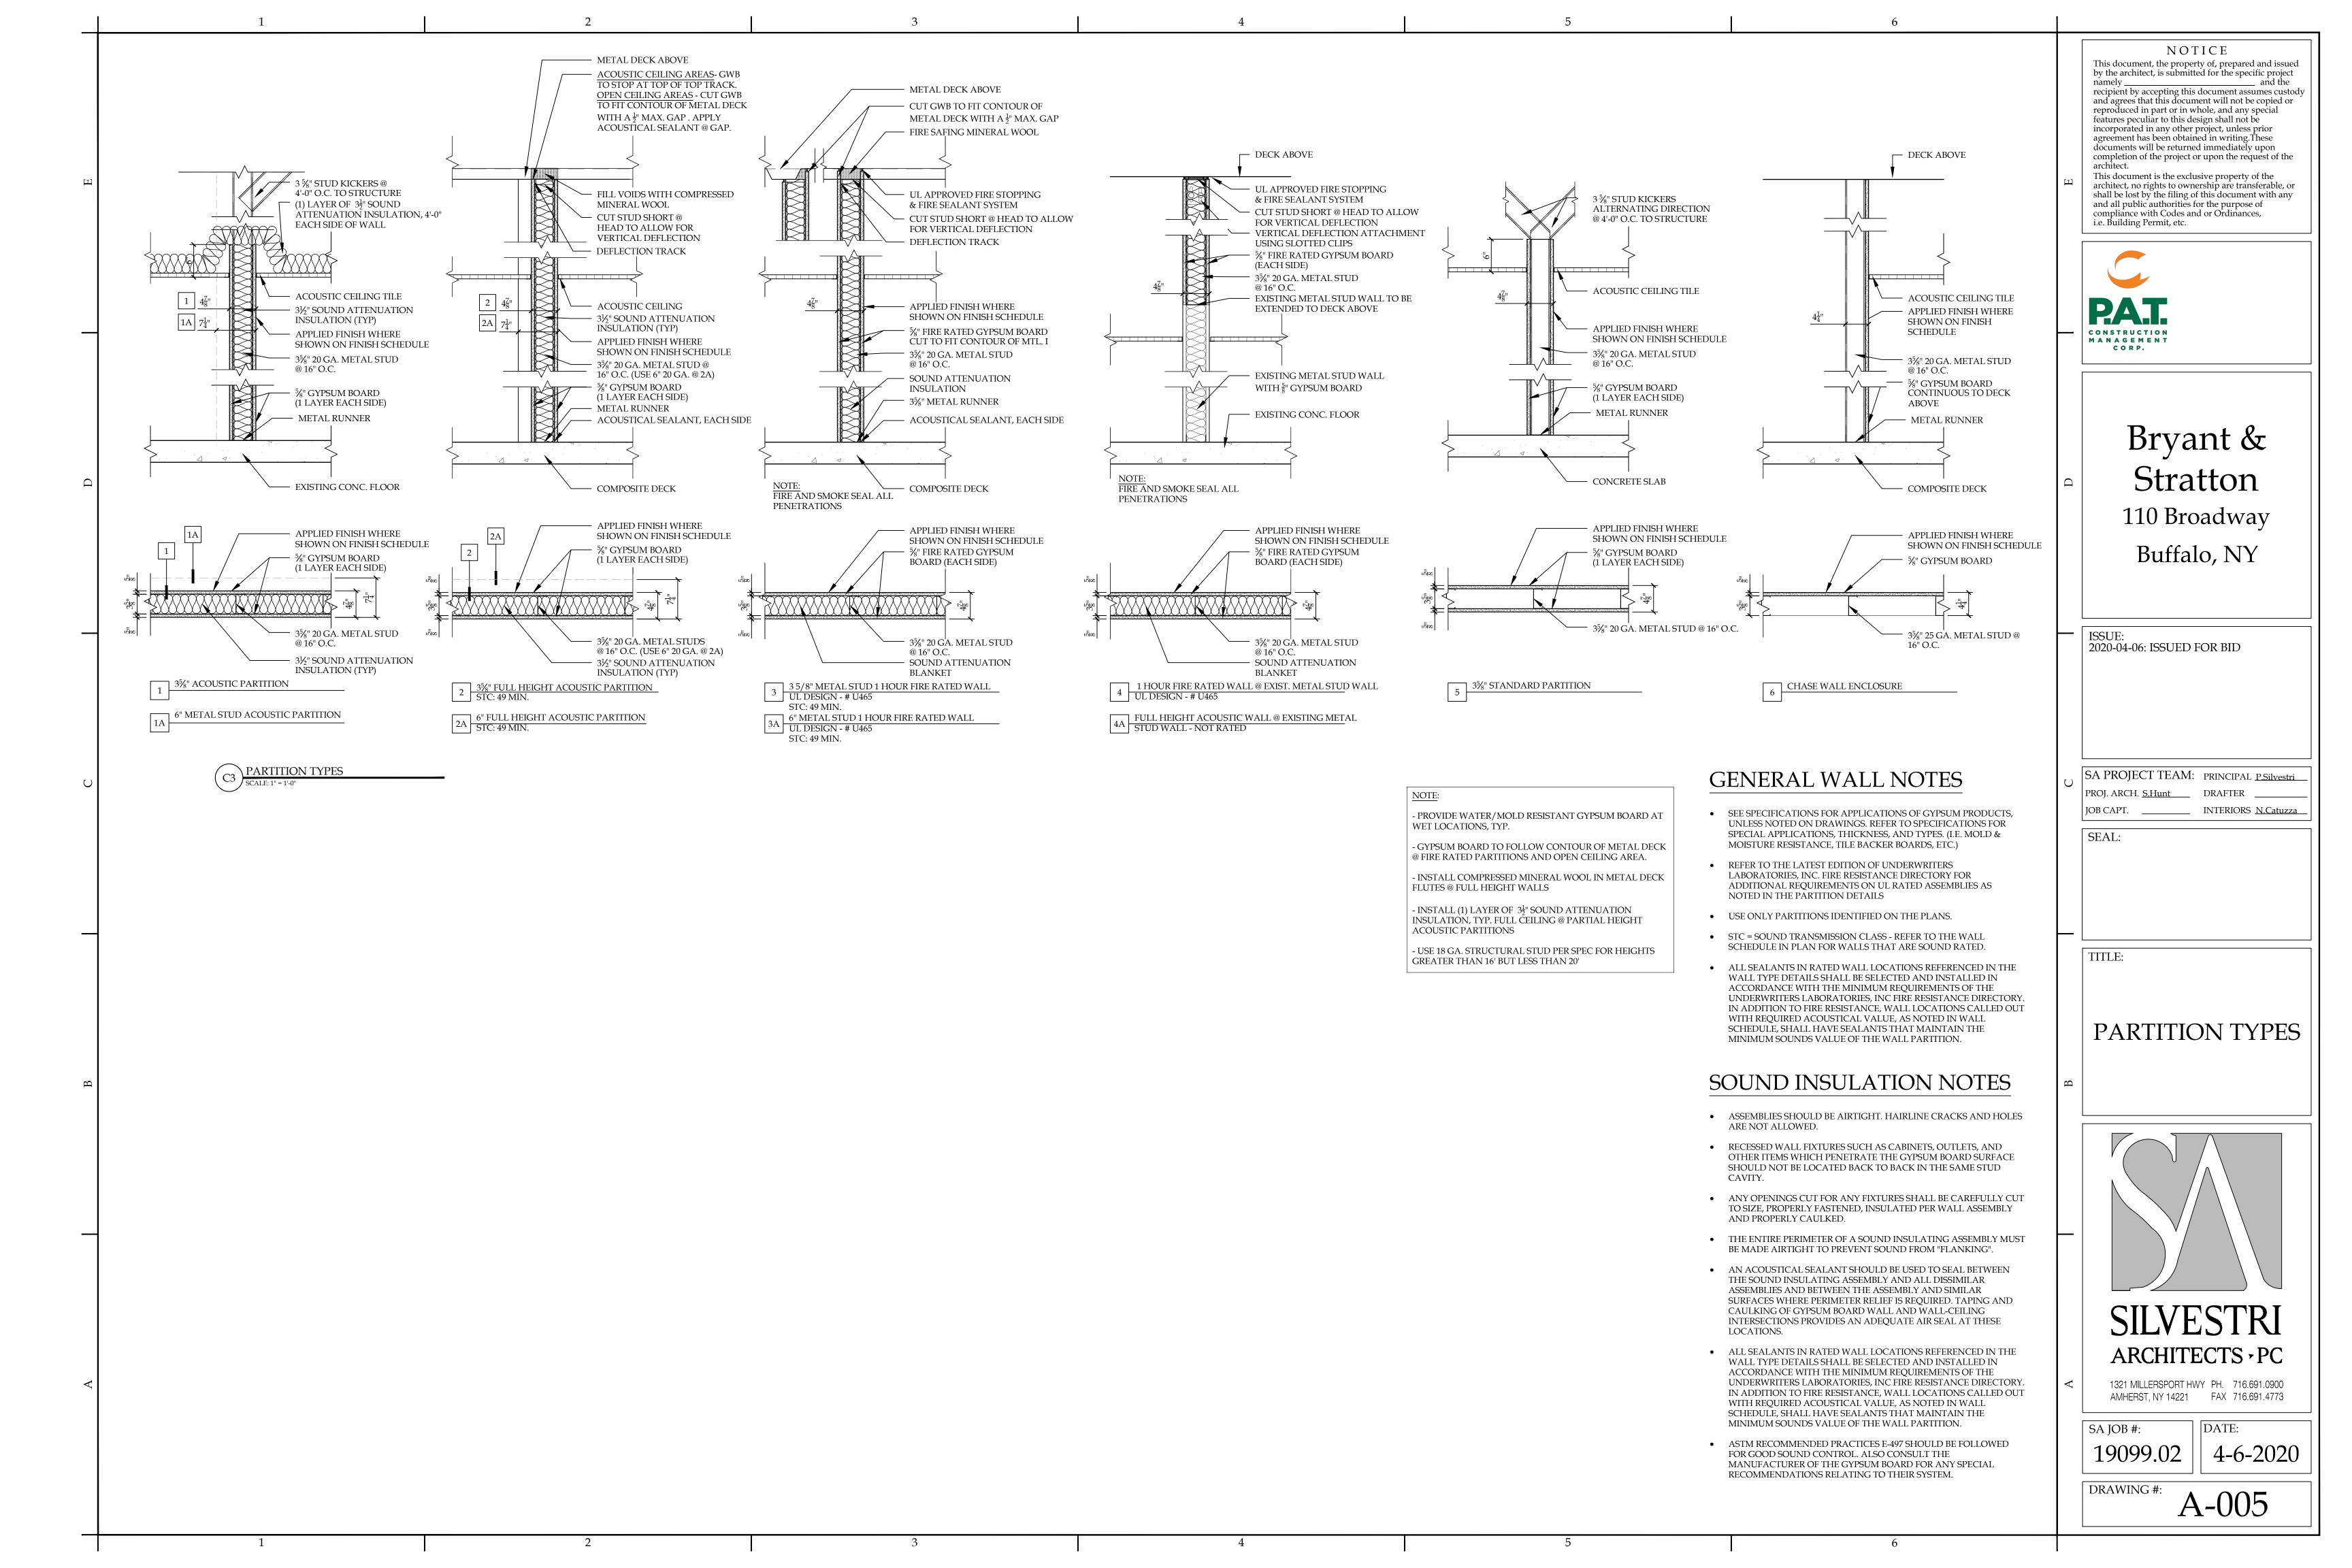


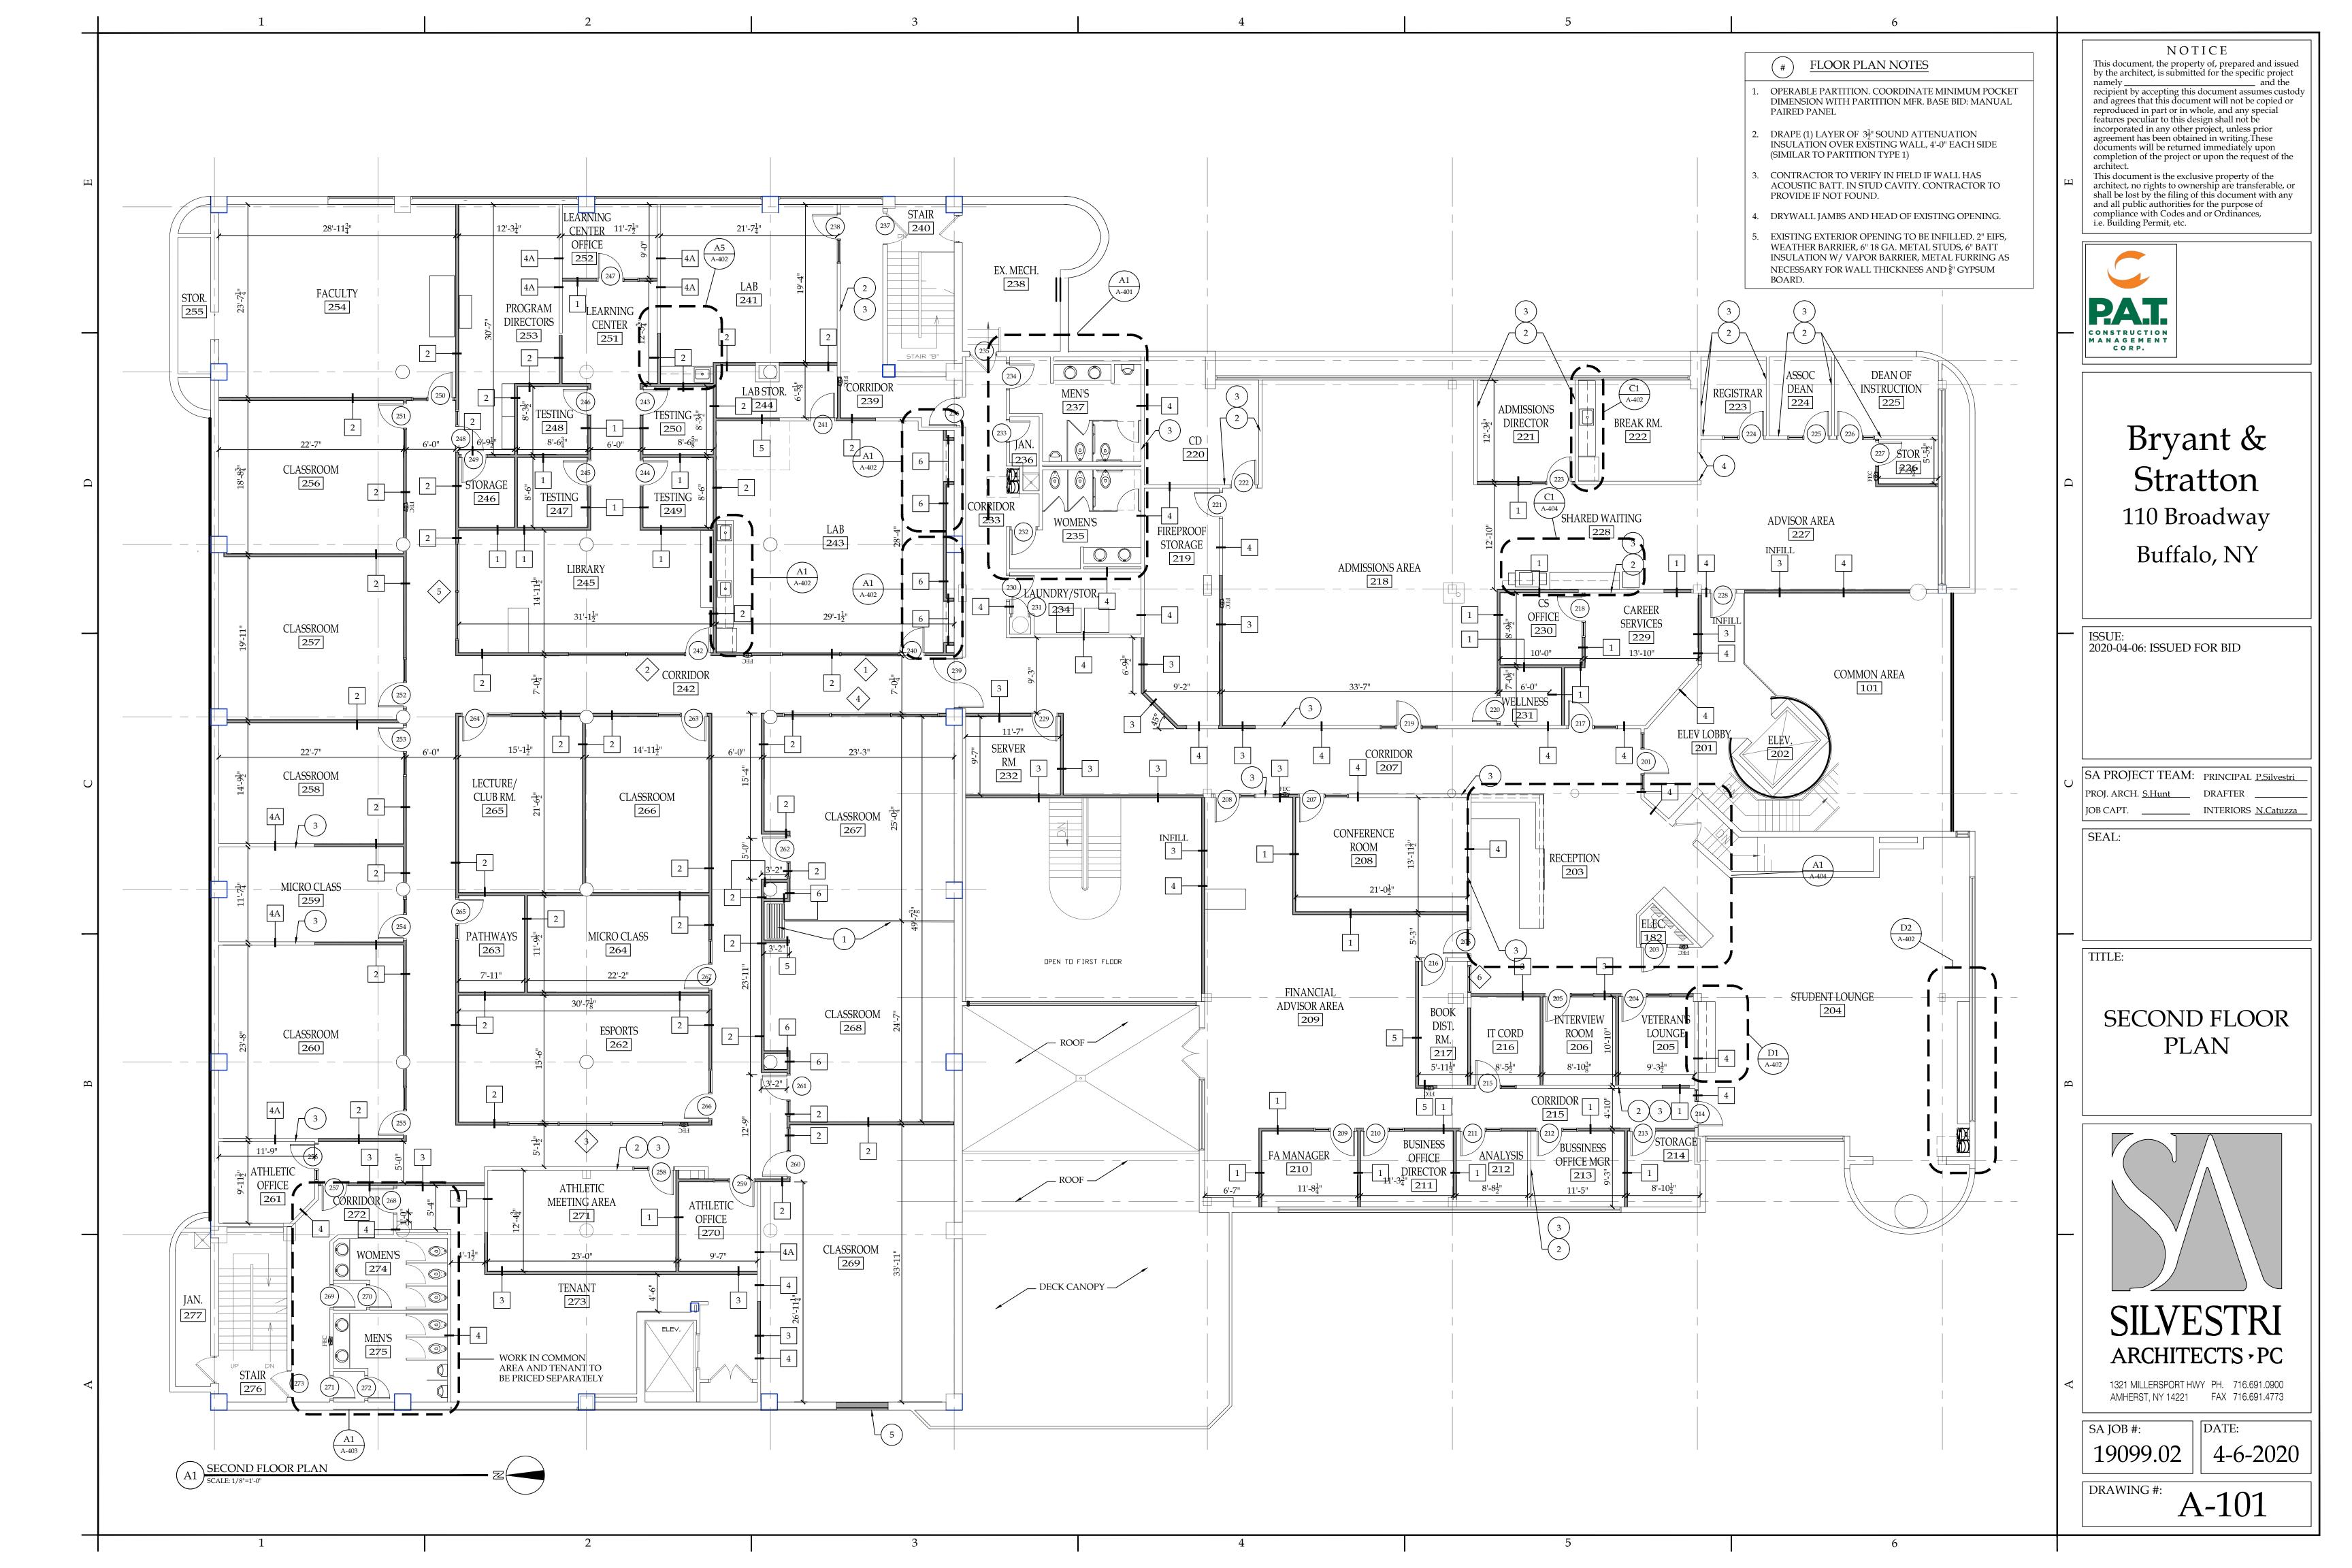


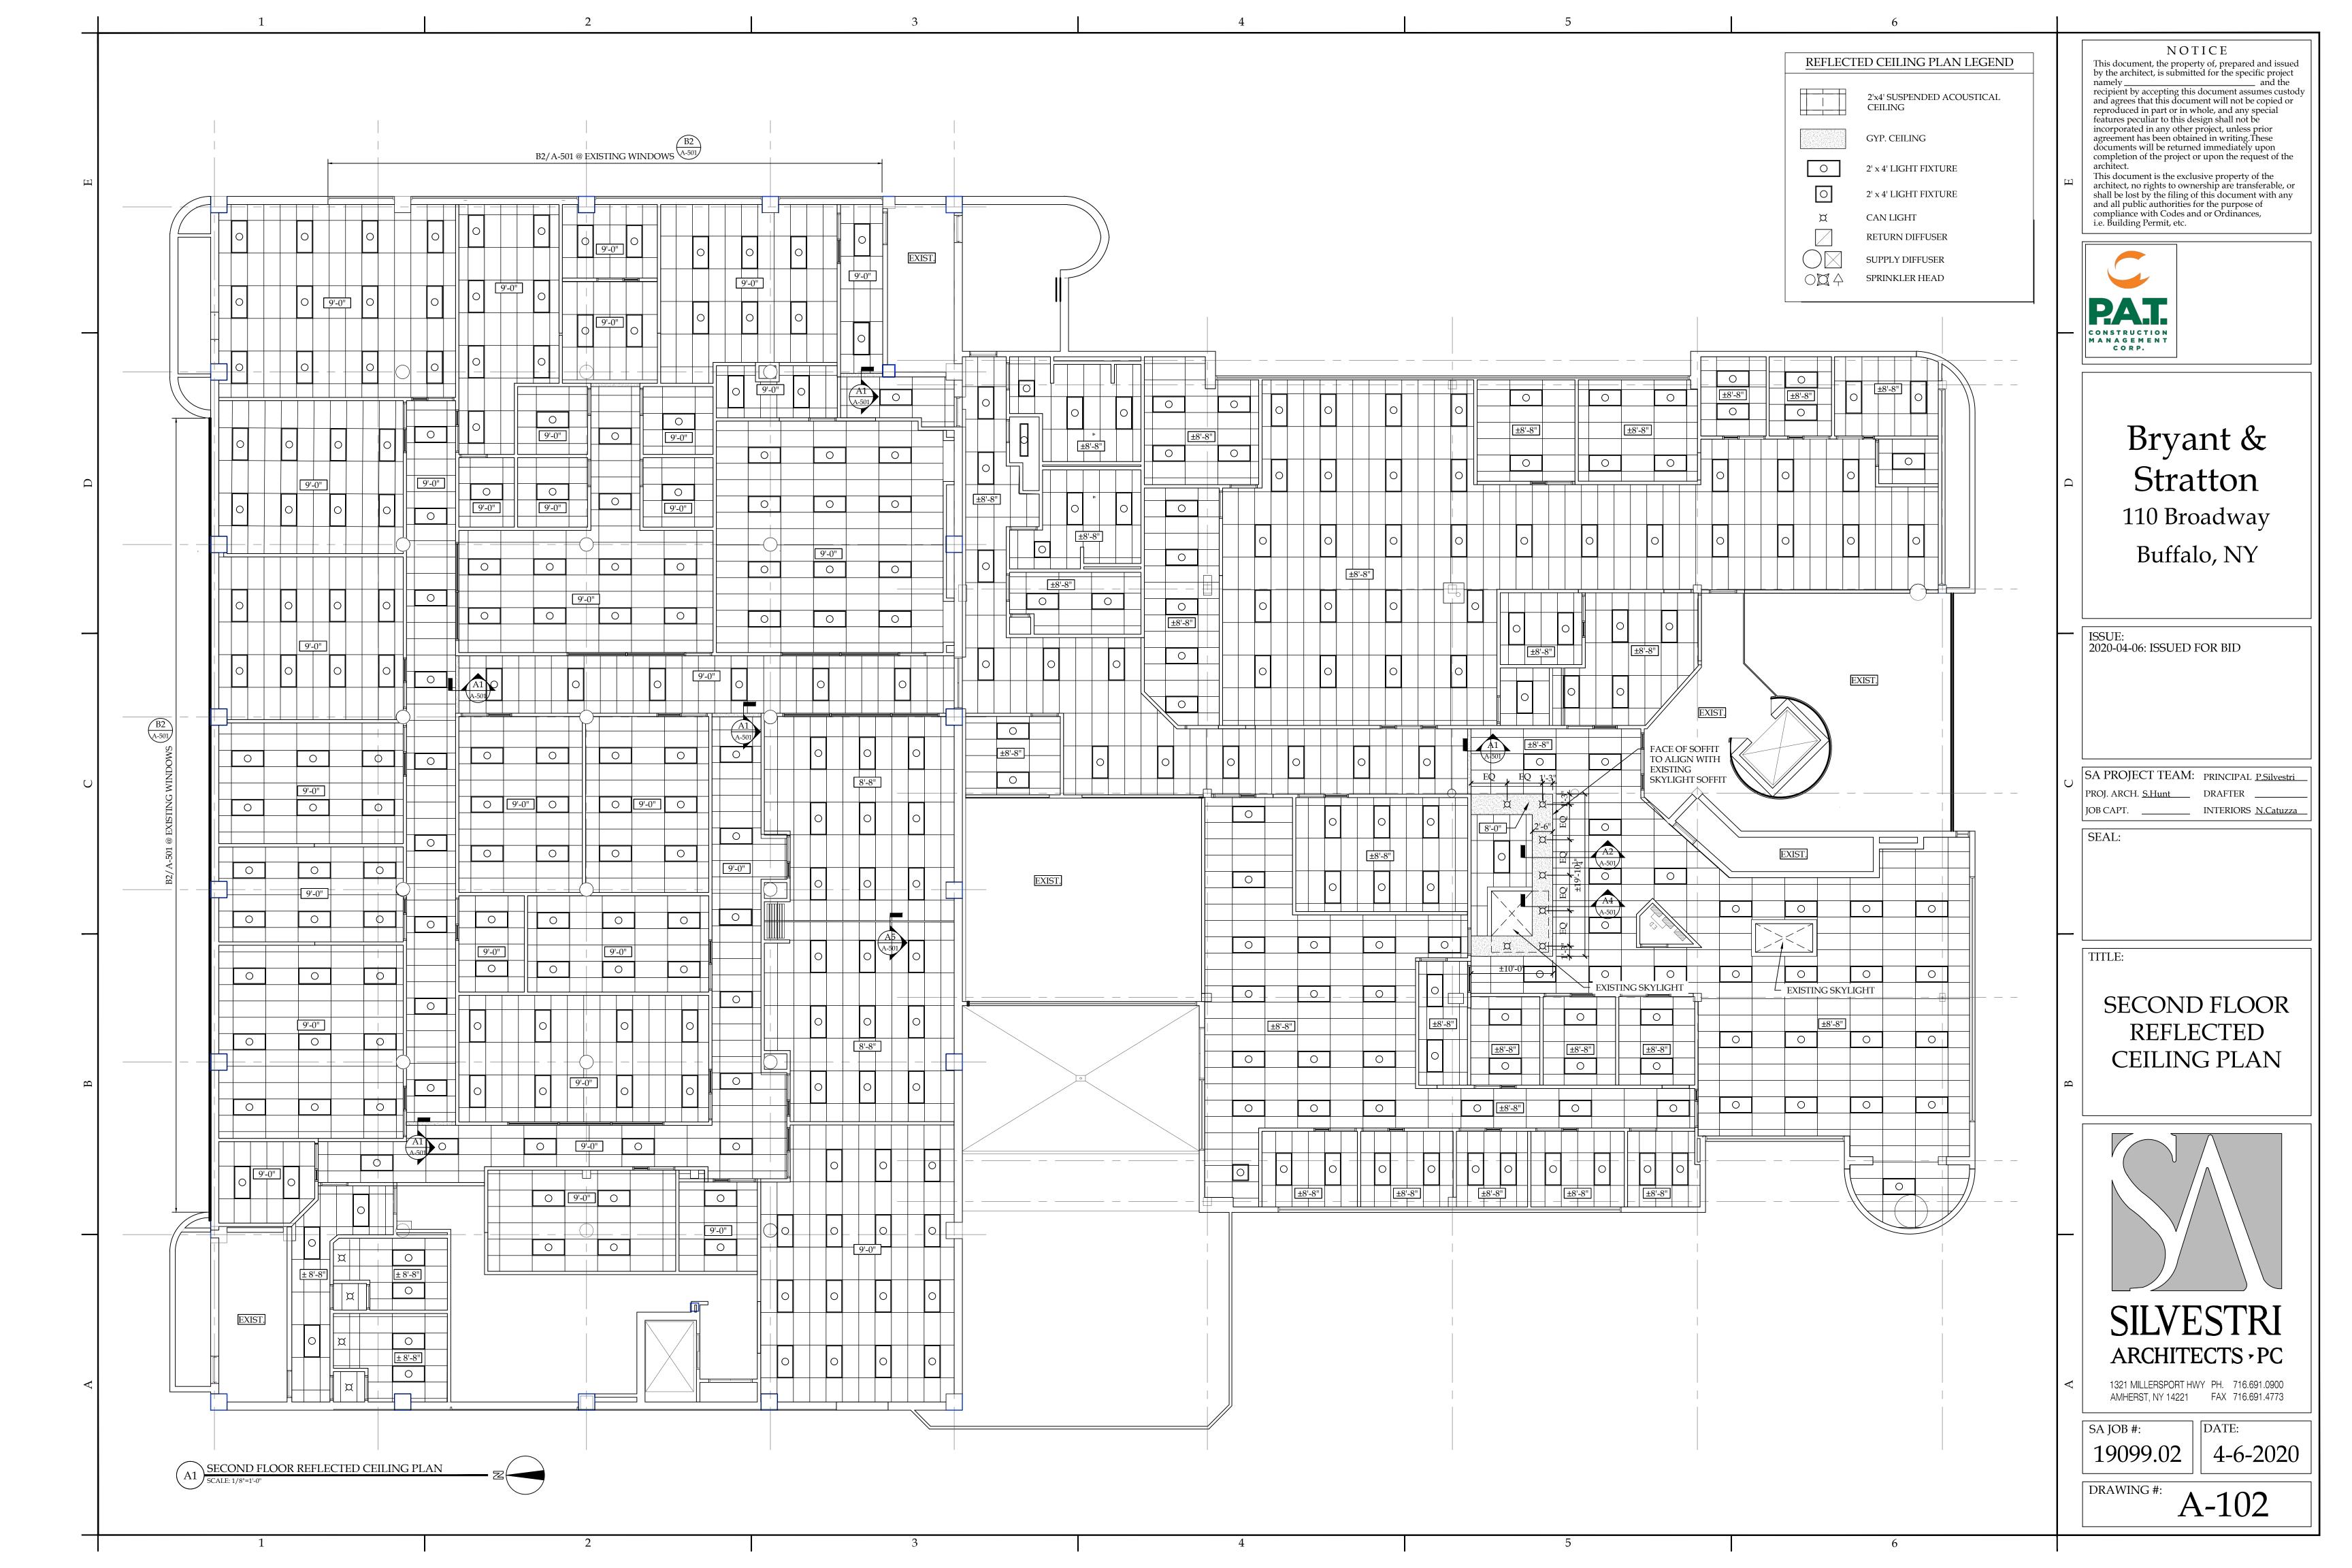


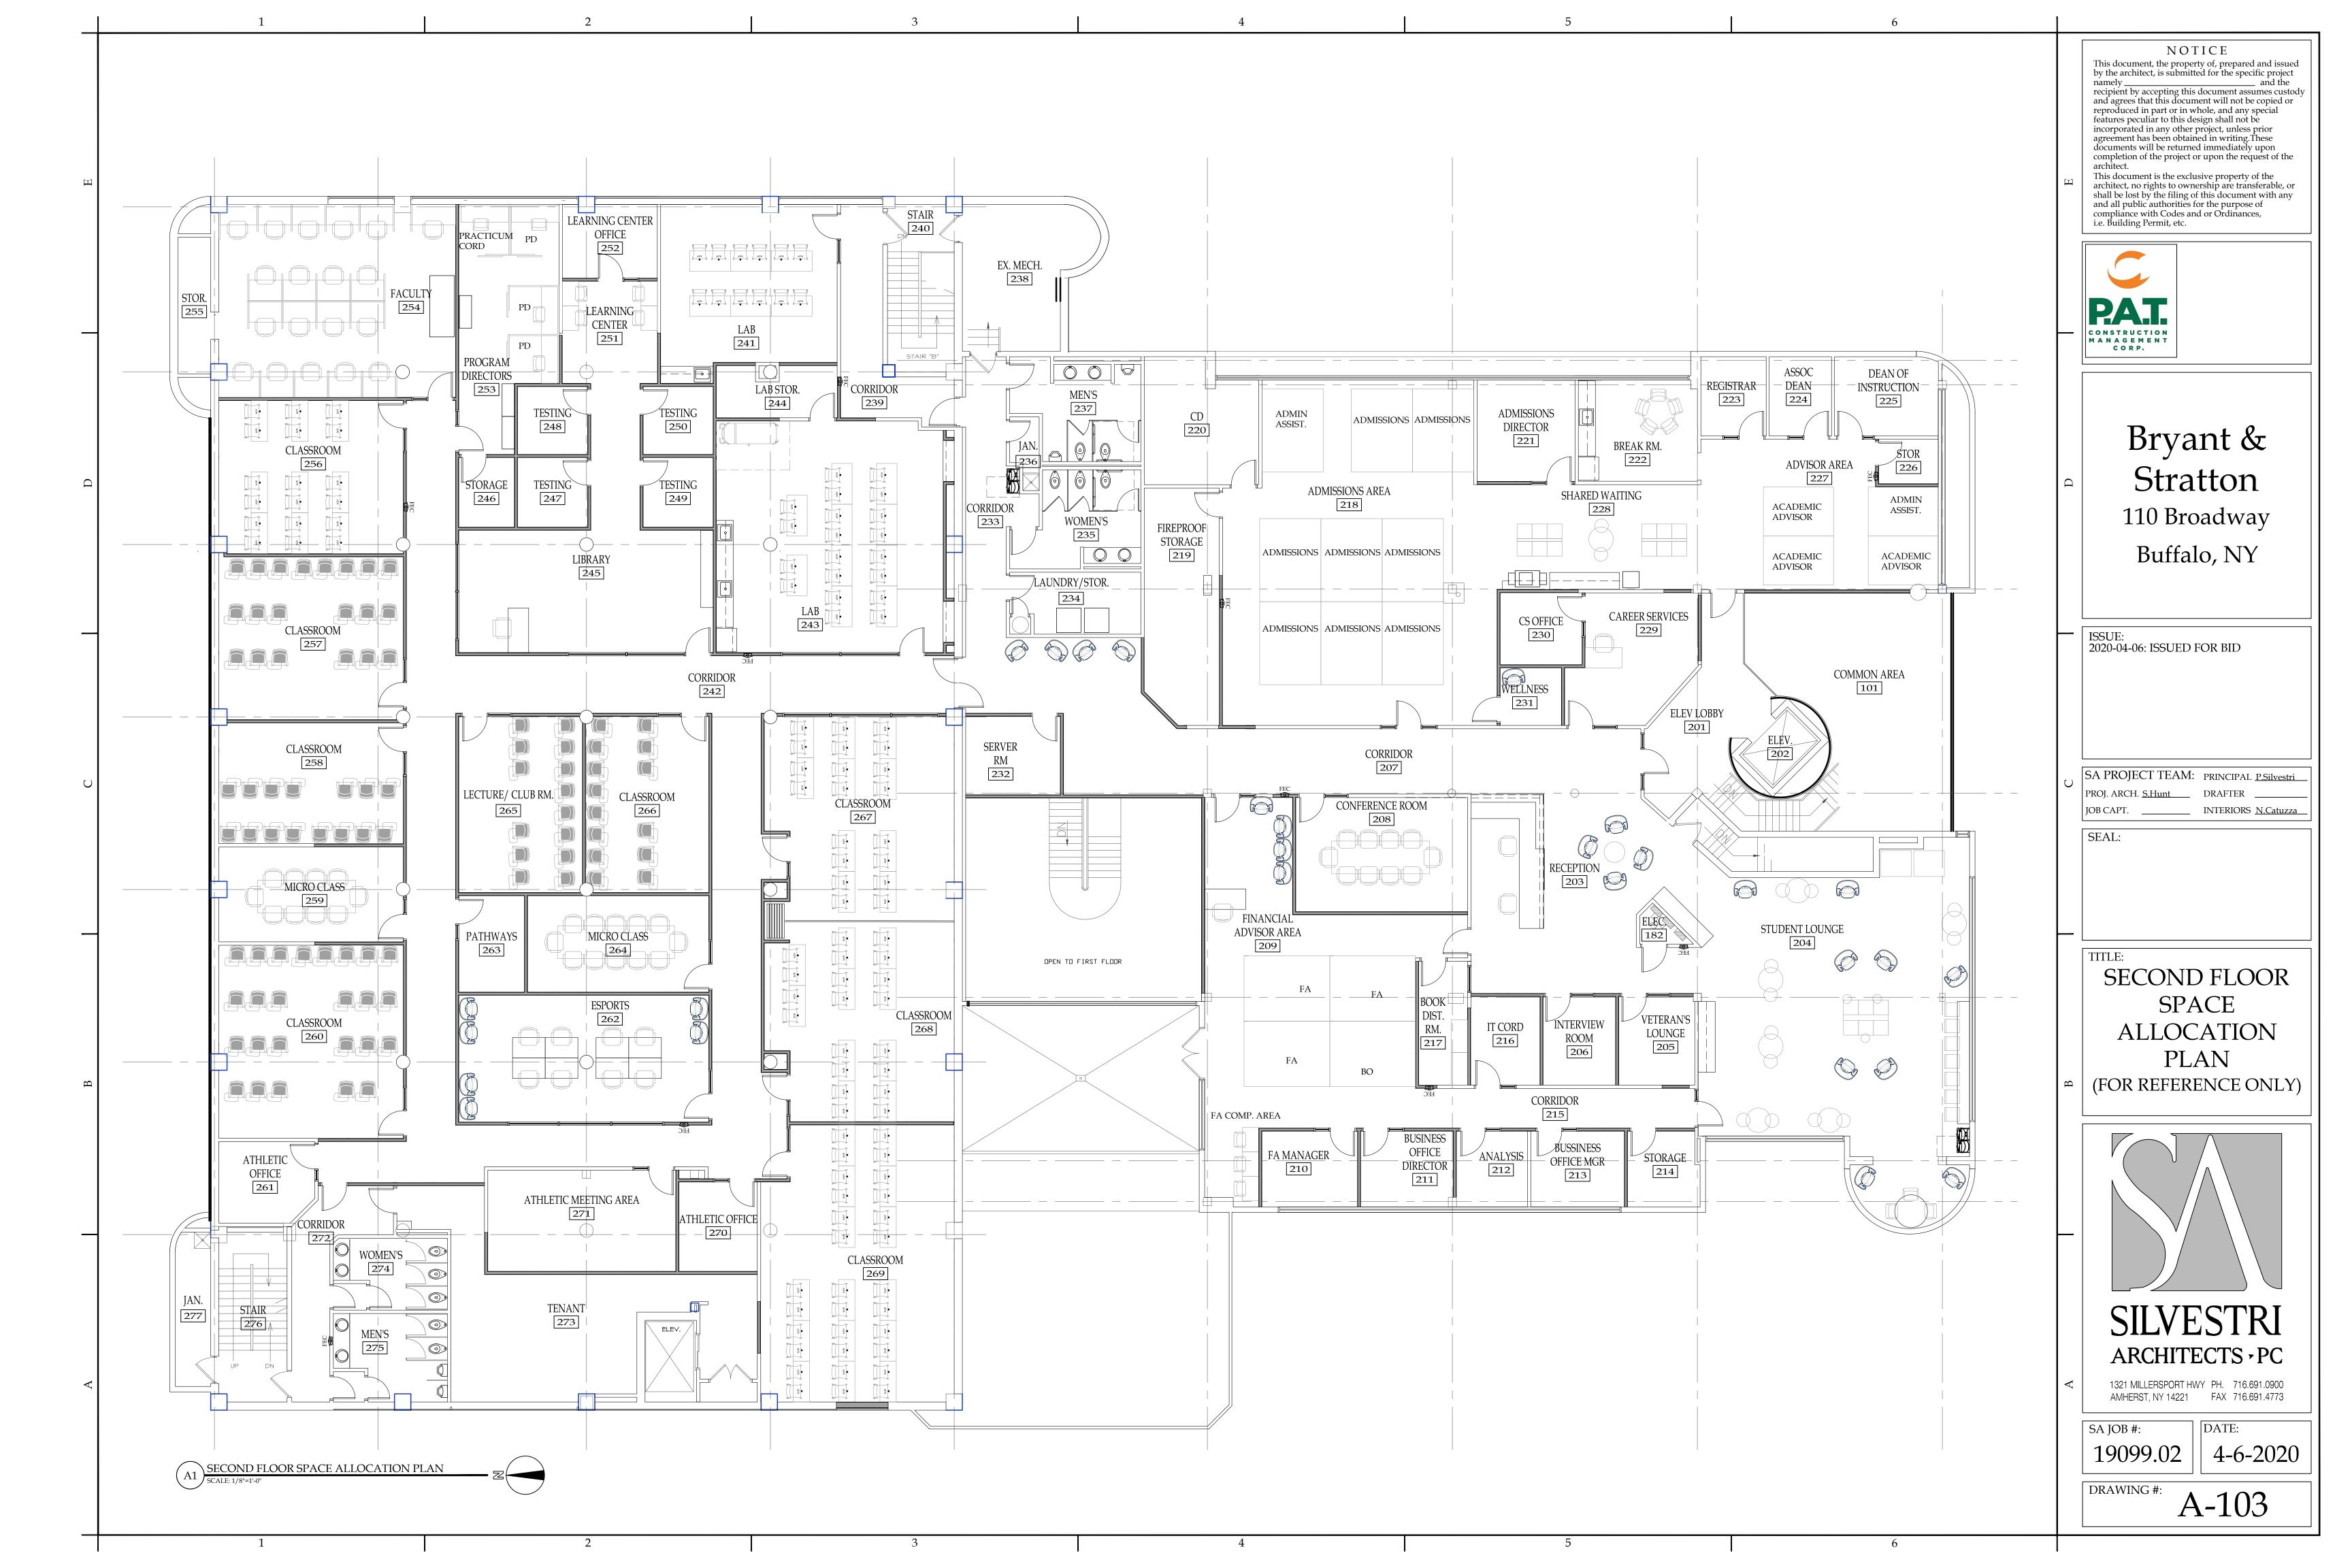


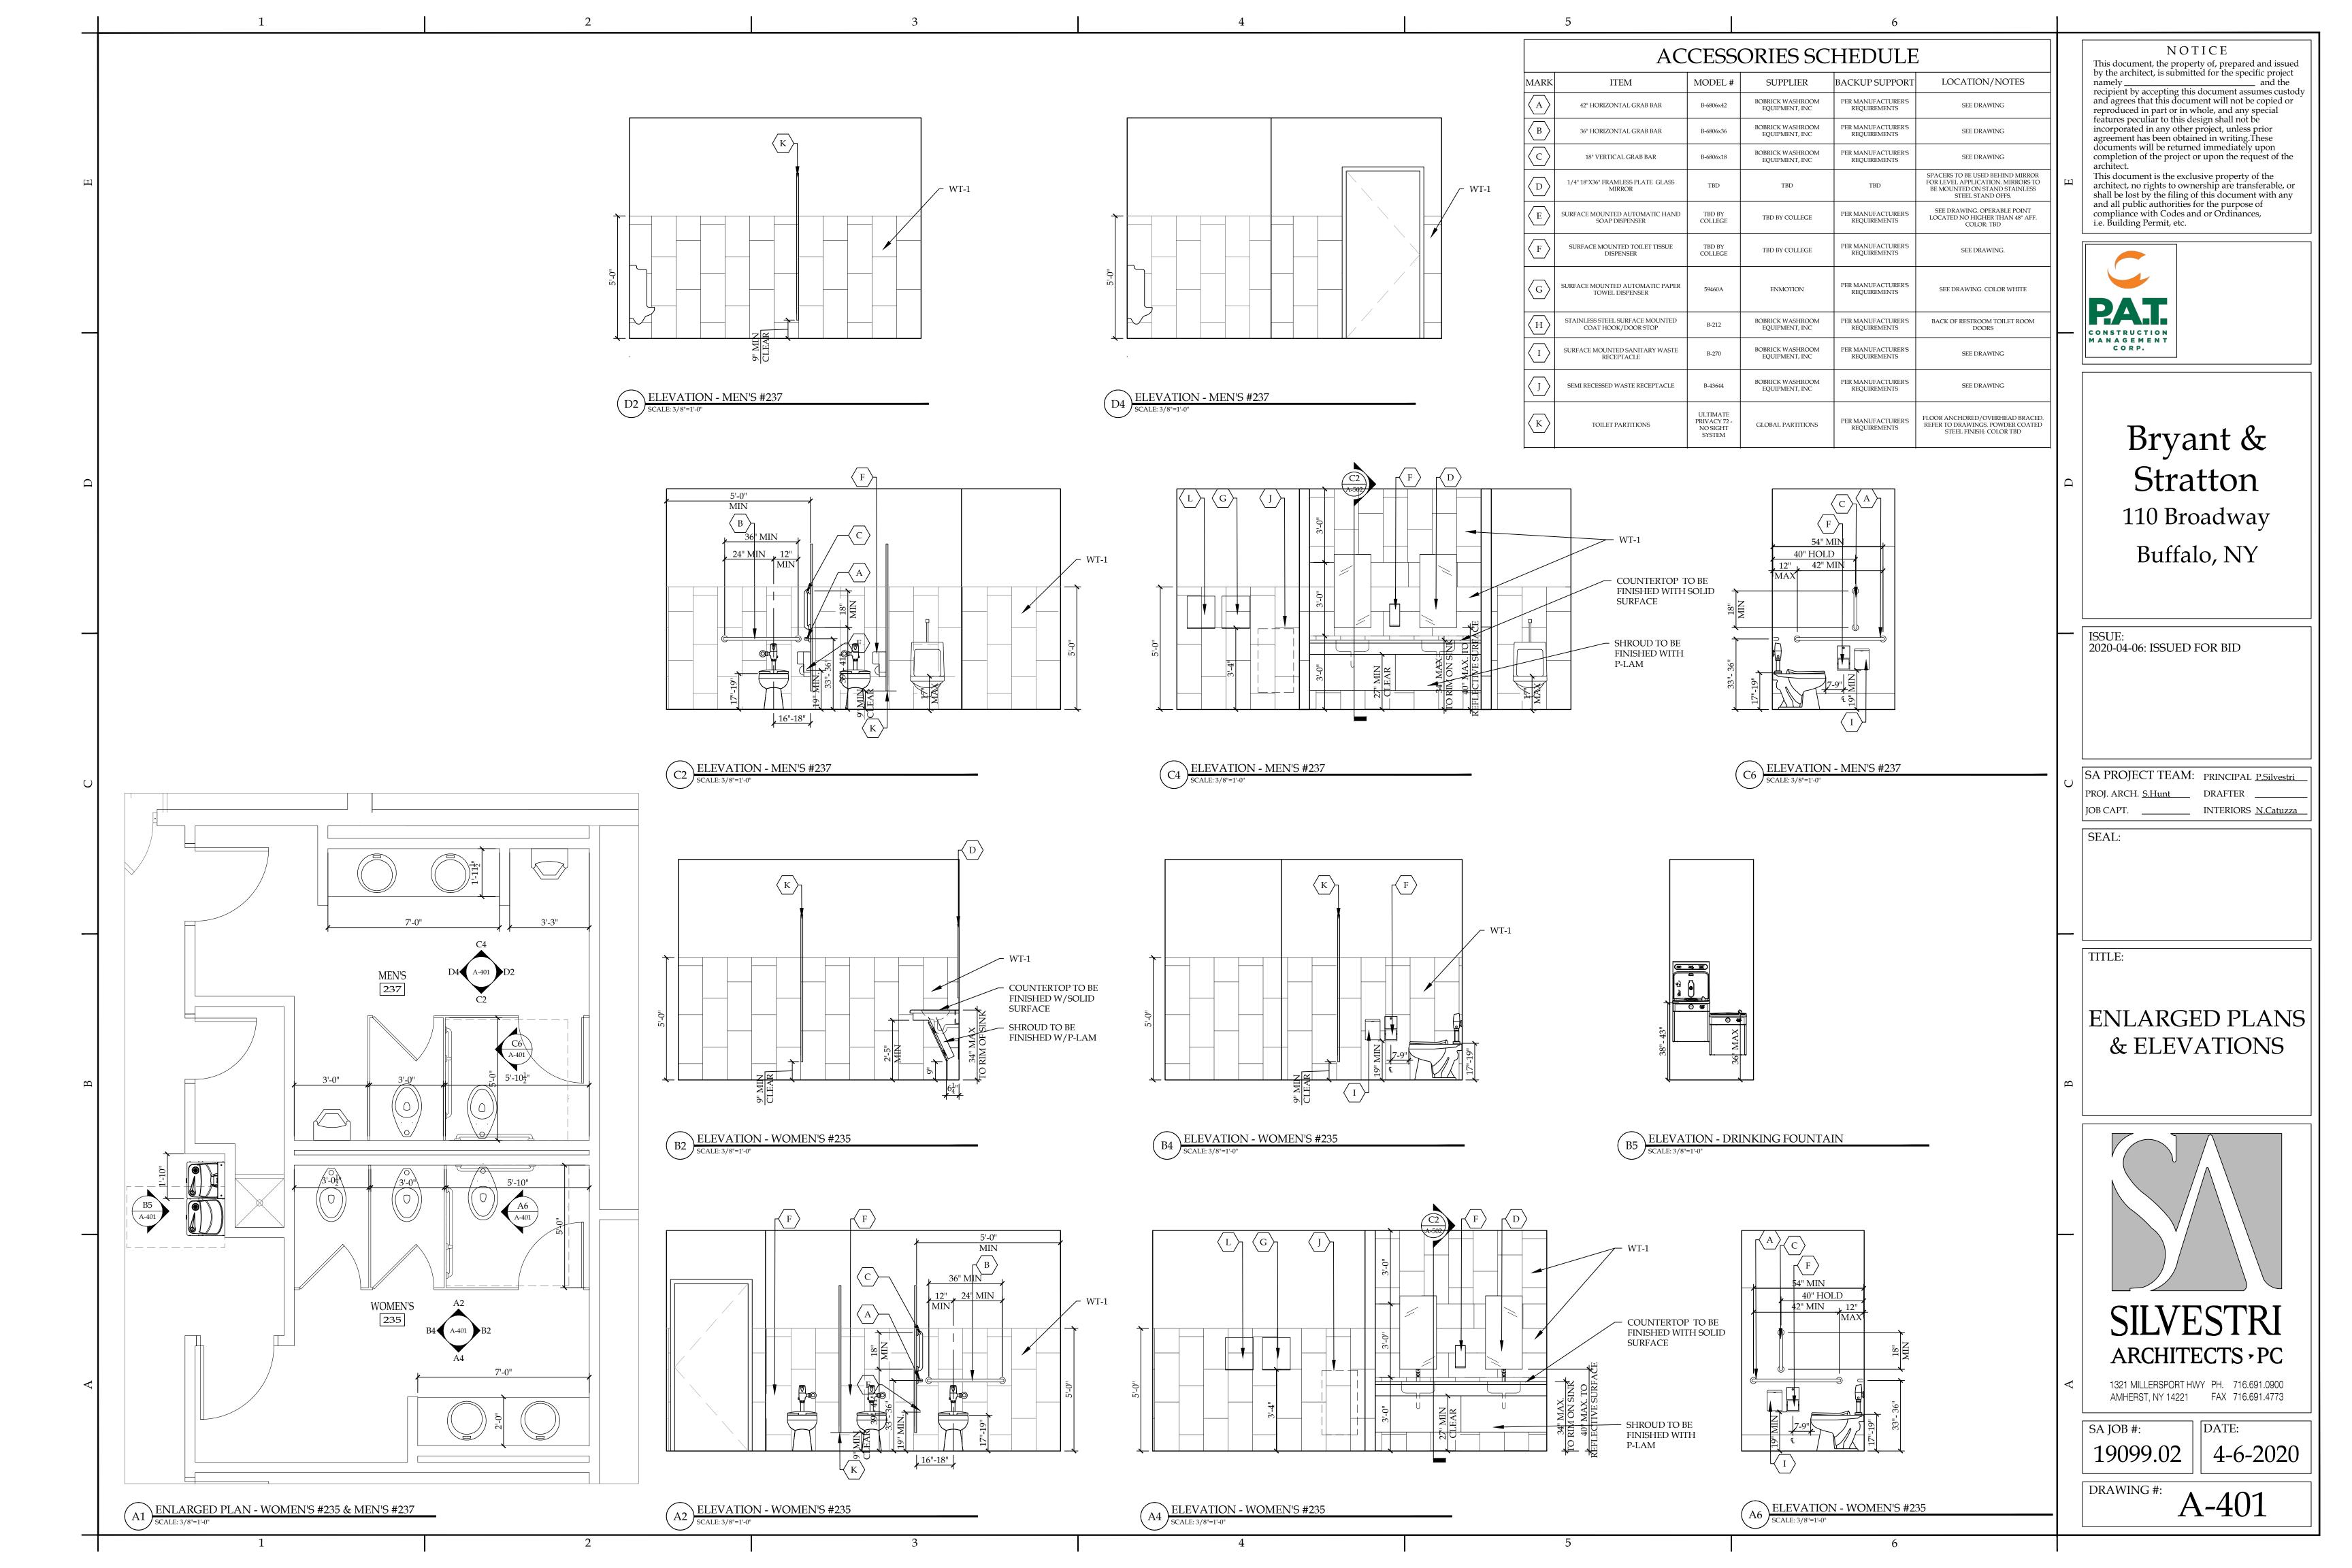


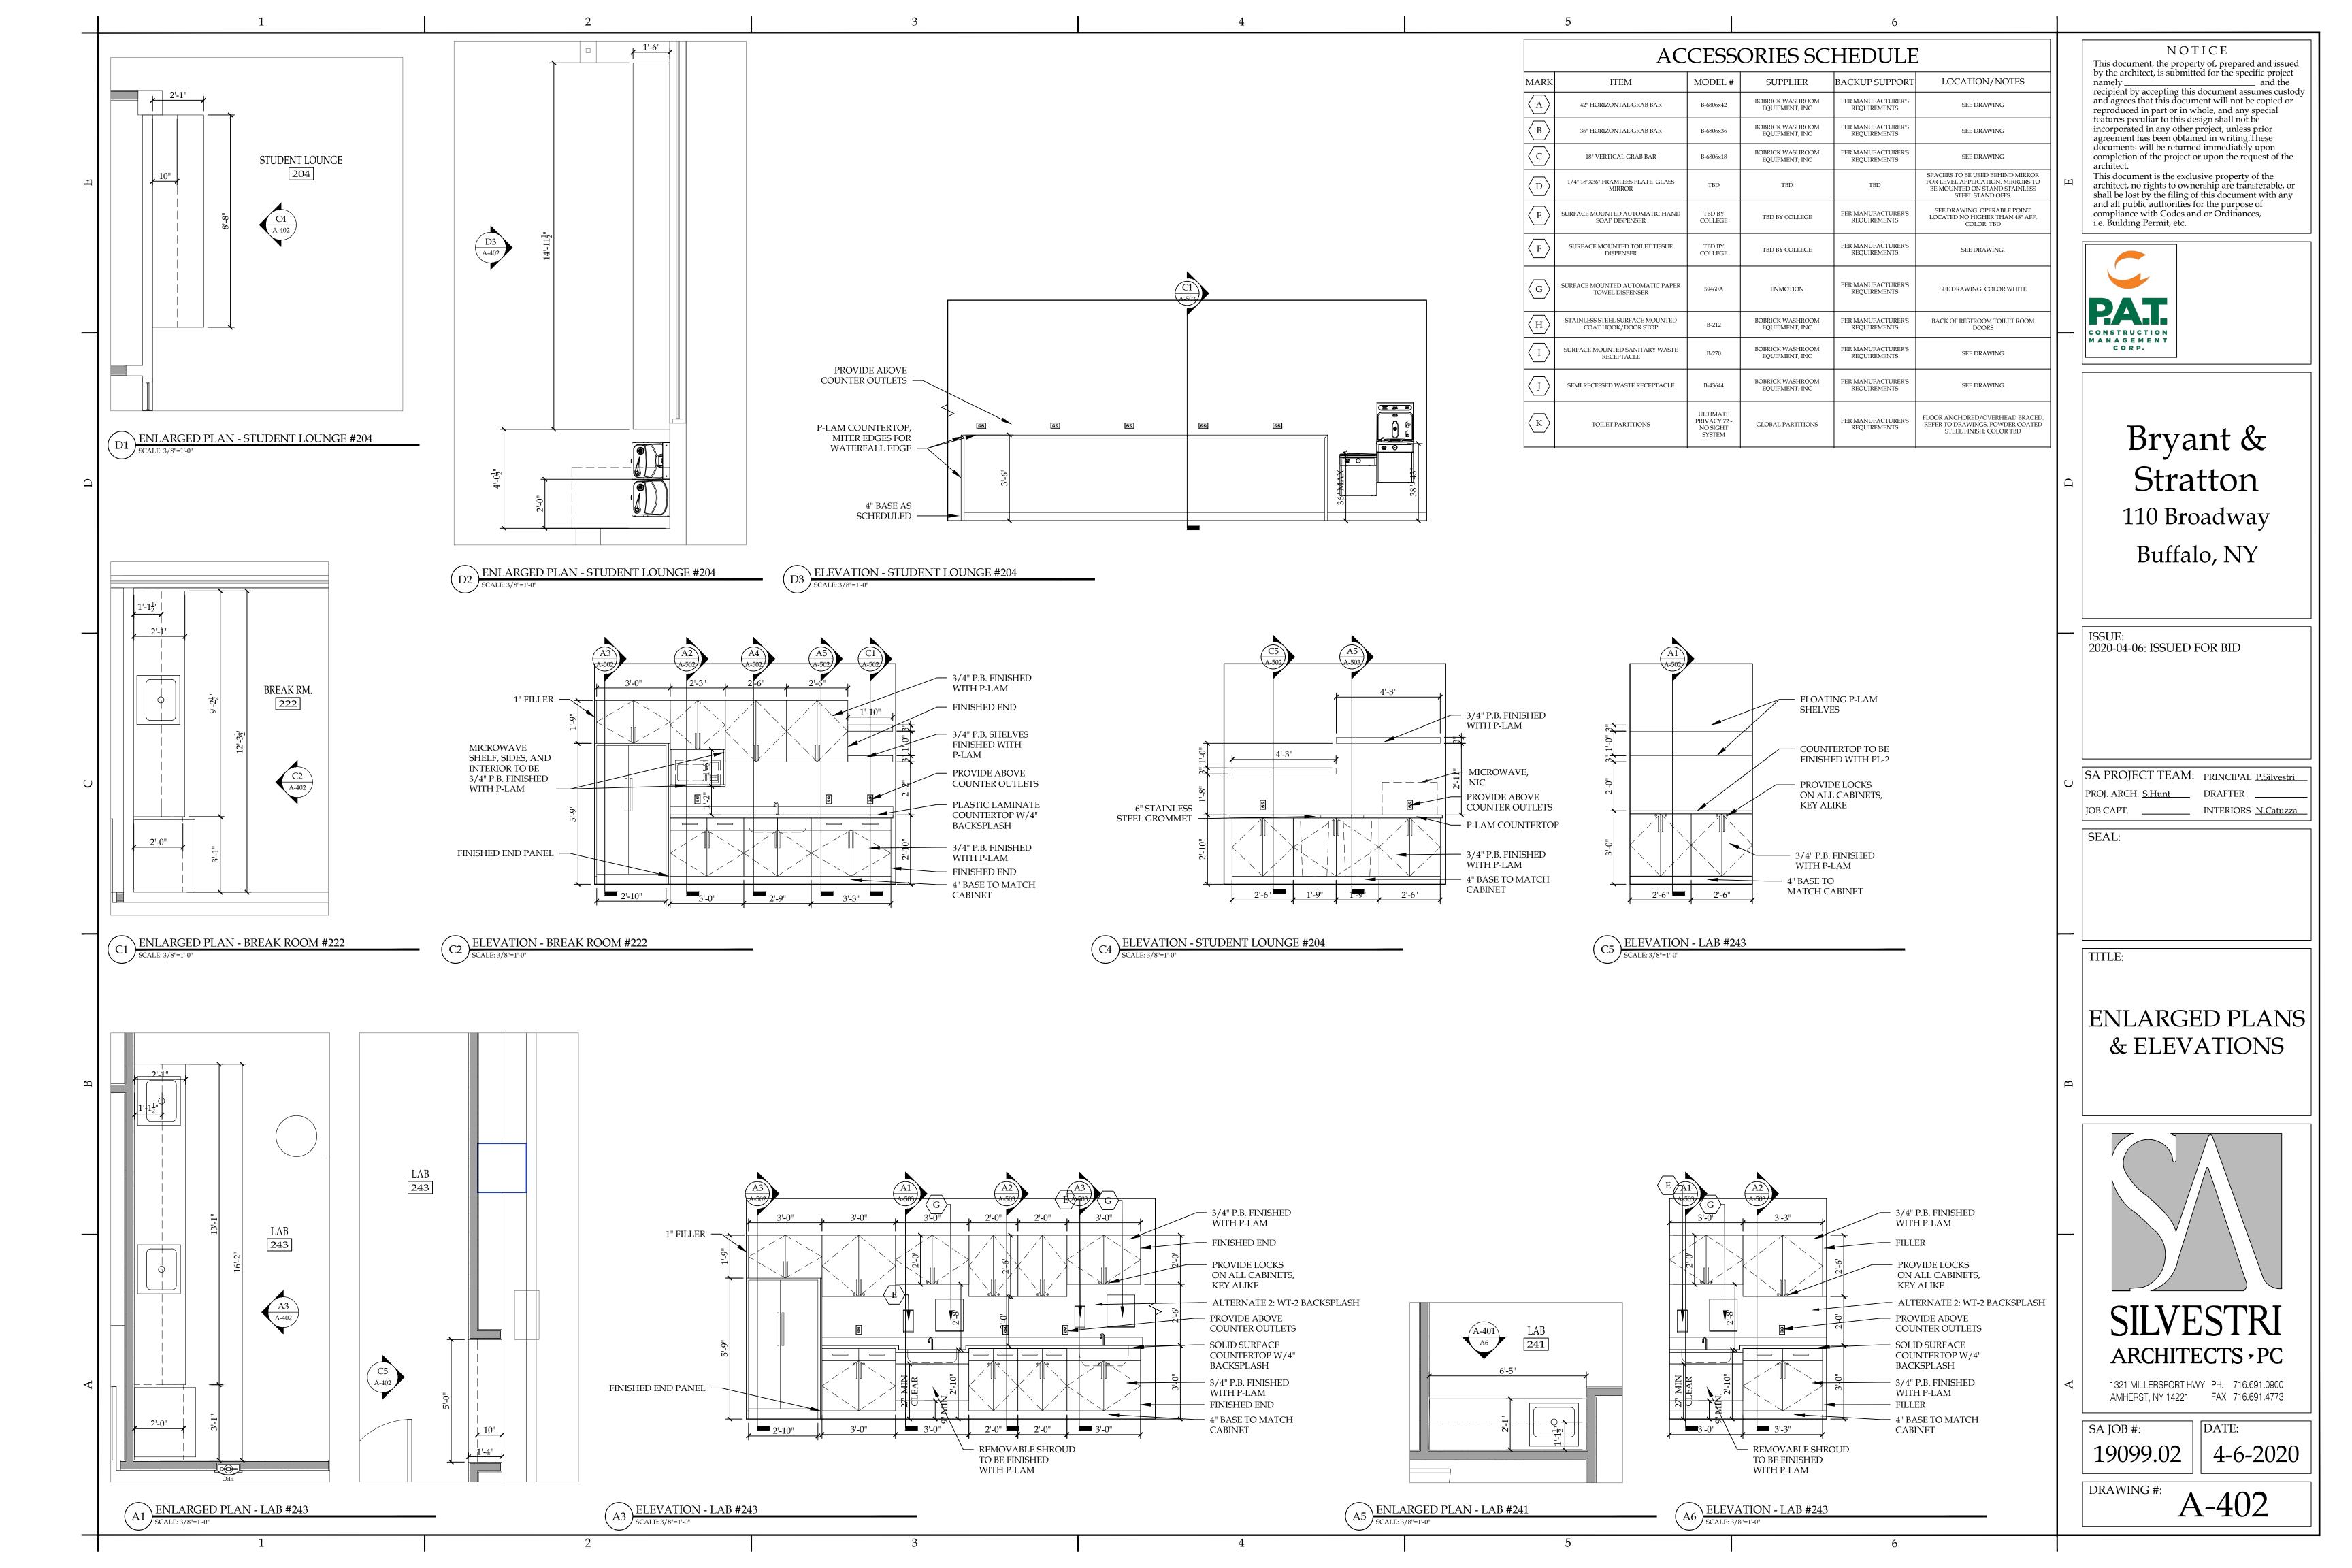


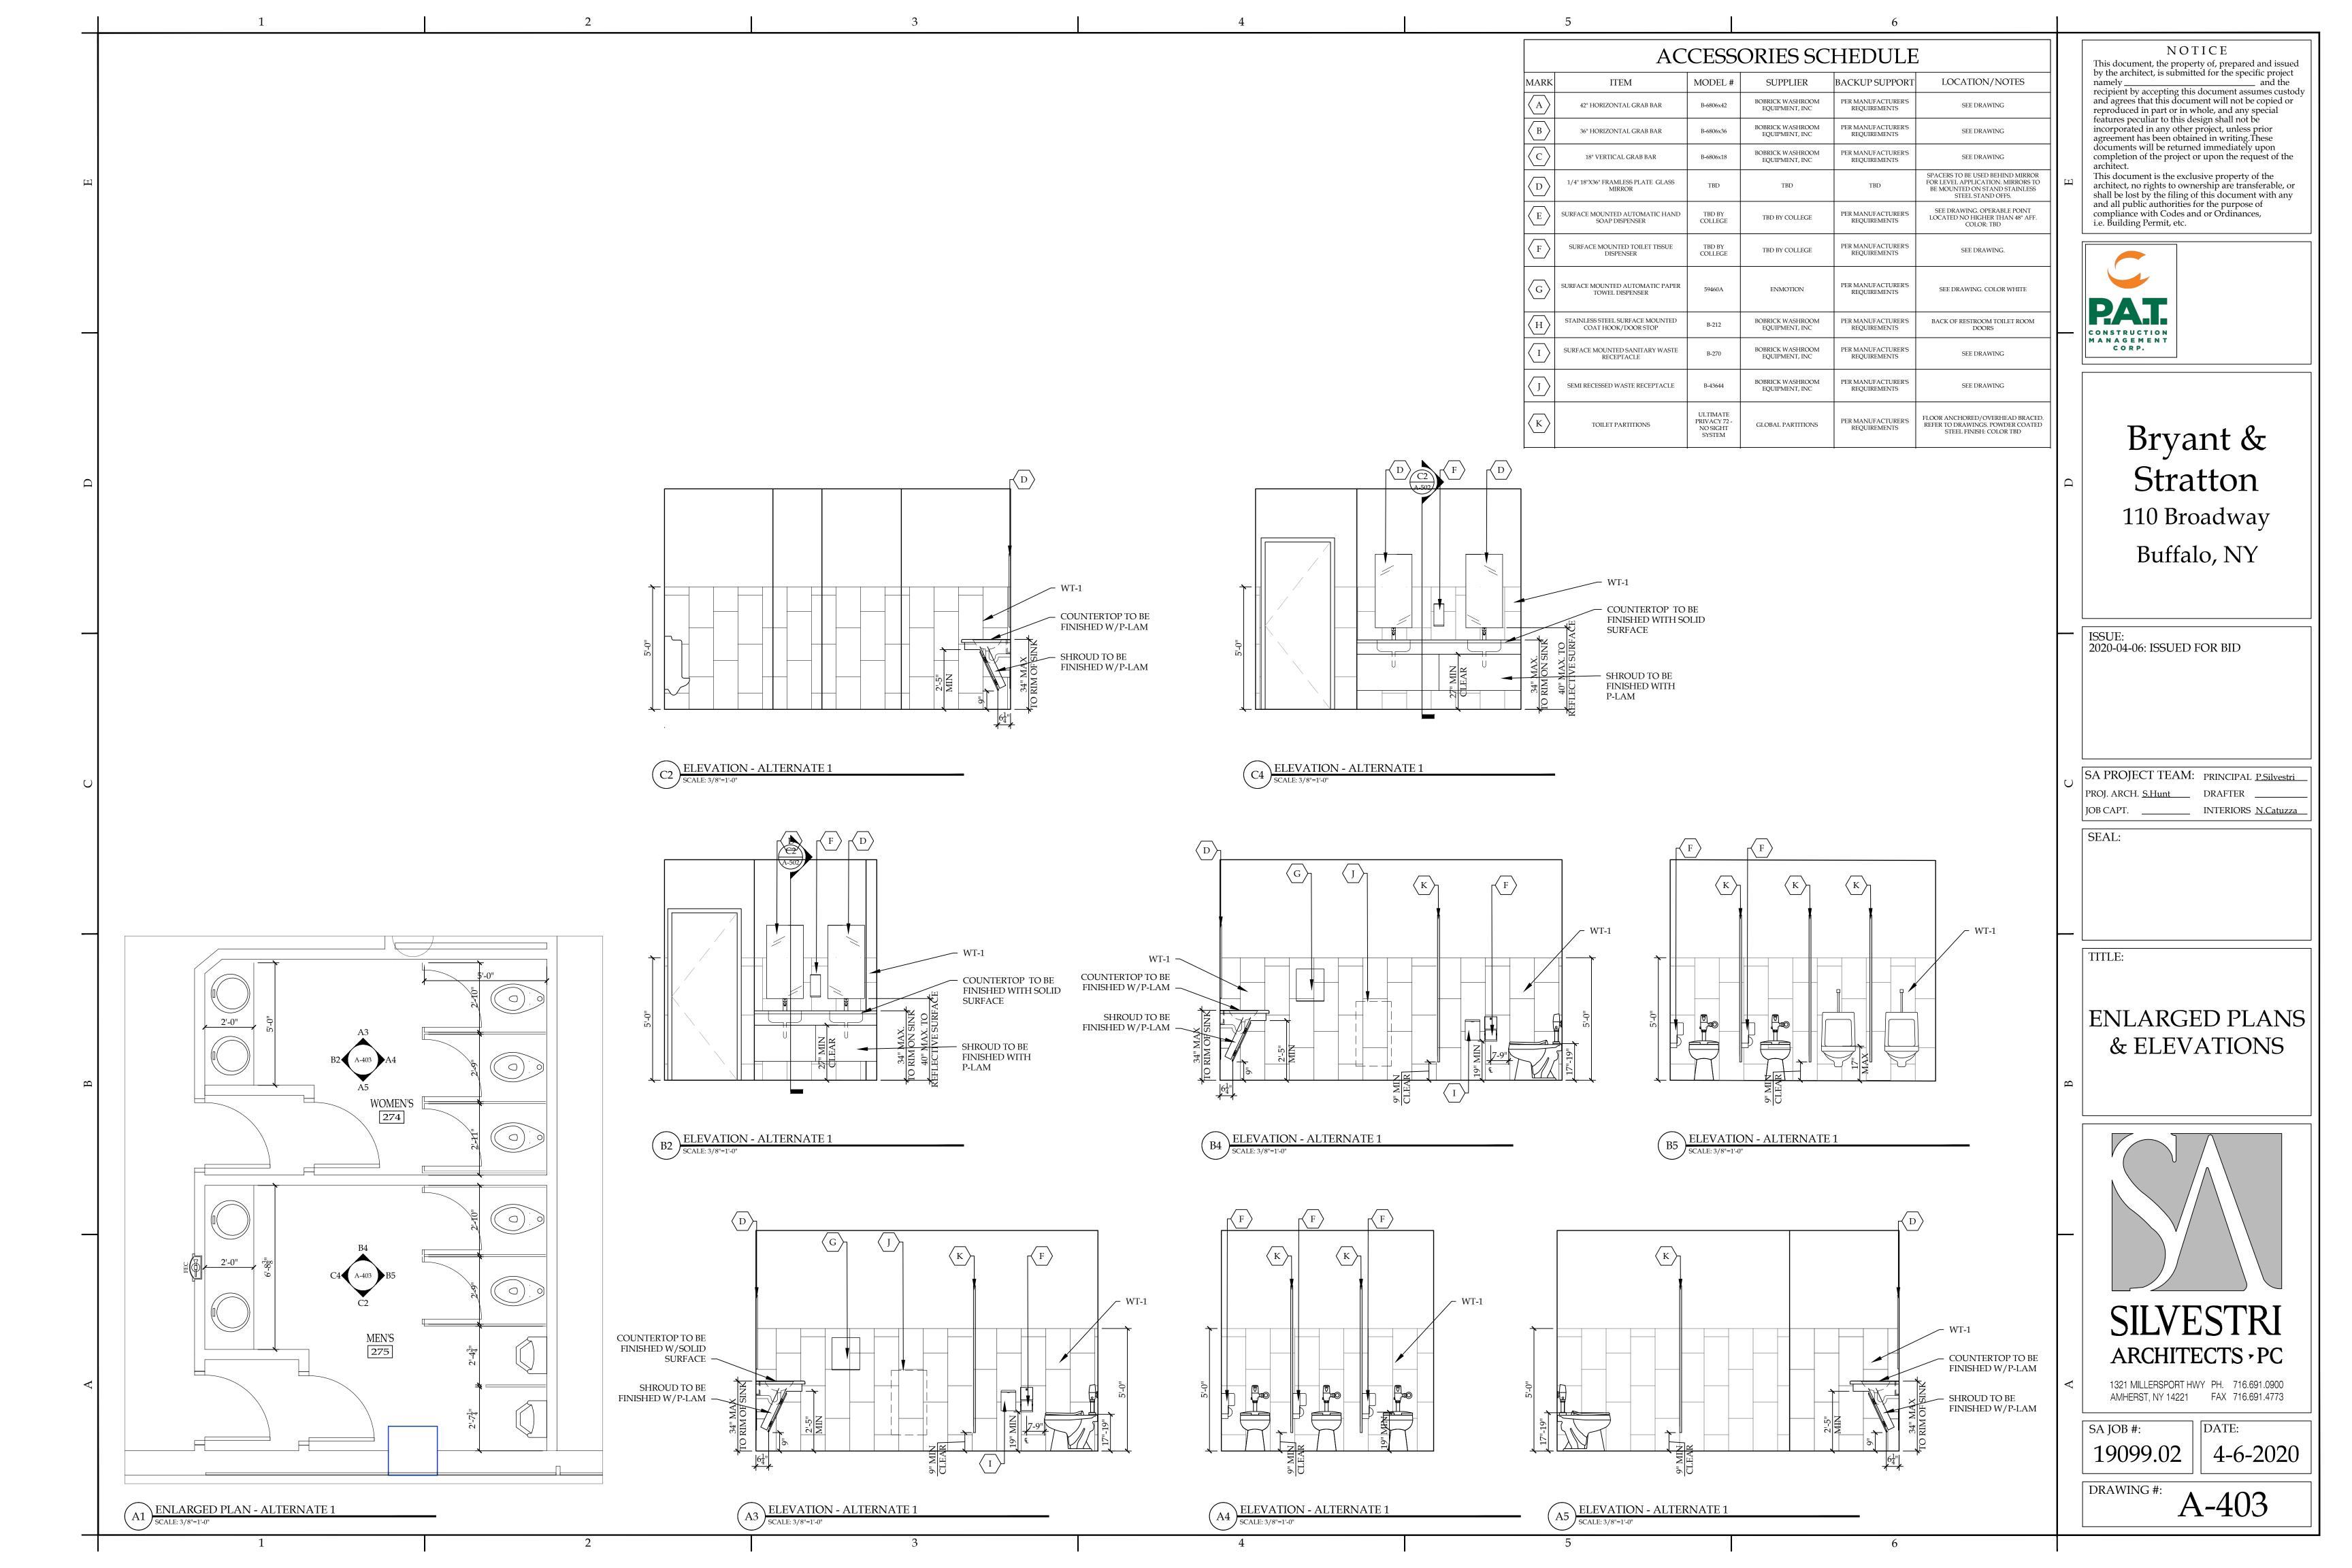


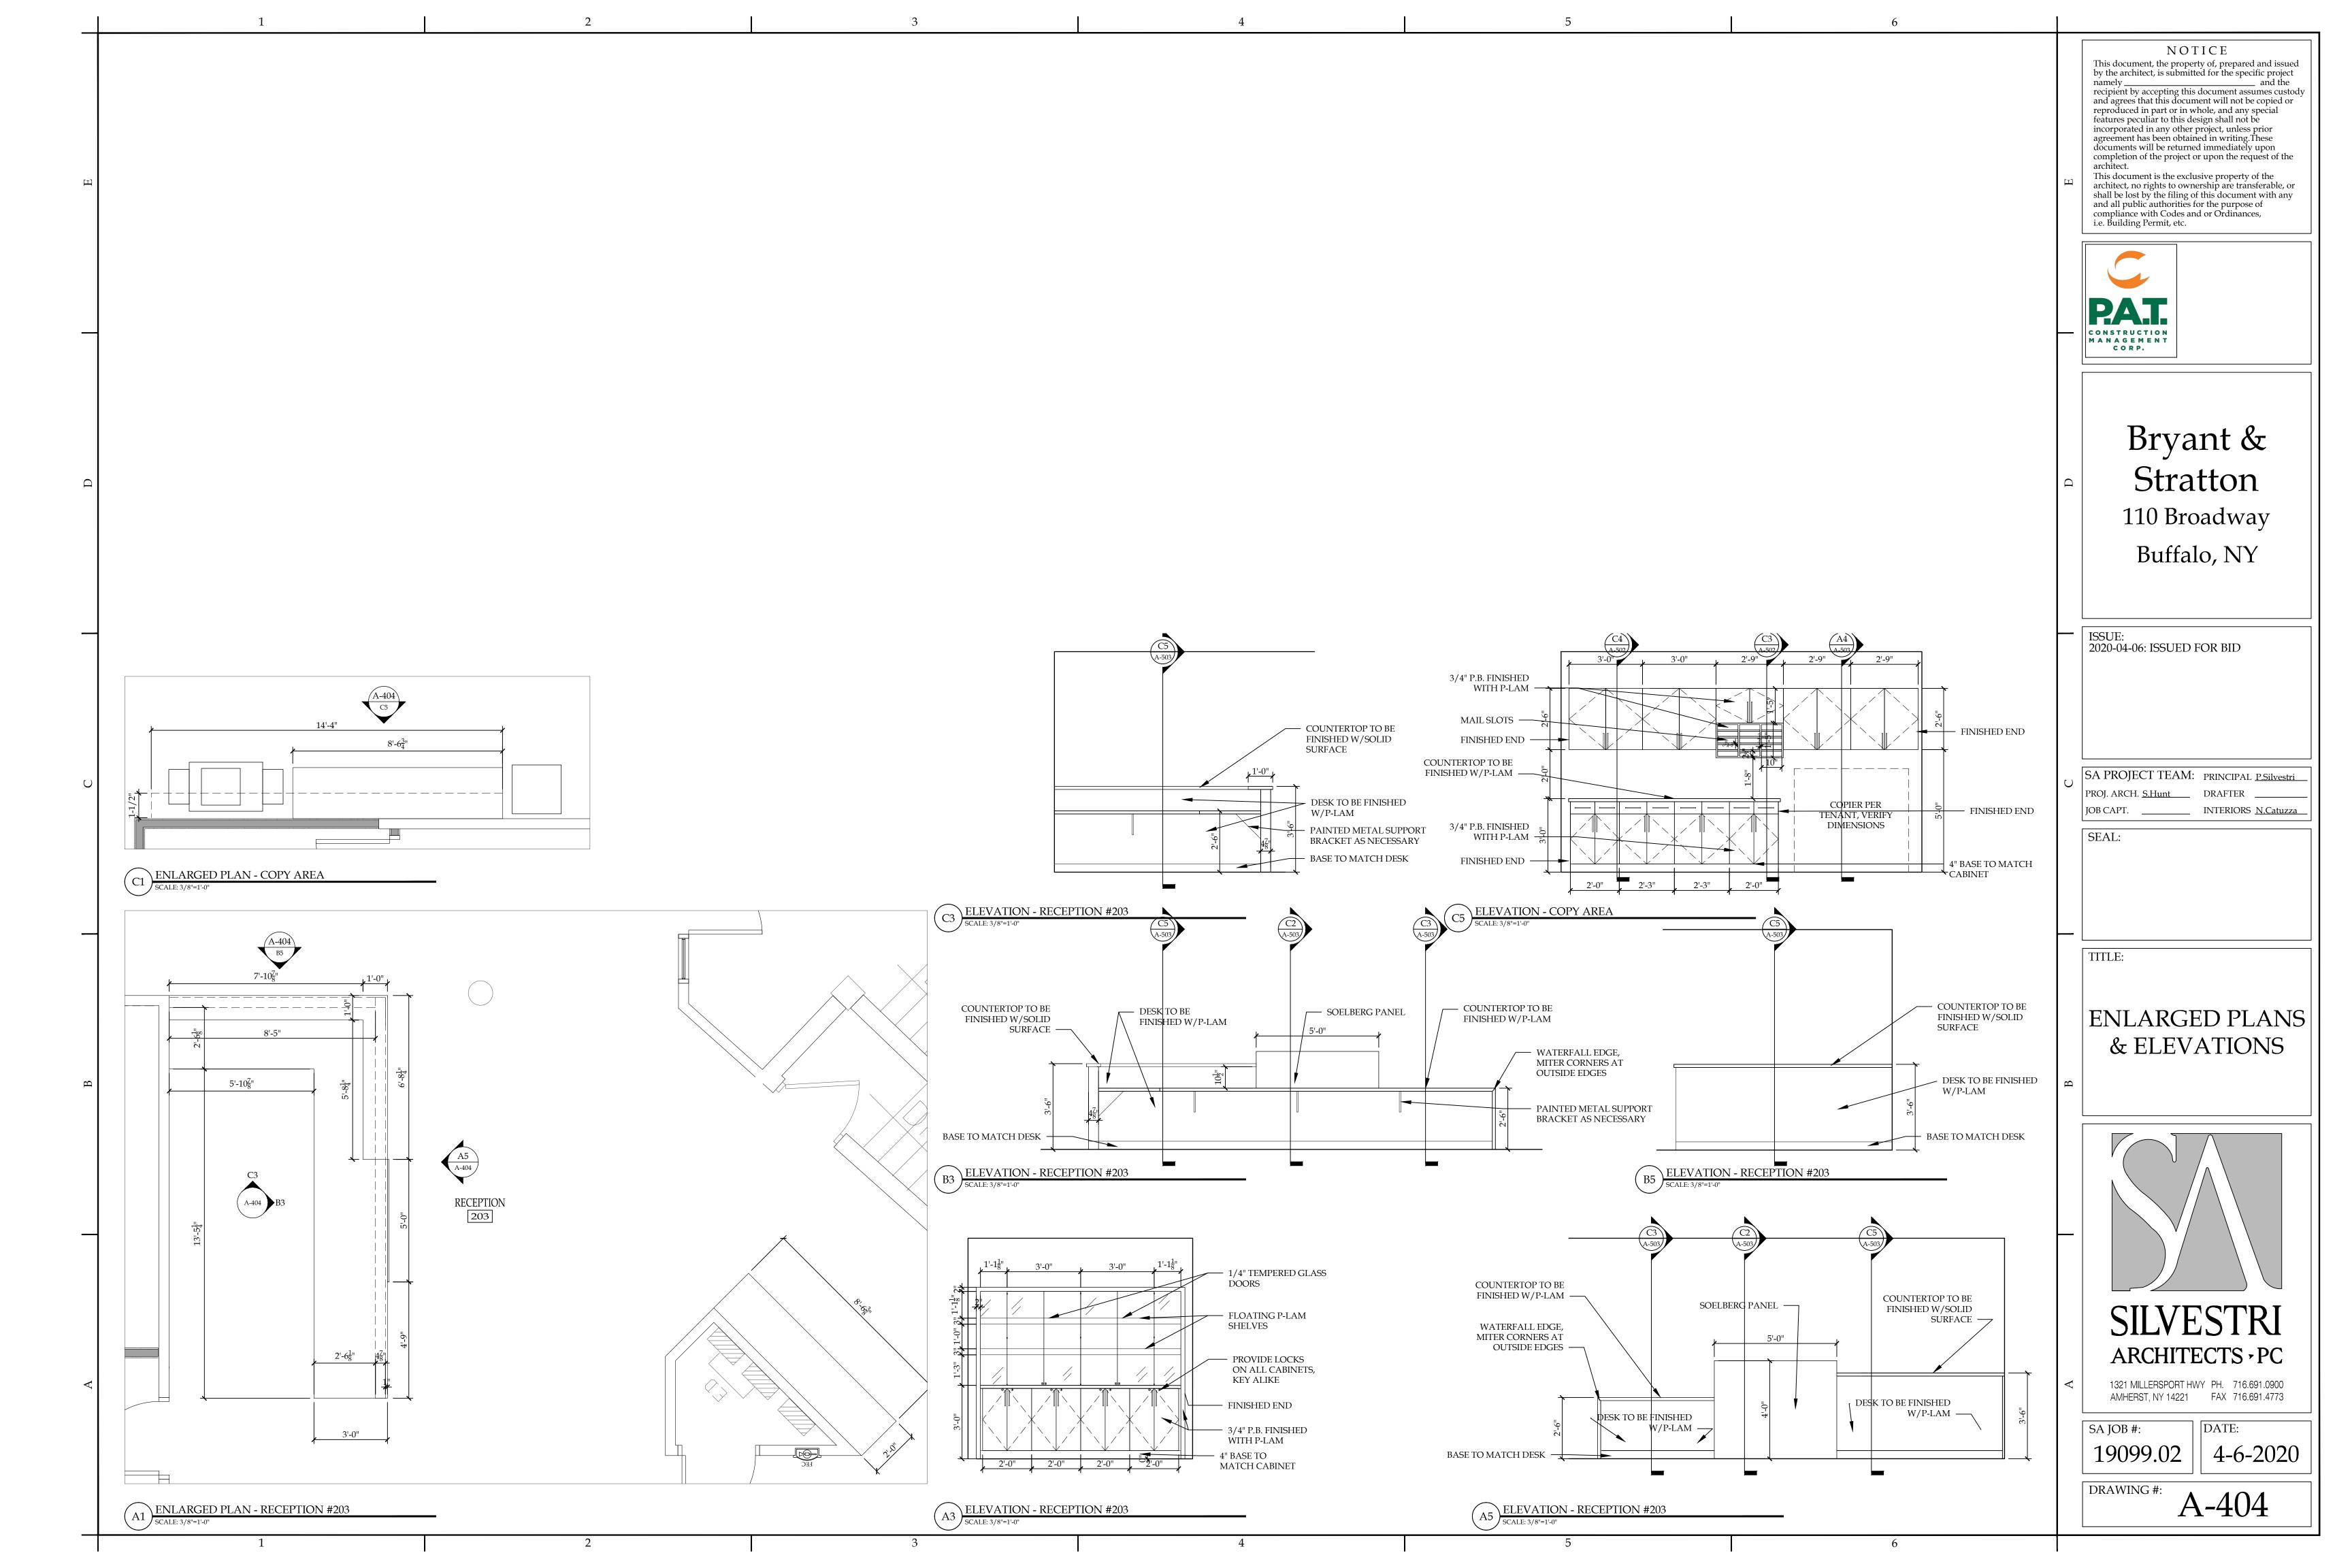


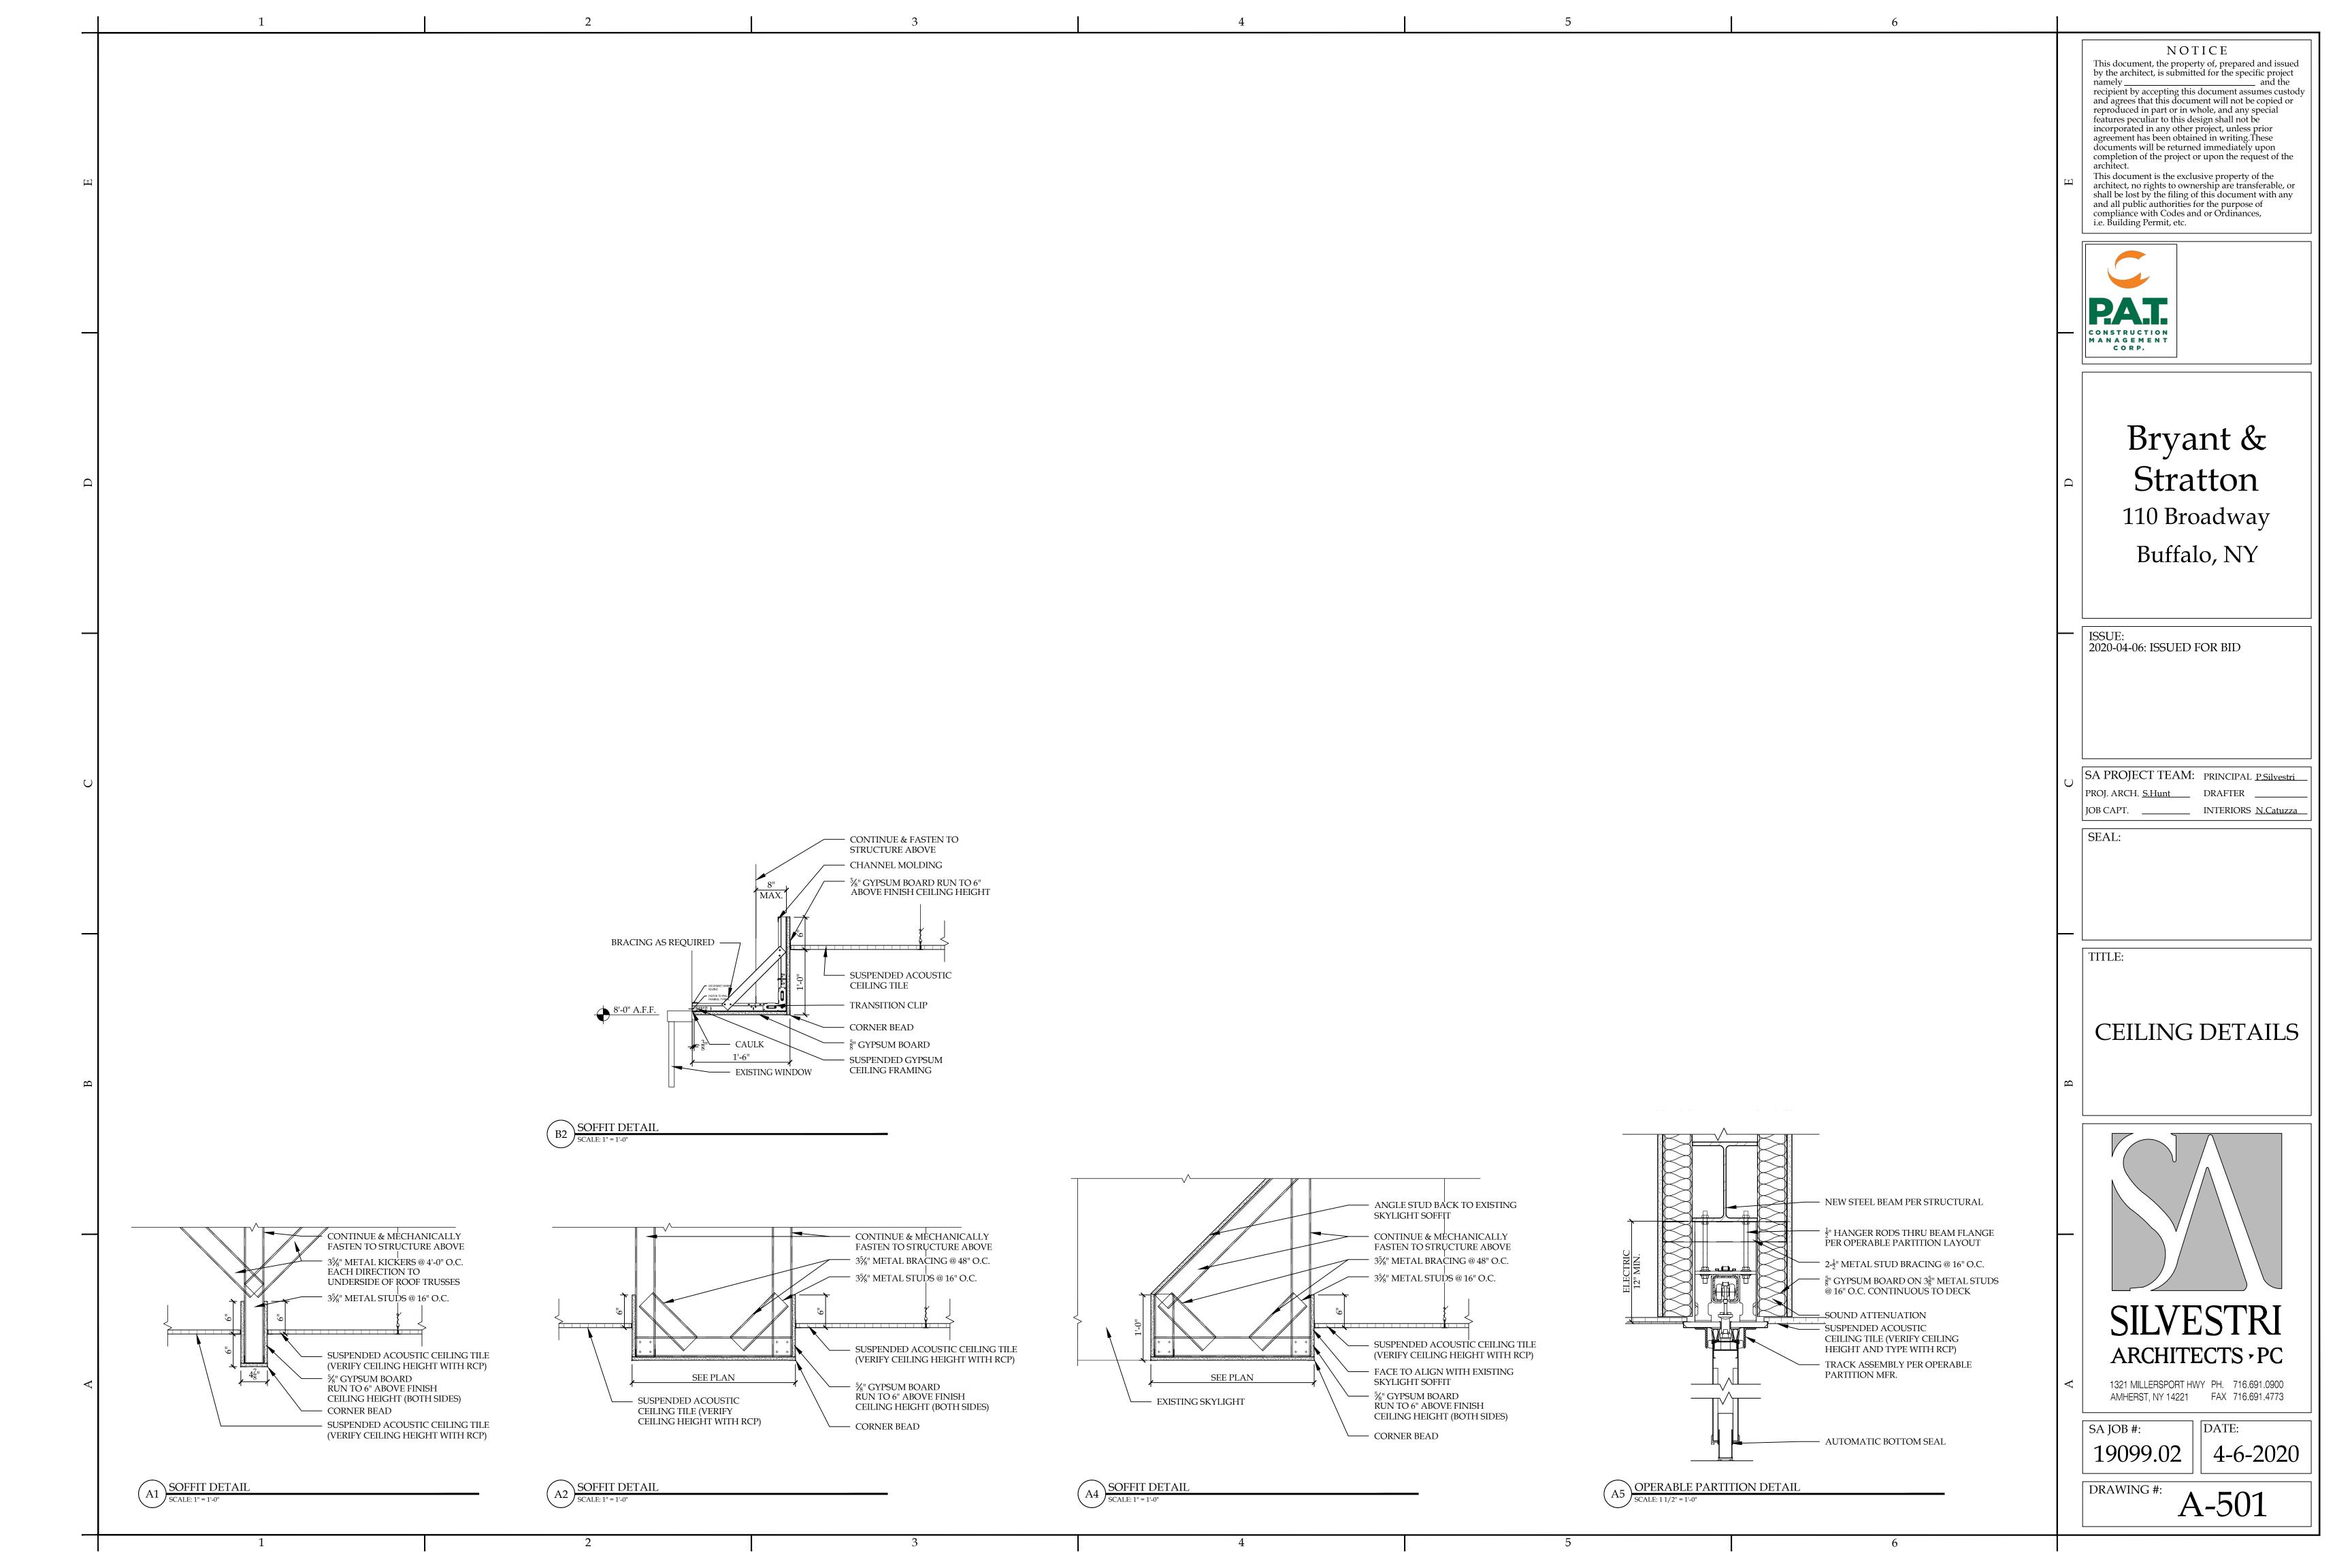

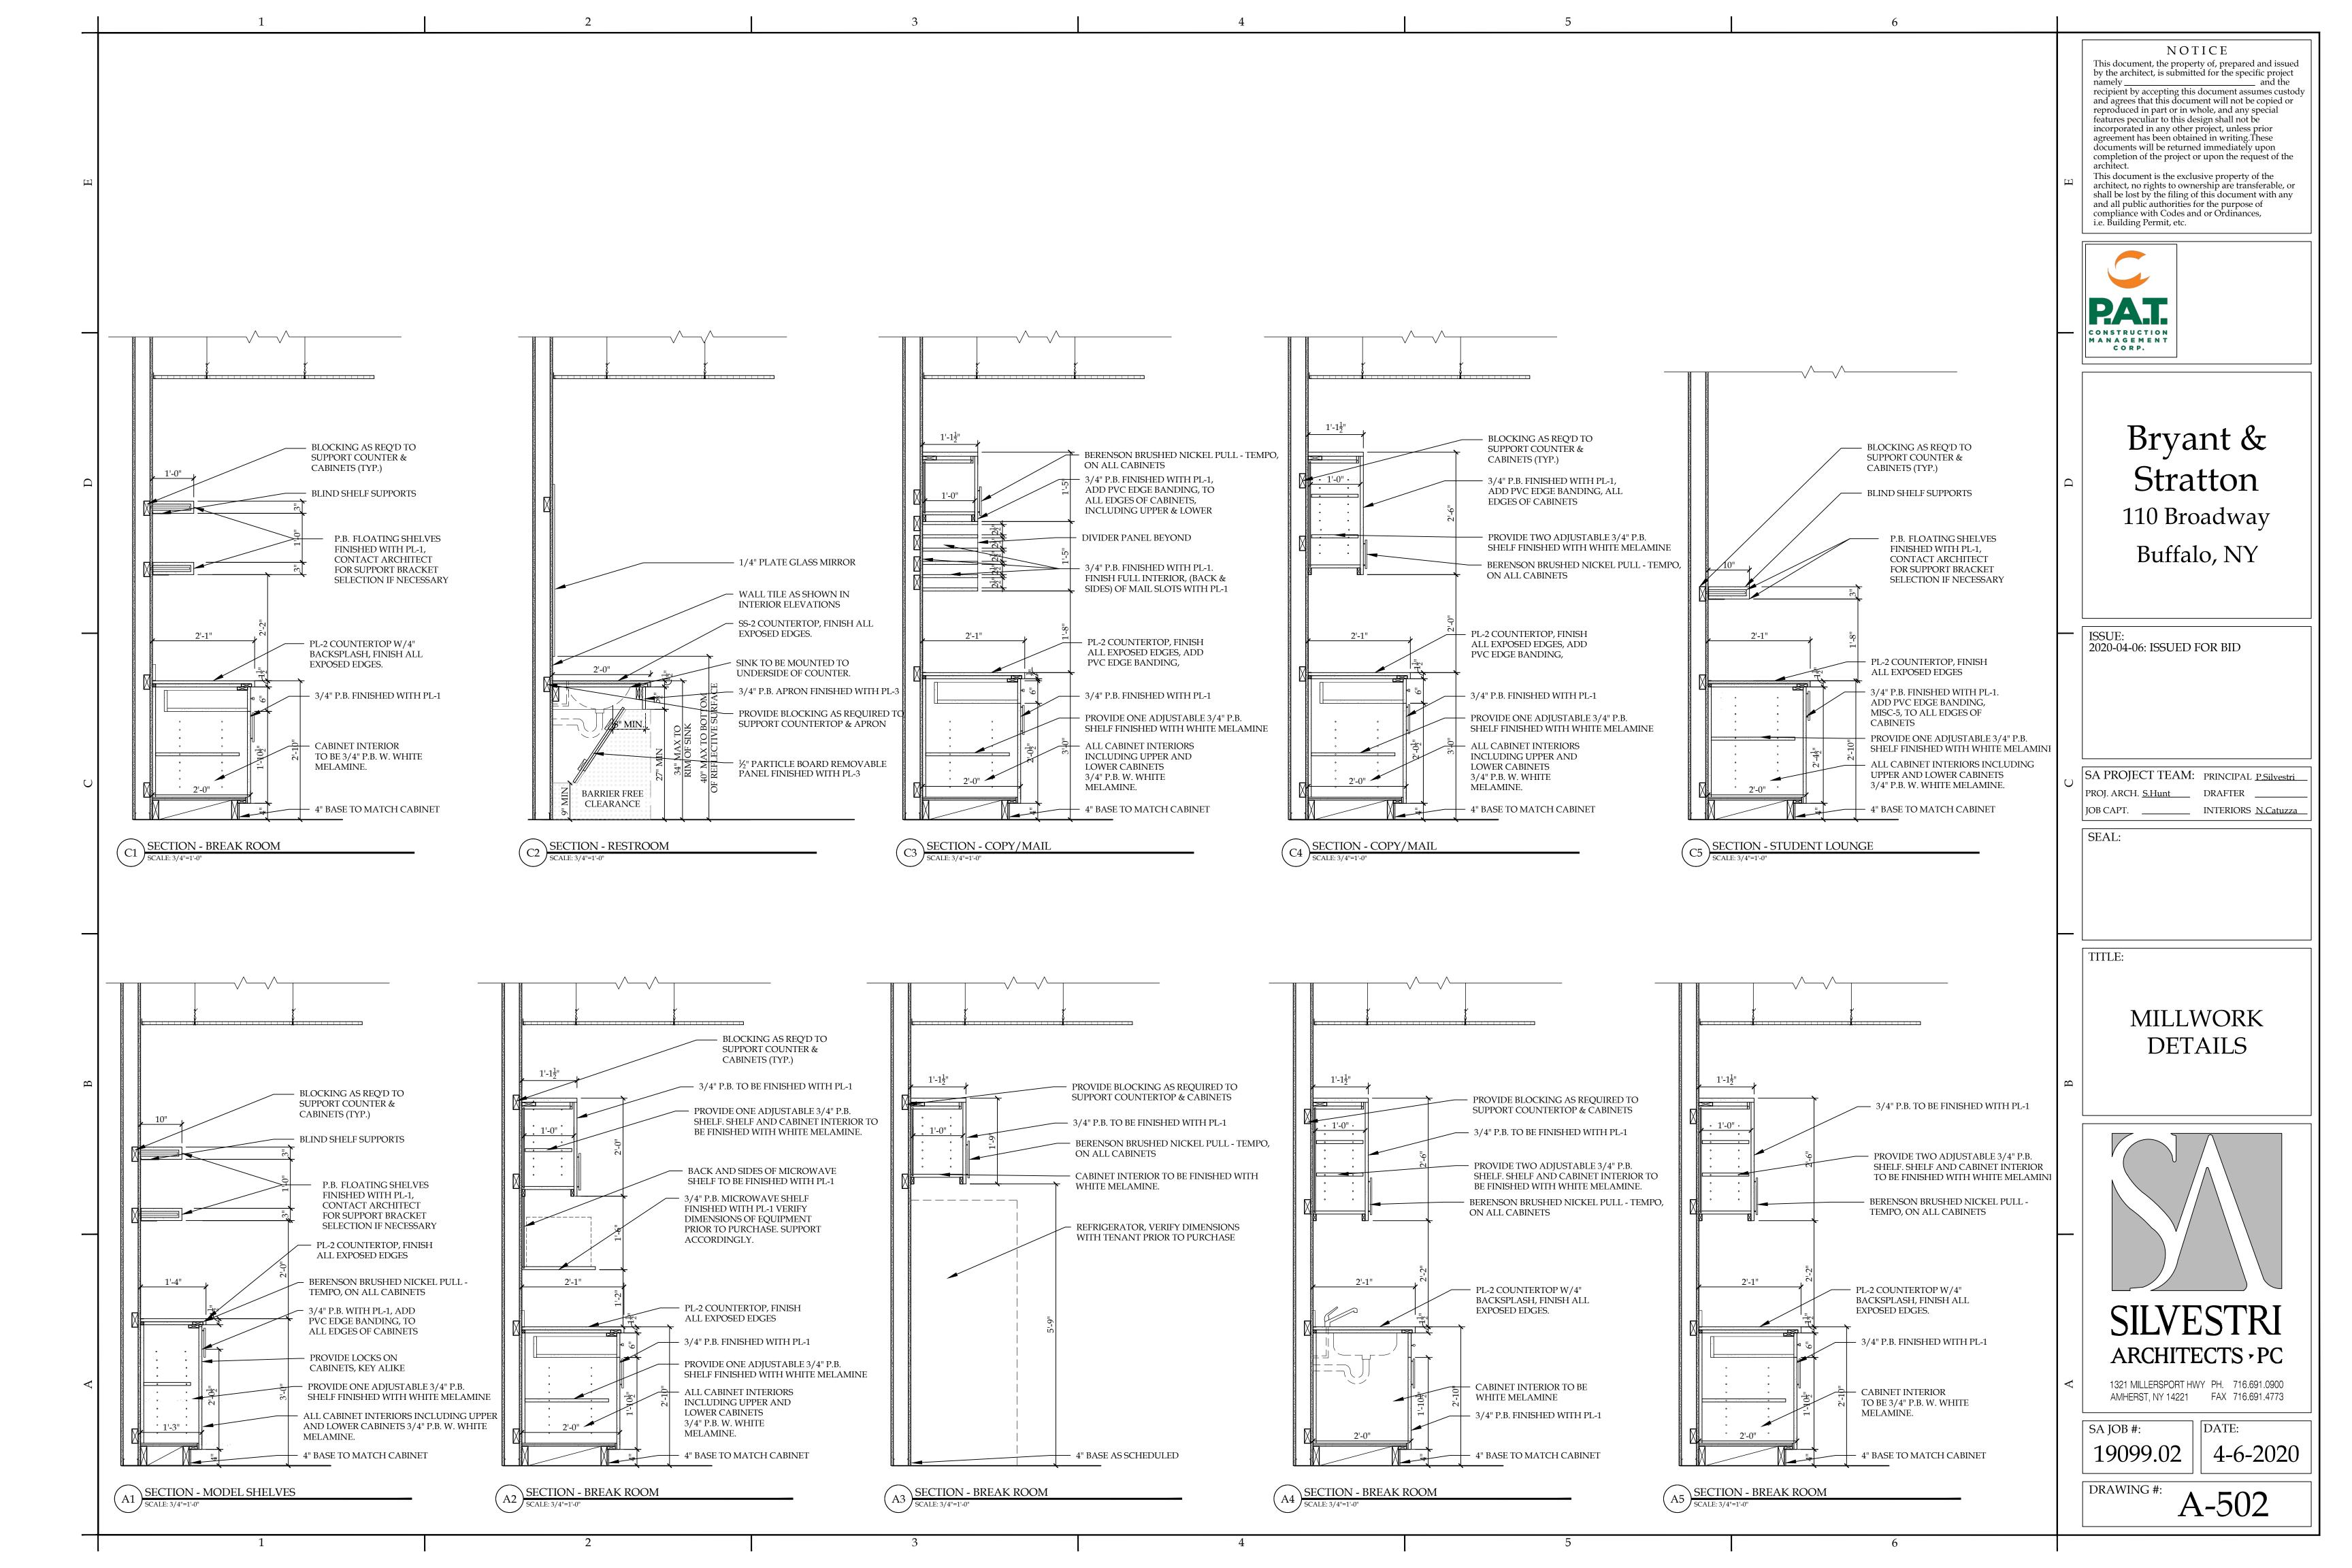

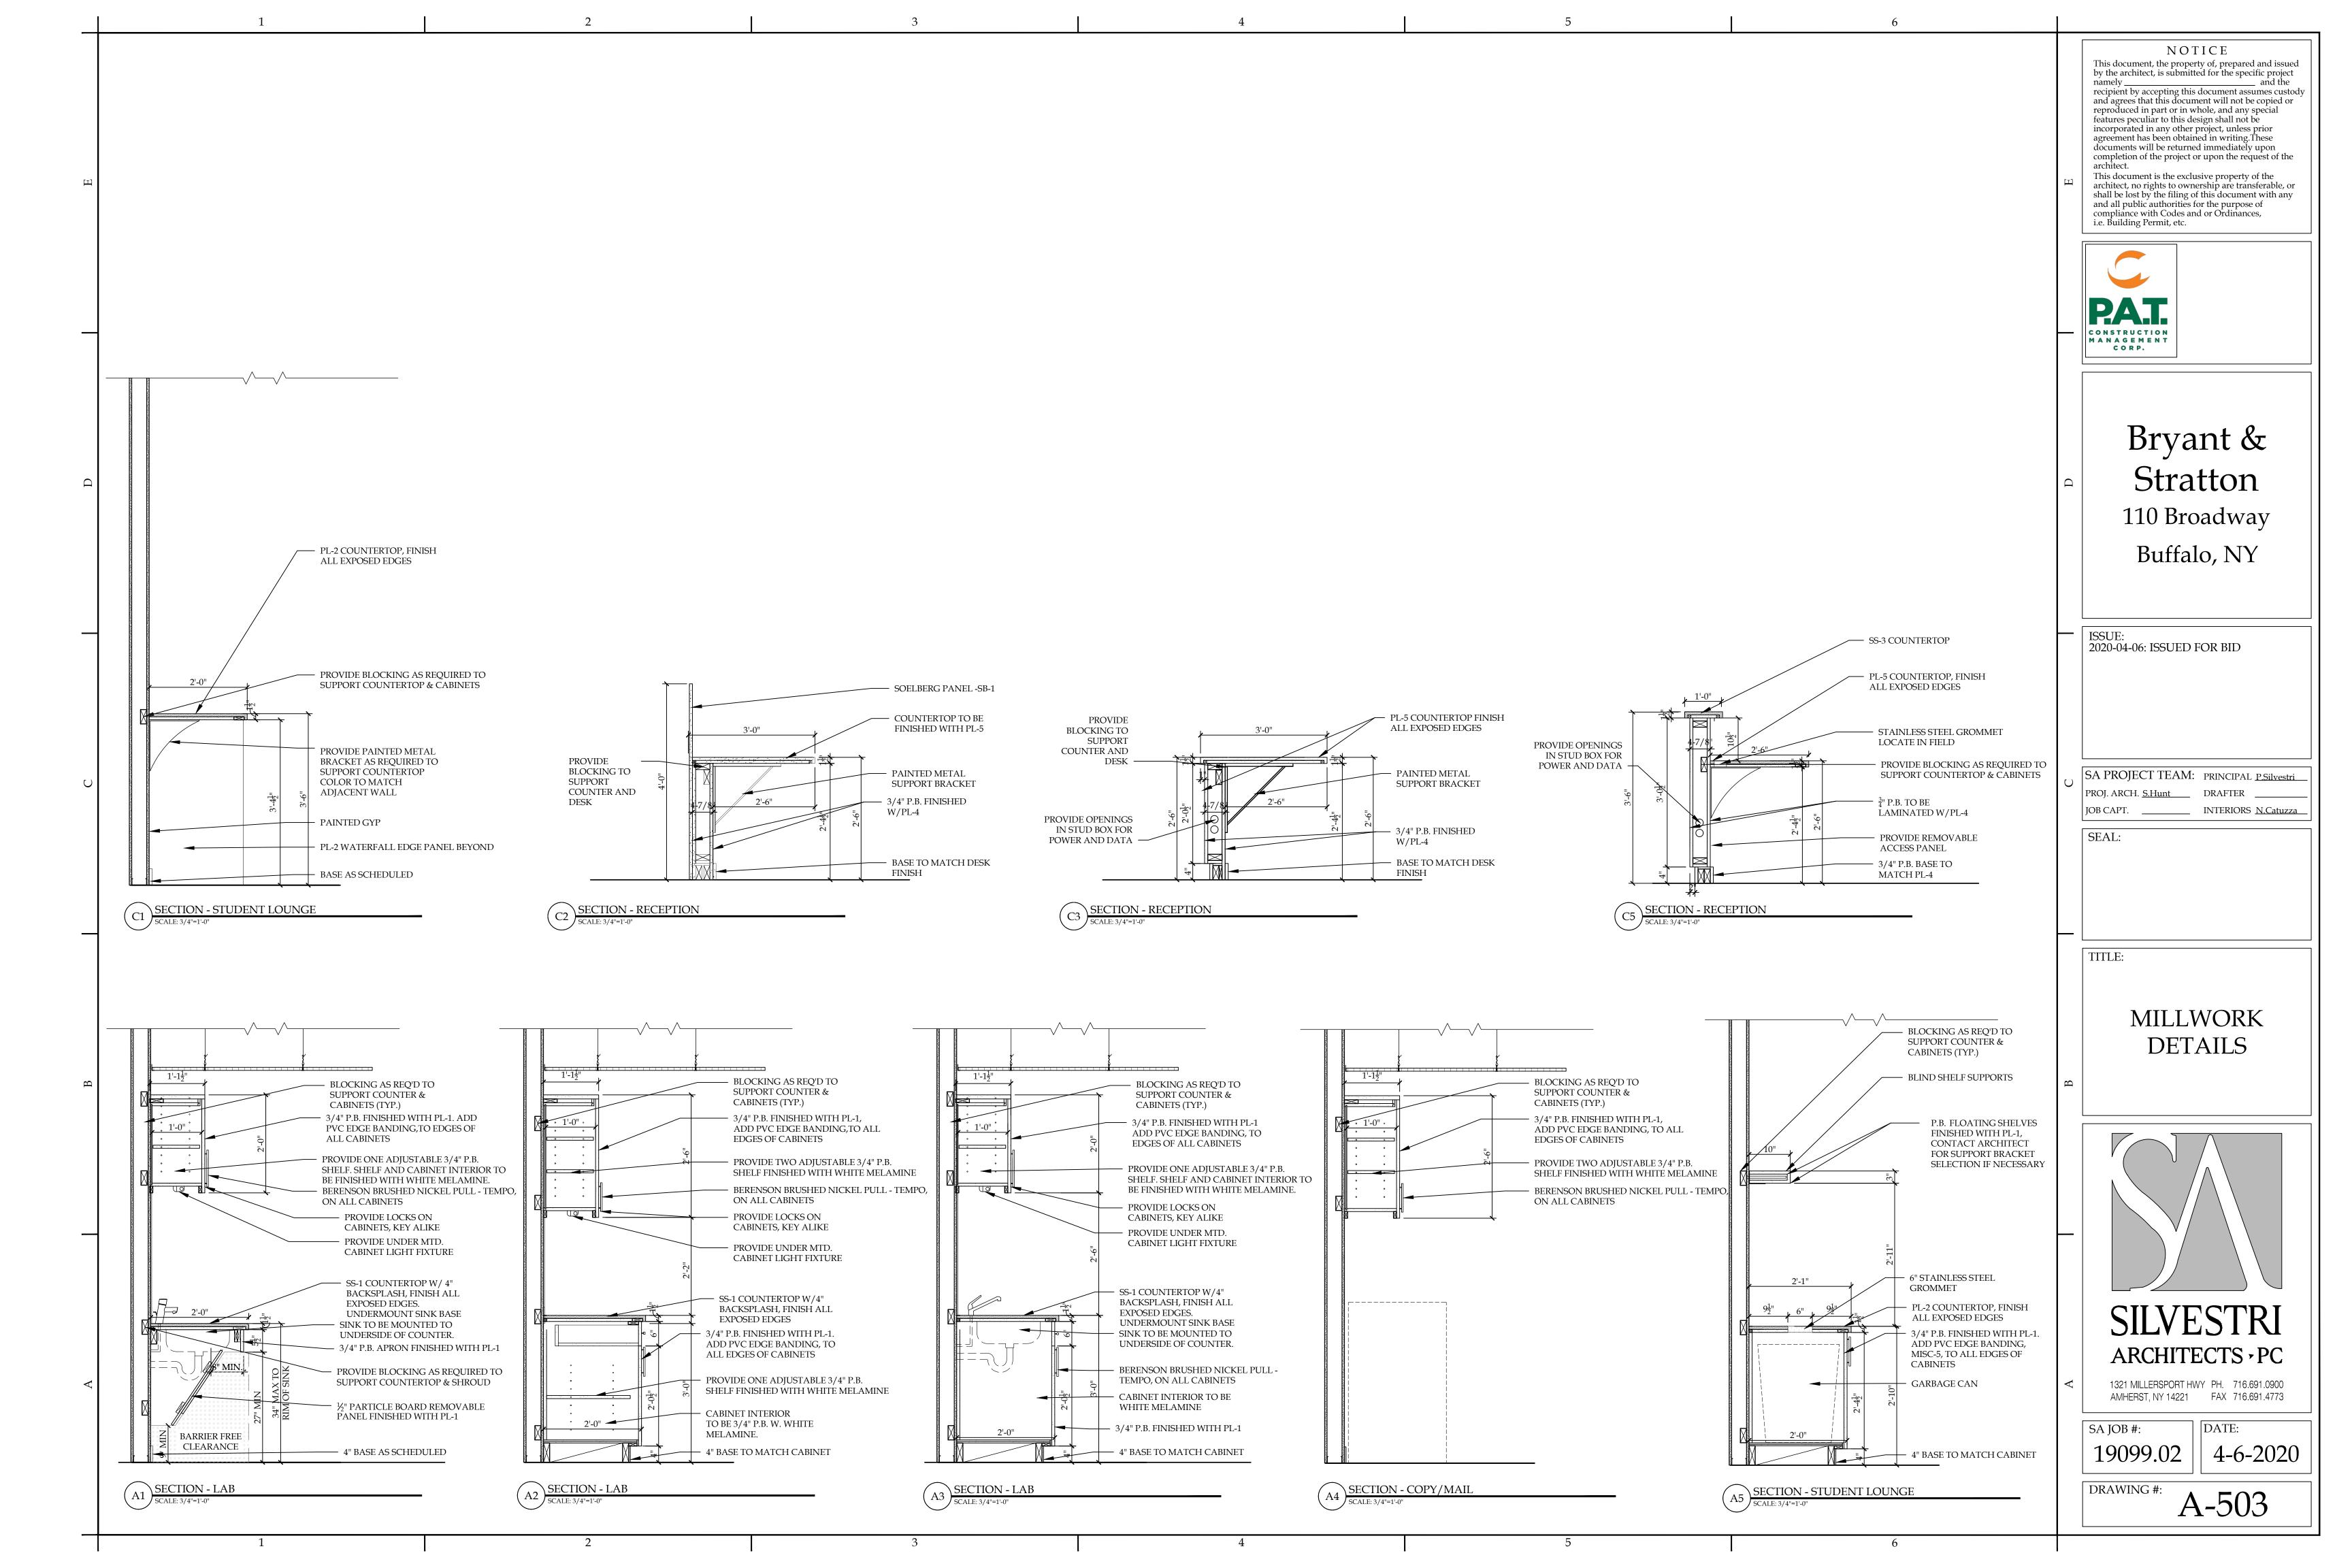

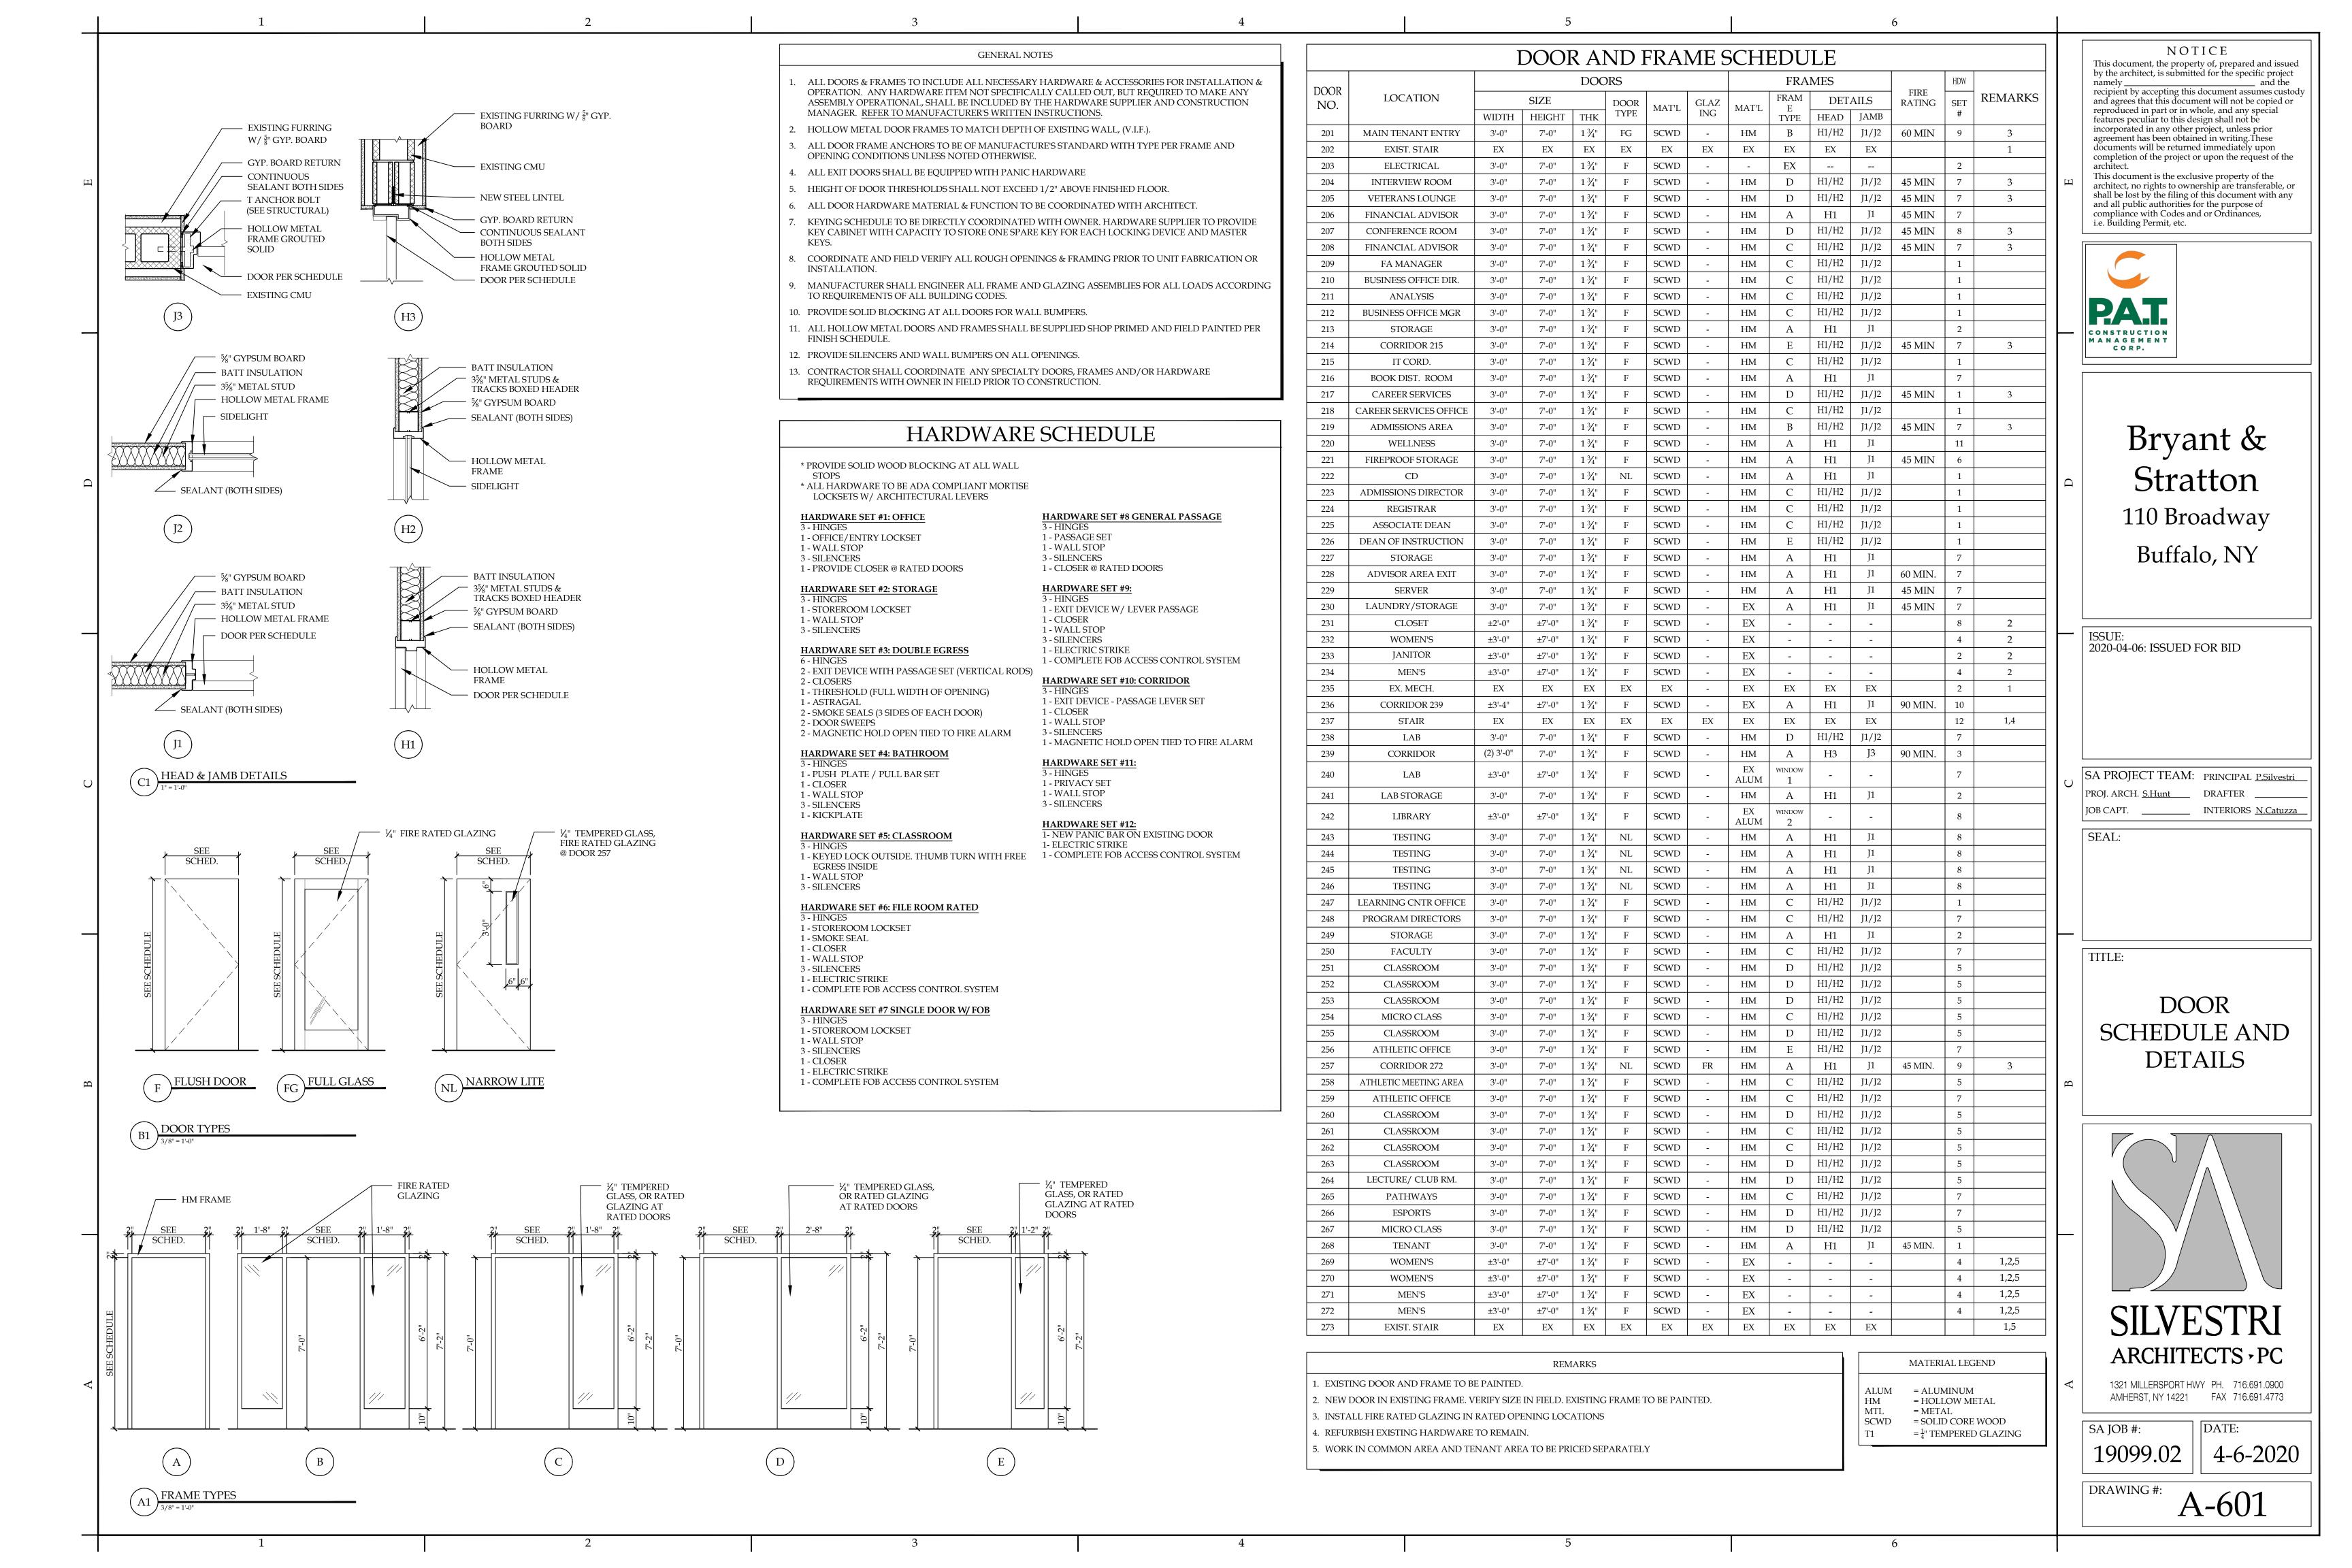

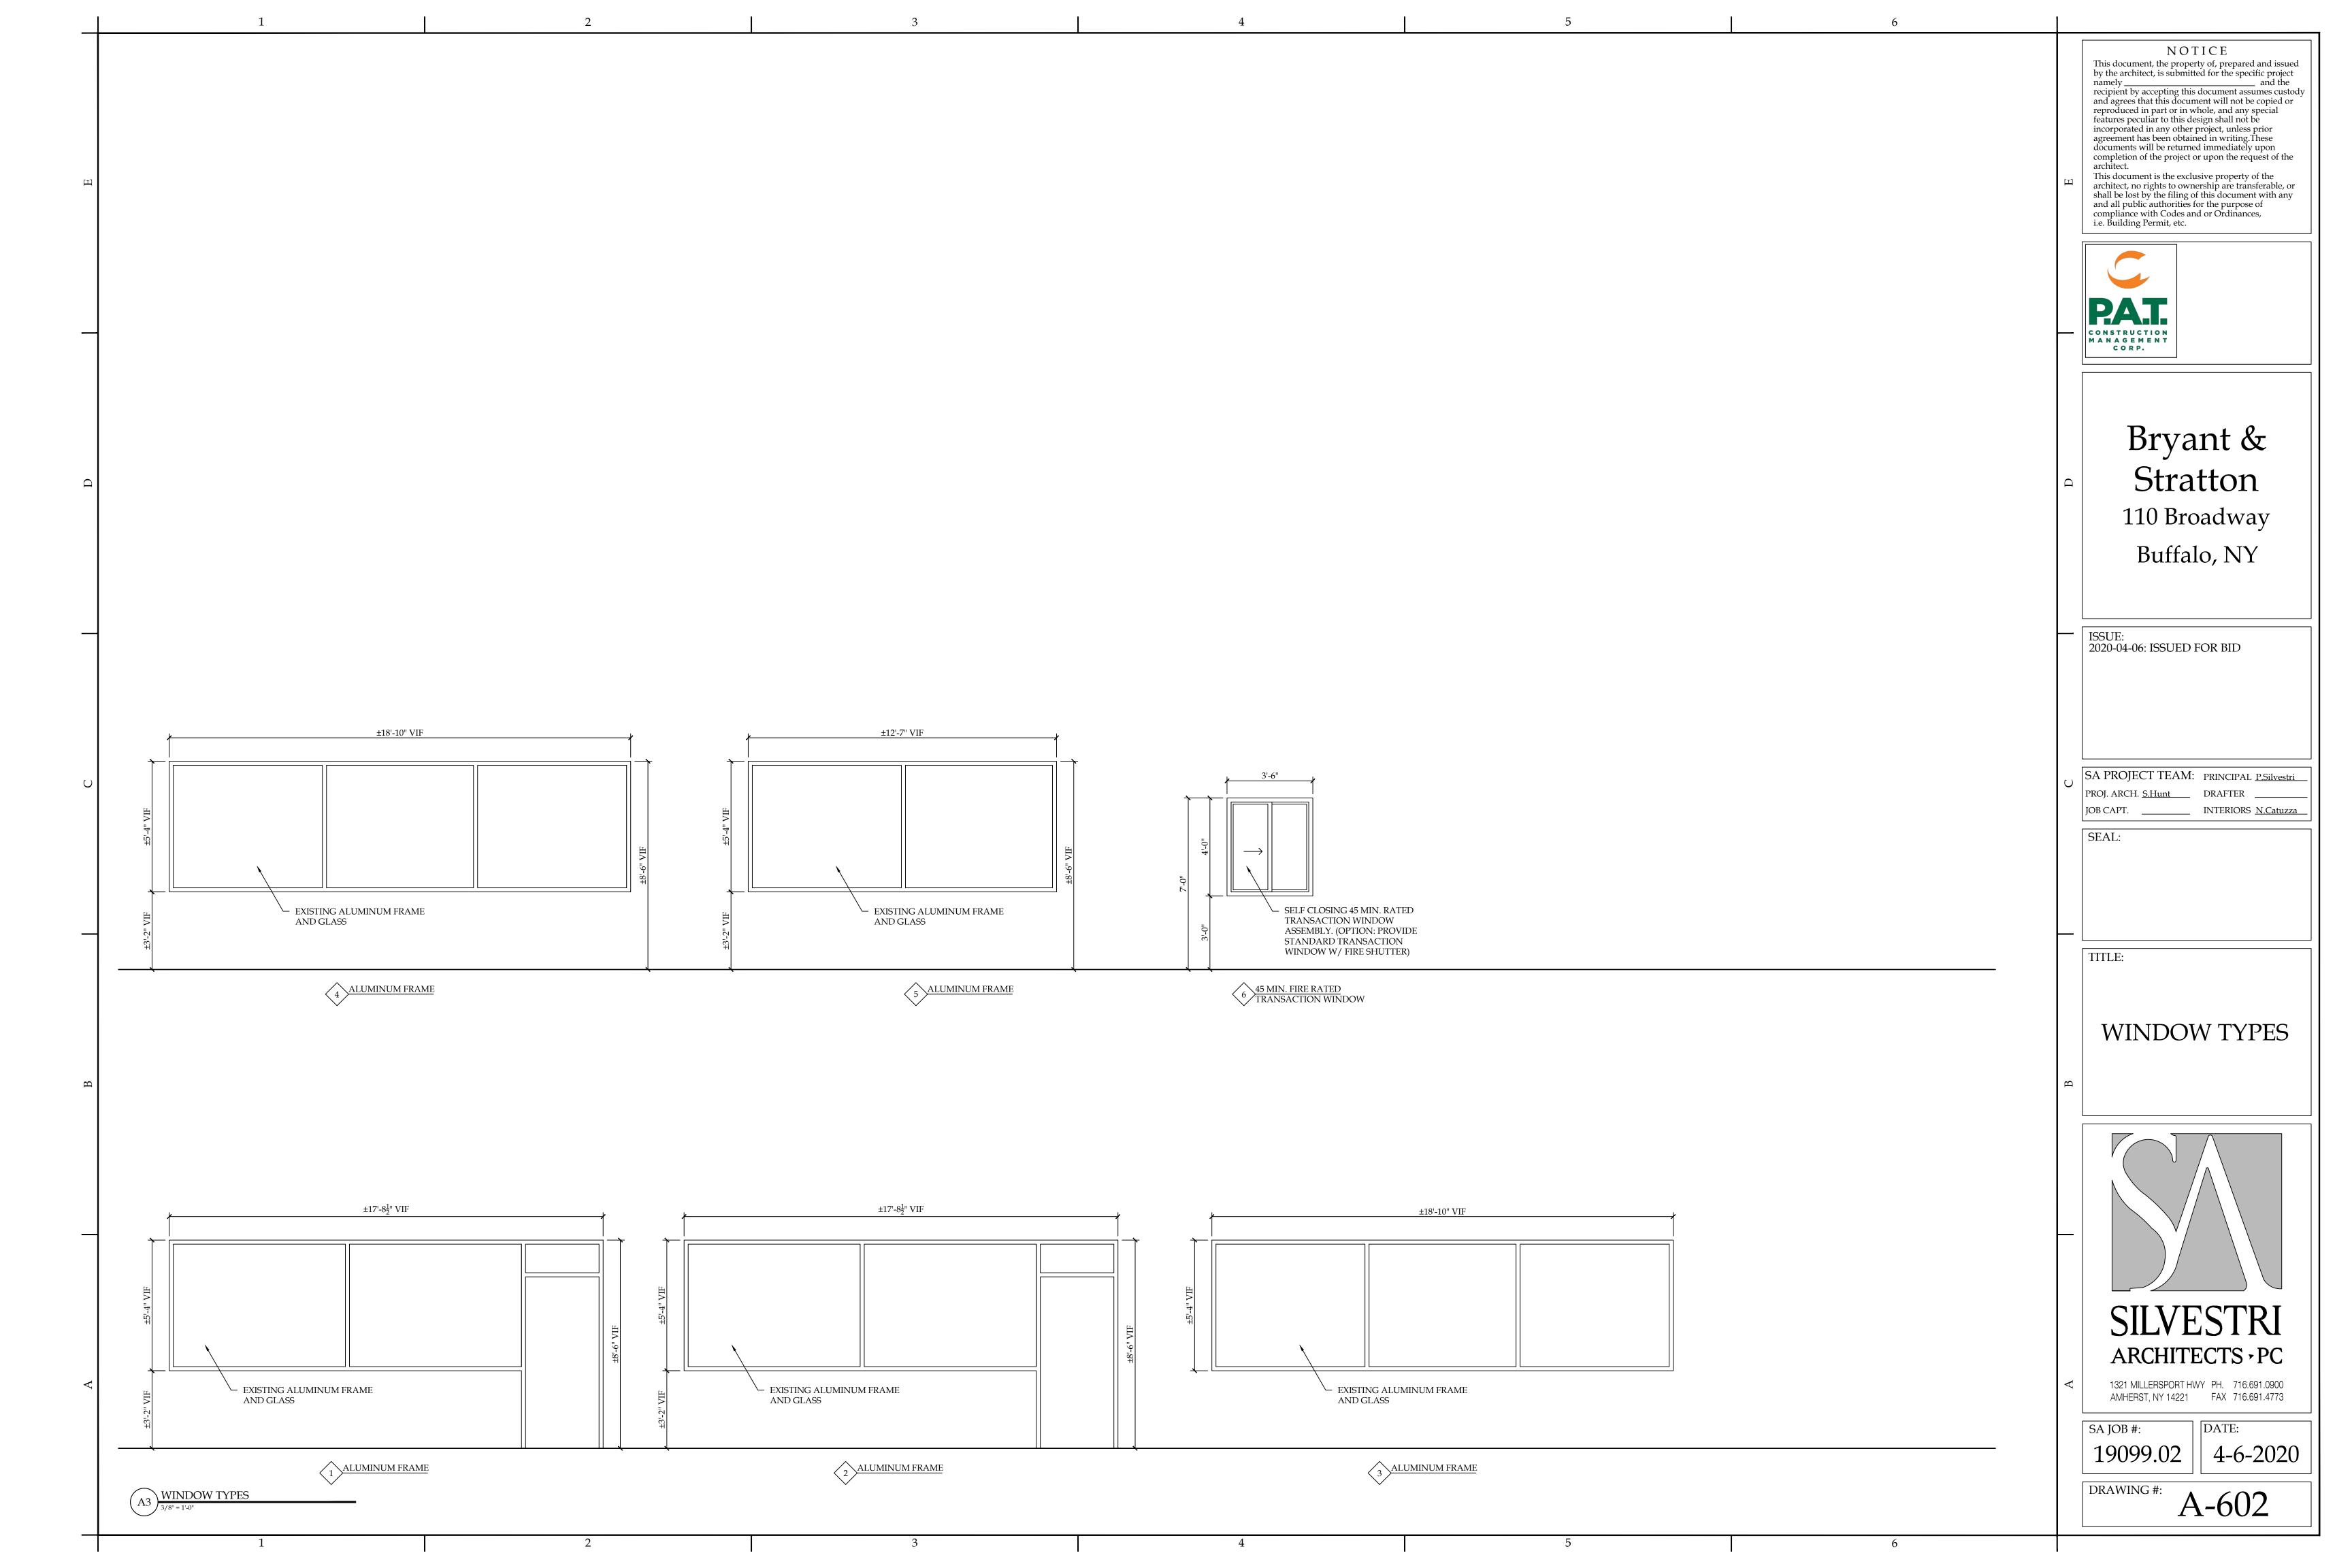

FINI							
	ISH SELECTIONS		FINISH SELECTIONS	GENERAL NO	<u>TES</u>		NOTICE This document, the property of, prepa
INT (P-X): 1) (TYPICAL)		ACOUSTICAL CEILING	TILE (ACT-X):	ANY AND ALL FINISH SELECTIONS/ COLORS MUST BE SUFFOR PROPER LEAD TIME. ANY FINISH THAT IS INSTALLED WIT	HOUT ARCHITECTS APPROVAL MAY BE REQUIRED TO BE		by the architect, is submitted for the sp namely
MANUFACTUŔER: COLOR:	SHERWIN WILLIAMS TBD	(ACT-1) MANUFACTURER:	ARMSTRONG	REMOVED AND REPLACED BY THE GENERAL CONTRACTOR. IT ORDER ALL MATERIALS AT THE APPROPRIATE TIME. ANY FEE	I IS THE RESPONSIBILITY OF THE CONTRACTOR TO SINCURRED AS A RESULT OF FINISHES NOT BEING		recipient by accepting this document a and agrees that this document will not reproduced in part or in whole, and ar
NISH: -2) (ACCENT)	EGGSHELL	STYLE: SIZE:	CORTEGA 2765 2' X 4"	ORDERED ON TIME WILL BE THE RESPONSIBILITY OF THE CONT     ANY DISCREPANCIES BETWEEN ARCHITECTURAL ELEVA			features peculiar to this design shall no incorporated in any other project, unleading agreement has been obtained in writing
	SHERWIN WILLIAMS TBD	EDGE: COLOR:	SQUARE WHITE	BROUGHT TO ARCHITECTS ATTENTION. ARCHITECT MUST BE WITH SPECIFIC DIRECTION PRIOR TO ANTICIPATED ACTION.			agreement has been obtained in writin documents will be returned immediate completion of the project or upon the
NISH:	EGGSHELL	SUSPENSION SYS.:	TEGULAR	· SEE A-500'S DRAWINGS FOR ALL CABINET HARDWARE . T TEMPO PULL	YPICAL HARDWARE TO BE BERENSON BRUSHED NICKEL		architect.  This document is the exclusive proper
2-3) (ACCENT) IANUFACTURER:	SHERWIN WILLIAMS	WOOD DOOR (WD-X): (WD-1)		ALL INTERIOR PRODUCTS TO MEET/EXCEED FLAME SPRE	EAD RATING PER CODE		architect, no rights to ownership are tr shall be lost by the filing of this docum
COLOR: FINISH:	TBD EGGSHELL	MANUFACTURER: STYLE:	MASONITE ASPIRO	ALL FLOOR FINISHES TO EXTEND BENEATH ALL MILLWO	PRK.		and all public authorities for the purpo compliance with Codes and or Ordina i.e. Building Permit, etc.
P-6) (DOOR FRAME) MANUFACTURER:	SHERWIN WILLIAMS	SPECIES: STAIN:	PLAIN SLICED BIRCH ROLLED OATS	ALL ELECTRICAL PANEL COVERS AND/OR MECHANICAI MATCH ADJOINING WALL.	LEQUIPMENT AND/OR DUCTING TO BE PAINTED TO		
COLOR: FINISH:	TBD SEMI-GLOSS	TRANSITION (TS-X):		ANY CEILING HVAC SUPPLY/DIFFUSERS ETC. TO BE PAIN QUESTIONS OR CONCERN TO BE BROUGHT TO ARCHITECT'S A			
(P-5) (RESTROOMS) MANUFACTURER:	SHERWIN WILLIAMS	(TS-1) (GENERAL)		ORDER/INSTALL BY CONTRACTOR OR OTHER.  GYPSUM SOFFIT TO BE EXTEND TO CEILING. HORIZONTA	ALCUDEACE OF ALL COFFITS TO BE DAINTED TO MATCH		
COLOR: FINISH:	TBD EGGSHELL	MANUFACTURER: STYLE & SIZE:	SCHLUTER SYSTEMS RENO-TK SIZE TO BE V.I.F. IN	ADJOINING WALLS UNLESS OTHERWISE SPECIFIED.	AL SURFACE OF ALL SOFFIIS TO BE PAINTED TO MATCH		PAT
P-6) (DOOR FRAMES)	CATEDOWN AND A CONTROL OF THE CONTRO	STYLE:	ACCORDANCE WITH MATERIAL(S) THICKNESS CLEAR SATIN ANODIZED ALUMINUM	<ul><li><u>CEILINGS:</u></li><li>ALL GYPSUM BOARD CEILINGS TO BE PAINTED IN A FLAT</li></ul>	WHITE EINISH LINILESS SPECIEIED		CONSTRUCTION MANAGEMENT CORP.
MANUFACTURER: COLOR: FINISH:	SHERWIN WILLIAMS TBD SEMI-GLOSS	LOCATION(S):	FLOORING MATERIAL CHANGES AS NECESSARY.	ALL EXPOSED MECHANICAL DUCT COVERS SHALL BE PA			CORP.
VALL TILE (WT-X):	SEMI GEOSC	NOTE(S):	PLEASE SEE GENERAL NOTES RE: TRANSITIONS. LVT TO CPT DOES NOT	<ul><li>COLOR. PRIME AS NECESSARY.</li><li>EXPOSED CEILING, JOISTS, DUCTS, DIFFUSERS, AND ALL C</li></ul>	OTHER CEILING ELEMENTS TO PAINTED P.6 IN ERONT		
WT-1) MANUFACTURER:	BEST TILE	FIBERGLASS REINFORG	NEED TRANSITION CED PANEL (FRP-X):	AREA, ADVISOR AREA, AND LEARNING COMMONS.	THEN CELENIC ELEMENTS TO TAINTED TO INTRODU		
STYLE: COLOR: SIZE:	ZEBRINO MICHAELANGELO 12"X24"	(FRP-1)		• PROVIDE (1) COAT WALL PRIMER FOLLOWED BY (2) COA	IS WALL PAINT ON ALL INTERIOR WALL SURFACE		Bryant
NSTALLATION: GROUT:	SEE A-400S FOR DETAILS FLEXTILE -	MANÚFACTURER: STYLE : COLOR:	CRANE COMPOSITES GLASBORD WITH SURFASEAL EMBOSSED WHITE	UNLESS OTHERWISE NOTED IN SPECIFICATIONS. SEE SPEC FOR	DETAILS.		
WT-2) (LAB BACKSPLASH) MANUFACTURER:	) BEST TILE	STYLE: LOCATION(S):	CLASS A FIRE RATED STORAGE RM	<ul> <li>WHERE DARK PAINT COLORS ARE APPLIED, USE DEEP GF</li> <li>PROVIDE SPACERS AS NEEDED BEHIND MIRRORING IN RI</li> </ul>			Stratto
TYLE: COLOR:	BRIXTON WHITE	ROLLERSHADES (RS-X)		FLOORS:			
INISH: IZE: IOTE:	GLOSSY 3"X6" INCLUDED IN ALTERNATE 2	(RS-1) MANUFACTURER:	HUNTER DOUGLAS	PROVIDE CORIAN OR EQUAL THRESHOLD AT ALL TOILE ARCHITECT TO CHOOSE FROM MANUFACTURER FULL RANGE			110 Broadw
ARPET (CPT-X):		STYLE: COLOR:	E SCREEN 7510 CHARCOAL	NO CHANGES OR SUBSTITUTIONS WILL BE MADE TO THI     OWNER OR ARCHITECT.			Buffalo, N
CPT-1) IANUFACTURER: OULECTION:	INTERFACE EVENSONG	OPENNESS: LOCATION:	5% EXTERIOR WINDOWS AT STUDENT UNION	CONTRACTOR TO PROVIDE (TS-1) AT ALL FLOORING MA			
OLLECTION: IYLE: OLOR:	WINTER SUN EVENING SUN	SOELBERG PANEL (SB-2		SIZES TO BE DETERMINED BY CONTRACTOR AND V.I.F. BASED ( MILLWORK:			
NSTALLATION:	REQUEST INSTALL GUIDE FROM ARCH	(SB-1) MANUFACTURER:	SOELBERG	PROVIDE CLEAR BEAD OF SILICONE OR CLEAR CALK TO	SEAL BETWEEN MILLWORK PIECES(IE: COUNTER TOP		
ANUFACTURER: COLLECTION:	INTERFACE EVENSONG	STYLE: COLOR:	LISCIO FROSTY WHITE	AND BACKSPLASH) AND MILLWORK AND WALL. (TYPICAL).  WINDOWS:			ISSUE: 2020-04-06: ISSUED FOR BID
TYLE: OLOR: NSTALLATION:	WINTER SUN DAWN SUN REQUEST INSTALL GUIDE FROM ARCH	LOCATION:  MISCELLANEOUS (MIS	RECEPTION DESK ACCENT  C-X):	ALL GLAZING FACING EXTERIOR TO RECEIVE RS-1.			
CPT-3)		(MISC-1)(TOILET PARTIT MANUFACTURER:		DOORS:			
MANUFACTURER: COLLECTION: TYLE:	INTERFACE EVENSONG WINTER SUN	MANUFACTURER: FINISH: STYLE:	POWDERCOATED STEEL COLOR TBD ULTIMATE PRIVACY 72 NO SIGHT SYSTE		TH P-6.		
OLOR: NSTALLATION:	MIDNIGHT SUN REQUEST INSTALL GUIDE FROM ARCH	(MISC-2)	FLOOR ANCHORED/OVERHEAD BRACE				
UXURY VINYL TILE (LVT	<u>Γ-X):</u>	(PVC EDGE BANDING) MANUFACTURER:	DOELLKEN	SIGNAGE:			SA PROJECT TEAM: PRINCIP.
IANUFACTURER: IYLE:	INTERFACE STEADY STRIDE WOODGRAINS	COLOR: LOCATION:	TBD COUNTERTOPS WHERE SPECIFIED	SIGNAGE LOCATIONS WILL NEED TO BE PROVIDED AND APPROVED BY ARCHITECT AND CLIENT PRIOR TO MANUFACT			PROJ. ARCH. <u>S.Hunt</u> DRAFTEI
COLOR:	STERLING	(MISC-3) (PVC EDGE BANDING)					JOB CAPT INTERIO
LVT-2) MANUFACTURER: TYLE:	INTERFACE STEADY STRIDE WOODGRAINS	MANUFACTURER: COLOR:	DOELLKEN TBD CARINETS WHERE SPECIFIED				SEAL:
STYLE: COLOR:	GRAPHITE	LOCATION:	CABINETS WHERE SPECIFIED				
TILE (T-X): T-1) (RESTROOMS)	REST TILE						
MANUFACTURER: FINISH: COLOR:	BEST TILE SLAB SILVER				CENT		
SIZE: NSTALLATION:	12"X24" 1/3 BRICK LAY			ROOM FINISH LE	GENU		
ROUT: UBBER BASE (RB-X):	FLEXTILE - TBD			FLOORS  CARDET	MISCELLANEOUS  PLANEOUS		TITLE:
RB-1)				CPT = CARPET T = TILE	PL = PLASTIC LAMINATE SS = SOLID SURFACE		FINISH
IANUFACTURER: IZE: OLOR:	JOHNSONITE 4" COVE BASE CHARCOAL			LVT = LUXURY VINYL TILE	TS = TRANSITION STRIP		SCHEDULE
OLID SURFACE (SS-X):				BASE	MISC = MISCELLANEOUS		GENERA
SS-1)(LAB COUNTER) MANUFACTURER:	CORIAN			RB = RUBBER BASE <u>WALLS</u>	RS = ROLLER SHADES  CG = CORNER GUARD		NOTES
IANUFACTURER: OLOR:	SILVER BIRCH			P = PAINT	SB = SOELBERG PANEL		
	ER) CORIAN TBD - LOWEST COST GRADE			WT = WALL TILE	MATERIALS		
IANUFACTURER:	D      =			FRP = FIBER REINFORCED PANEL	P.B. = PARTICLE BOARD		
ANÙFACTURER: OLOR: S-3) (RESTROOM COUNTE	ER)		<b>-</b>	CEILING	GYP. = GYPSUM BOARD		
ANÙFACTURER: OLOR: S-3) (RESTROOM COUNTE ANUFACTURER:				ACT = ACOUSTIC CEILING TILE			
ANUFACTURER: OLOR: S-3) (RESTROOM COUNTE ANUFACTURER: OLOR:	ER) MSI QUARTZ TBD			ACT = ACOUSTIC CEILING TILE  GYP = GYPSUM BOARD			
IANÙFACTURER: OLOR: S-3) (RESTROOM COUNTE IANUFACTURER: OLOR: LASTIC LAMINATE (PL-X L-1) (CABINETS) IANUFACTURER:	TER)  MSI QUARTZ  TBD  X):  WILSONART			GYP = GYPSUM BOARD <u>DOORS</u>			
IANUFACTURER: OLOR: S-3) (RESTROOM COUNTE IANUFACTURER: OLOR: LASTIC LAMINATE (PL-X L-1) (CABINETS) IANUFACTURER: OLOR:	ER) MSI QUARTZ TBD  X):			GYP = GYPSUM BOARD			
ANUFACTURER: OLOR: S-3) (RESTROOM COUNTE ANUFACTURER: OLOR: LASTIC LAMINATE (PL-X L-1) (CABINETS) ANUFACTURER: OLOR: L-2) (COUNTER) ANUFACTURER:	ER) MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR			GYP = GYPSUM BOARD <u>DOORS</u>			
ANUFACTURER: OLOR: S-3) (RESTROOM COUNTE ANUFACTURER: OLOR: LASTIC LAMINATE (PL-X L-1) (CABINETS) ANUFACTURER: OLOR: L-2) (COUNTER) ANUFACTURER: OLOR: L-3) (RESTROOM SHROUI	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  TD)			GYP = GYPSUM BOARD <u>DOORS</u>			
MANUFACTURER: COLOR: ESS-3) (RESTROOM COUNTE MANUFACTURER: COLOR: PLASTIC LAMINATE (PL-X PL-1) (CABINETS) MANUFACTURER: COLOR: PL-2) (COUNTER) MANUFACTURER: COLOR: PL-3) (RESTROOM SHROUE MANUFACTURER:	ER) MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE			GYP = GYPSUM BOARD <u>DOORS</u>			
IANUFACTURER: OLOR: S-3) (RESTROOM COUNTE IANUFACTURER: OLOR: LASTIC LAMINATE (PL-X PL-1) (CABINETS) IANUFACTURER: OLOR: PL-2) (COUNTER) IANUFACTURER: OLOR: PL-3) (RESTROOM SHROUE IANUFACTURER: OLOR: PL-3) (RESTROOM SHROUE IANUFACTURER: OLOR:	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  (D) WILSONART STEEL MESH			GYP = GYPSUM BOARD <u>DOORS</u>			SILVEST
MANUFACTURER: COLOR: COLOR: COLOR: MANUFACTURER: COLOR: MASTIC LAMINATE (PL-X) PL-1) (CABINETS) MANUFACTURER: COLOR: PL-2) (COUNTER) MANUFACTURER: COLOR: PL-3) (RESTROOM SHROUT MANUFACTURER: COLOR: PL-4) (RECEPTION DESK) MANUFACTURER:	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  (D) WILSONART STEEL MESH			GYP = GYPSUM BOARD <u>DOORS</u>			
COLOR: SS-3) (RESTROOM COUNTEMANUFACTURER: COLOR: PLASTIC LAMINATE (PL-X) PL-1) (CABINETS) MANUFACTURER: COLOR: PL-2) (COUNTER) MANUFACTURER: COLOR: PL-3) (RESTROOM SHROUT MANUFACTURER: COLOR: PL-4) (RECEPTION DESK)	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  D) WILSONART STEEL MESH  WILSONART TBD - PRICE PREMIUM LAMINATE			GYP = GYPSUM BOARD <u>DOORS</u>			ARCHITECTS
IANÚFACTURER: OLOR: S-3) (RESTROOM COUNTE IANUFACTURER: OLOR: LASTIC LAMINATE (PL-X PL-1) (CABINETS) IANUFACTURER: OLOR: PL-2) (COUNTER) IANUFACTURER: OLOR: PL-3) (RESTROOM SHROUE IANUFACTURER: OLOR: PL-4) (RECEPTION DESK) IANUFACTURER: OLOR: PL-4) (RECEPTION WORK SHANUFACTURER:	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  (D) WILSONART STEEL MESH  WILSONART TBD - PRICE PREMIUM LAMINATE  SURFACE)			GYP = GYPSUM BOARD <u>DOORS</u>			ARCHITECTS  1321 MILLERSPORT HWY PH. 7
IANÚFACTURER: OLOR: S-3) (RESTROOM COUNTE IANUFACTURER: OLOR: LASTIC LAMINATE (PL-X PL-1) (CABINETS) IANUFACTURER: OLOR: PL-2) (COUNTER) IANUFACTURER: OLOR: PL-3) (RESTROOM SHROUE IANUFACTURER: OLOR: PL-4) (RECEPTION DESK) IANUFACTURER: OLOR:	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  (D) WILSONART STEEL MESH  WILSONART TBD - PRICE PREMIUM LAMINATE  SURFACE) NEVAMAR			GYP = GYPSUM BOARD <u>DOORS</u>			ARCHITECTS  1321 MILLERSPORT HWY PH. 71 AMHERST, NY 14221 FAX 71
ANUFACTURER: DLOR:  3-3) (RESTROOM COUNTE ANUFACTURER: DLOR:  ASTIC LAMINATE (PL-X)  11) (CABINETS) ANUFACTURER: DLOR: 12) (COUNTER) ANUFACTURER: DLOR: 13) (RESTROOM SHROUE ANUFACTURER: DLOR: 14) (RECEPTION DESK) ANUFACTURER: DLOR: 15) (RECEPTION WORK SECTION WORK SEC	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  (D) WILSONART STEEL MESH  WILSONART TBD - PRICE PREMIUM LAMINATE  SURFACE) NEVAMAR			GYP = GYPSUM BOARD <u>DOORS</u>			ARCHITECTS  1321 MILLERSPORT HWY PH. 71 AMHERST, NY 14221 FAX 71  SA JOB #: DATE:
ANUFACTURER: DLOR:  6-3) (RESTROOM COUNTE ANUFACTURER: DLOR:  6-ASTIC LAMINATE (PL-X  6-ASTIC LAMINATE	MSI QUARTZ TBD  X):  WILSONART PHANTOM CHARCOAL  NEVAMAR EISKAFFE  (D) WILSONART STEEL MESH  WILSONART TBD - PRICE PREMIUM LAMINATE  SURFACE) NEVAMAR			GYP = GYPSUM BOARD <u>DOORS</u>			SILVEST ARCHITECTS  1321 MILLERSPORT HWY PH. 71 AMHERST, NY 14221 FAX 71  SA JOB #: 19099.02 DATE: 4-6

	1		ROOM FINISH S	SCHEDI II	 .E				254	FACULTY	RB-1	CPT-1/CPT-2/CPT-3	P-1, P-3	ACT-1					NOTICE
					ن <b>د</b> ر 	<b>N</b> // IT T	LWORK		255	STORAGE	RB-1	LVT-1	P-1	ACT-1			+		This document, the property of, prepared and iss by the architect, is submitted for the specific proj
ROOM	ROOM NAME	BASE	FLOOR	WALLS	CEILING		COUNTERTOP,	   REMARKS		CLASSROOM	RB-1	LVT-1	P-1/P-2	ACT-1					namely and t recipient by accepting this document assumes cu and agrees that this document will not be copied
IUMBER							BACKSPLASH		257	CLASSROOM	RB-1	CPT-1/CPT-2	P-1/P-2	ACT-1					reproduced in part or in whole, and any special features peculiar to this design shall not be
201	ELEV. LOBBY	EXIST	EXIST	EXIST	EXIST				258	CLASSROOM	RB-1	LVT-2	P-1/P-2	ACT-1					incorporated in any other project, unless prior agreement has been obtained in writing. These documents will be returned immediately upon
202	ELEV.	EXIST	EXIST	EXIST	EXIST				<u> </u>		RB-1	LVT-2	P-1/P-2						completion of the project or upon the request of architect.  This document is the exclusive property of the
203	RECEPTION	RB-1	LVT-1, LVT-2	P-1/P-2	ACT-1	PL-4/SB-1	PL-5/SS-3	1	259	MICRO CLASS			•	ACT-1				TI I	architect, no rights to ownership are transferab shall be lost by the filing of this document with
204	STUDENT LOUNGE	RB-1	LVT-1, LVT-2	P-1	ACT-1	PL-1	PL-2	1	260	CLASSROOM	RB-1	LVT-2	P-1	ACT-1					and all public authorities for the purpose of compliance with Codes and or Ordinances, i.e. Building Permit, etc.
205	VETERAN'S LOUNGE	RB-1	CPT-2	P-1, P-2	ACT-1				261	ATHLETIC OFFICE	RB-1	CPT-1	P-1/P-3	ACT-1					
206	INTERVIEW ROOM	RB-1	CPT-2	P-1, P-2	ACT-1				262	ESPORTS	RB-1	CPT-1	P-1/P-2	ACT-1					
207	CORRIDOR	RB-1	LVT-1, LVT-2	P-1, P-4	ACT-1				263	PATHWAYS	RB-1	CPT-1	P-1	ACT-1					
208	CONFERENCE ROOM	RB-1	CPT-1, CPT-2	P-1, P-2	ACT-1				264	MICRO CLASS	RB-1	CPT-1	P-1/P-2	ACT-1					PAT
209	FINANCIAL ADVISOR AREA	RB-1	CPT-1, CPT-2, CPT-3	P-1, P-3	ACT-1				265	LECTURE/CLUB RM.	RB-1	CPT-1	P-1/P-2	ACT-1				-	CONSTRUCTION MANAGEMENT CORP.
210	FA MANAGER	RB-1	CPT-2	P-1, P-3	ACT-1				266	CLASSROOM	RB-1	CPT-1	P-1/P-2	ACT-1					
211	BUSINESS OFFICE DIRECTOR	RB-1	CPT-2	P-1, P-3	ACT-1				267	CLASSROOM	RB-1	LVT-2	P-1/P-2	ACT-1					
212	ANALYSIS	RB-1	CPT-2	P-1, P-3	ACT-1				268	CLASSROOM	RB-1	CPT-1	P-1/P-2	ACT-1					
213	BUSINESS OFFICE MGR	RB-1	CPT-2	P-1, P-3	ACT-1				269	CLASSROOM	RB-1	CPT-1	P-1/P-2	ACT-1					Bryant &
214	STORAGE	RB-1	LVT-1	P-1	ACT-1				270	ATHLETIC OFFICE	RB-1	CPT-1	P-1/P-2	ACT-1					Diyante &
215	CORRIDOR	RB-1	LVT-1, LVT-2	P-1, P-4	ACT-1				271	ATHLETIC MEETING	RB-1	CPT-1	P-1/P-2	ACT-1					Stratton
216	IT CORD	RB-1	CPT-2	P-1, P-3	ACT-1				272	AREA CORRIDOR	RB-1	LVT-2/CPT-3	P-1, P-4	ACT-1					110 Broadway
217	BOOK DIST. RM	RB-1	CPT-2	P-1	ACT-1				273	TENANT	RB-1	-		-					
218	ADMISSIONS AREA	RB-1	CPT-1, CPT-2, CPT-3	P-1, P-3	ACT-1				274	WOMEN'S	-	T-1	P-5/ WT-1	ACT-1	PL-3	SS-2	2,4		Buffalo, NY
219	FIREPROOF STORAGE	RB-1	CPT-2	P-1	ACT-1				275	MEN'S	_	T-1	P-5/ WT-1	ACT-1	PL-3	SS-2	2,4		
220	CD	RB-1	CPT-2	P-1, P-3	ACT-1				276	STAIR		-	-	7101-1	T L-U		2/1		
									277	JAN.	RB-1	LVT-1	P-1, FRP-1	ACT-1			3	_	ISSUE: 2020-04-06: ISSUED FOR BID
221	ADMISSIONS DIRECTOR	RB-1	CPT-2	P-1, P-3	ACT-1				277	JAIN.			1-1, 1111-1	ACI-I			3		2020-04-06: ISSUED FOR BID
222	BREAK RM	RB-1	LVT-1	P-1, P-3	ACT-1	PL-1	PL-2		_		ROOM FINISH	I LEGEND							
223	REGISTRAR	RB-1	CPT-2	P-1, P-3	ACT-1					FLOORS		MISCELLANEOUS							
224	ASSOC DEAN	RB-1	CPT-2	P-1, P-3	ACT-1					CPT = CARPET T = TILE		PL = PLASTIC LAMINATE SS = SOLID SURFACE							
225	DEAN OF INSTRUCTION	RB-1	CPT-2	P-1, P-3	ACT-1					LVT = LUXURY VINYL TILE		TS = TRANSITION STRIP							
226	STORAGE	RB-1	CPT-1/CPT-2	P-1	ACT-1				-	BASE		MISC = MISCELLANEOUS						U	SA PROJECT TEAM: PRINCIPAL P.Silv
227	ADVISOR AREA	RB-1	CPT-1/CPT-2/CPT-3	P-1, P-3	ACT-1				-	RB = RUBBER BASE WALLS		RS = ROLLER SHADES  CG = CORNER GUARD							PROJ. ARCH. <u>S.Hunt</u> DRAFTER  JOB CAPT INTERIORS <u>N.Ca</u>
						DI 4	DI 0		-	P = PAINT		SB = SOELBERG PANEL							SEAL:
228	SHARED WAITING	RB-1	CPT-1/CPT-2/CPT-3	P-1	ACT-1	PL-1	PL-2			WT = WALL TILE		MATERIALS							OET IE.
229	CAREER SERVICES	RB-1	CPT-2/CPT-3	P-1, P-3	ACT-1					FRP = FIBER REINFORCED PANEL		P.B. = PARTICLE BOARD							
230	CS OFFICE	RB-1	CPT-2	P-1, P-3	ACT-1					<u>CEILING</u> ACT = ACOUSTIC CEILING TILE		GYP. = GYPSUM BOARD							
231	WELLNESS	RB-1	CPT-2	P-1	ACT-1					GYP = GYPSUM BOARD								_	-
232	SERVER RM	RB-1	LVT-1	P-1	ACT-1					DOORS  WD = WOOD DOOR									TITLE:
233	CORRIDOR	RB-1	LVT-1, LVT-2	P-1, P-4	ACT-1					WD - WOOD DOOK									
234	LAUNDRY/STOR.	RB-1	LVT-1	P-1	ACT-1						DEI (4)	DVG							
235	WOMEN'S		T-1	WT-1/P-5	ACT-1	PL-3	SS-2	2	1 PEFER TO DE	THE COTED OF HIS ON AN EAR EVACT DETAIL	REMA		N IT						FINISH LEGENI
236	JAN.	TB-1	LVT-1	P-1/FRP-1	ACT-1			3		FLECTED CEILING PLAN FOR EXACT DETA I RESTROOMS WILL ACT AS WALL BASE. RE	•	,	OU 1.						
237	MEN'S	TB-1	T-1	WT-1/P-5	ACT-1	PL-3	SS-2	2	3. FRP-1 TO BE I	NSTALLED AT 4'-6" A.F.F, P-1 TO BE PAINTEI	ABOVE FRP.								
238	EX MECH	RB-1	LVT-1	P-1	ACT-1					1 IS SPECIFIED FOR THIS SPACE, SEE FINISH									
239	CORRIDOR	RB-1	LVT-1, LVT-2	P-1, P-4	ACT-1	PL-1	PL-2		5. ALTERNATE	2 IS SPECIFIED FOR THIS SPACE, SEE FINISH	PLAN FOR EXTENT (	OF WORK.							
240	STAIR	_	-	-	EXIST				1										
241	LAB	RB-1	LVT-1	P-1, P-2	ACT-1	PL-1	SS-1/PL-2	5	1										
242	CORRIDOR	RB-1	LVT-1, LVT-2	P-1, P-4	ACT-1		,	-	-										
243	LAB	RB-1	LVT-1	P-1	ACT-1	PL-1	SS-1/PL-2	5	-										
244	LAB STOR.	RB-1	LVT-1	P-1	ACT-1		, - <b>~ -</b>												
244	LIBRARY	RB-1	CPT-1, CPT-2	P-1, P-2	ACT-1						ALTERN	JATES							
245	LIBRARY STOR.	RB-1	LVT-1	P-1	ACT-1				1. COMMON A	REA RESTROOMS TO BE REMODELED, SEE A									
	+	RB-1 RB-1		P-1 P-1, P-2					1 1	REA RESTROOMS TO BE REMODELED, SEE A PLASH AT LABS.	1000 1110 A-0003 FU	II (IOI OBBECTION).							SILVESTR
247	TESTING		CPT-2		ACT 1				-										
248	TESTING	RB-1	CPT-2	P-1, P-2	ACT-1			1	-										ARCHITECTS - P
249	TESTING	RB-1	CPT-2	P-1, P-2	ACT-1				4										1321 MILLERSPORT HWY PH. 716.691.0 AMHERST, NY 14221 FAX 716.691.4
250	TESTING	RB-1	CPT-2	P-1, P-2	ACT-1	DI 4 /27 5			4										
251	LEARNING CENTER LEARNING CENTER	RB-1	CPT-2	P-1, P-2	ACT-1	PL-1/PL-3	SS-1		4										
252	OFFICE	RB-1	CPT-2	P-1, P-3	ACT-1														19099.02 4-6-20
	PROGRAM DIRECTORS	RB-1	CPT-2	P-1, P-3	ACT-1	PL-1/PL-3	SS-1												DRAWING #: A-604
253														_				-	A 2 1 1 7

